
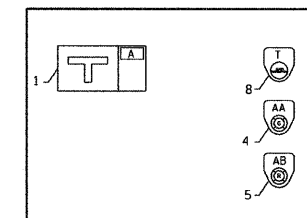


ITEM	NAMEPLATE SCHEDULE
A	POWER DISCONNECT
B	ELAPSED RUN TIME
C	PUMP STARTS
D	PUMP RUNNING
E	PUMP OFF
F	PUMP CALL
G	MANUAL START
H	MOTOR BUMP
I	MANUAL STOP
J	TIMED START
K	MANUAL OPERATION
L	MANUAL OPERATION - OFF - AUTO OPERATION
M	TIMED RUN TIMER
N	AMMETER
O	AMMETER SWITCH (OFF-OA-OB-OC)
P	MOTOR MOISTURE/TEMPERATURE DETECTOR
Q	MOTOR HIGH MOISTURE
R	MOTOR HIGH TEMPERATURE
S	BEARING HIGH TEMPERATURE
T	RESET
U	OPEN
V	GATE OPERATING
W	CLOSE
X	STOP
Y	LOCAL-OFF-REMOTE
Z	ON-OFF-AUTO
AA	ON
AB	OFF
AC	OPEN (DISCHARGE POSITION)
AD	CLOSED (RECIRCULATION POSITION)
AE	OPEN (RECIRCULATION POSITION)
AF	CLOSED (DISCHARGE POSITION)
AG	MOIST. DETECTOR TEST
AH	ON-AUTO


ITEM	NAMEPLATE SCHEDULE
AI	RAKE PARKED
AJ	RAKE JAMMED
AK	RAKE ON
AL	RAKE OFF
AM	SUPPLY FAN SF1
AN	EXHAUST FAN EF2
AO	GROUND FAULT
AP	
AR	

DEVICE LEGEND		
ITEM	DEVICE DESCRIPTION	DEVICE COLOR
1	MOTOR CIRCUIT PROTECTOR	
2	ELAPSED TIME METER	BLACK
3	ELECTROMECHANICAL COUNTER	BLACK
4	INDICATING LIGHT	GREEN
5	INDICATING LIGHT	RED
6	INDICATING LIGHT	YELLOW
7	PUSHBUTTON	GREEN
8	PUSHBUTTON	BLACK
9	PUSHBUTTON	RED
10	3 - POSITION SELECTOR SWITCH	BLACK
11	0 - 30 MINUTE TIMER, RESETABLE	BLACK
12	AMMETER	BLACK
13	AMMETER SWITCH (4-POSITION)	BLACK
14	CIRCUIT BREAKER	BLACK
15	LIGHTED PUSHBUTTON	RED
16	2-POSITION SELECTOR SWITCH	BLACK
17	ELECTRONIC METERING	BLACK
18	TRANSFER SWITCH CONTROLLER	


NAMEPLATE SCHEDULE 1" x 3"	
ITEM	ENGRAVING
MCC	MOTOR CONTROL CENTER - PS48
1A	1A-MAIN PUMP NO. 1 MP-1
1B	1B-PUMP ROOM EXHAUST FAN EF-2
1C	1C-PUMP ROOM UNIT HEATER EUH-2
1D	1D-LIGHTING TRANSFORMER PRIMARY BREAKER
1E	1E-SPARE BREAKER 3P-20A
2A	2A-MAIN PUMP NO. 2 MP-2
2B	2B-DISCHARGE SLIDE GATE ACTUATOR G1
2C	2C-SUMP PUMP CONTROL PANEL BREAKER 3P-20A
2D	2D-SPARE BREAKER 3P-20A
3A	3A-MAIN PUMP NO. 3 MP-3
3B	3B-RECIRCULATION SLIDE GATE ACTUATOR G2
3C	3C-SPACE
4A	4A-LOW FLOW PUMP LFP4
4B	4B-SPARE SIZE 1 FVNR
4C	4C-GENERATOR AUXILIARY PANEL
4D	4D-ELECTRICAL ROOM UNIT HEATER EUH-1
4E	4E-MONORAL
5A	5A-NORMAL LINE GROUND FAULT RELAY
5B	5B-EMERGENCY LINE GROUND FAULT RELAY
5C	5C-AUTOMATIC TRANSFER SWITCH (3P-200A)
6A	6A-NORMAL LINE TVSS
6B	6B-NORMAL LINE (ComEd) BREAKER (200A)
6C	6C-EMERG. LINE (GENERATOR) BREAKER (200A)
6D	6D-EMERG. LINE TVSS

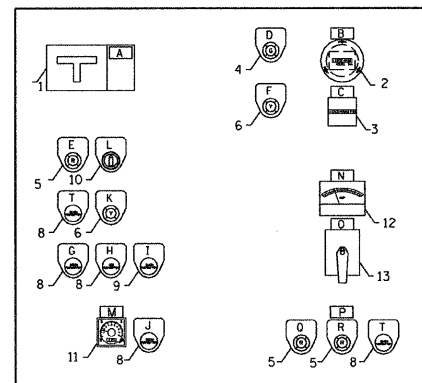

PUMP ROOM EXHAUST FAN EF2

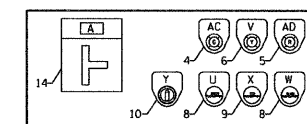

DISCHARGE SLIDE GATE ACTUATOR G1

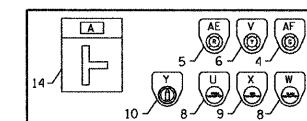

RECIRCULATION SLIDE GATE ACTUATOR G2

E5

REVISIONS	
NAME	DATE

ILLINOIS DEPARTMENT OF TRANSPORTATION
PUMP STATION NO. 48
REHABILITATION

MCC - ELEVATION

SCALE: N/A
DATE: 03-10-11
DRAWN BY: HFF
CHECKED BY: MS