



ELEVATION AT WEST ABUT.


TYPE III ELASTOMERIC EXP. BRG.

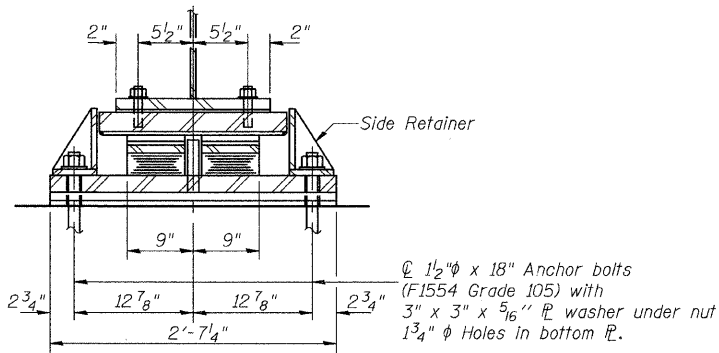

SECTION A-A

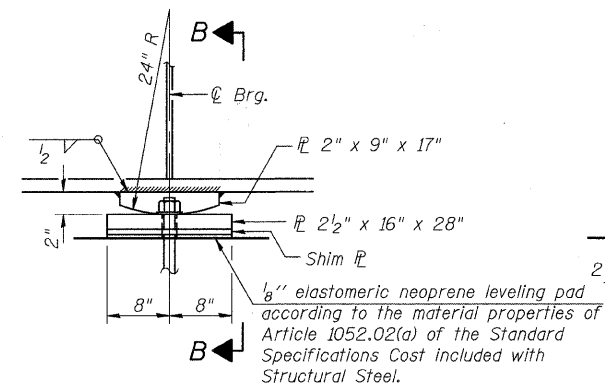


ELEVATION AT PIER

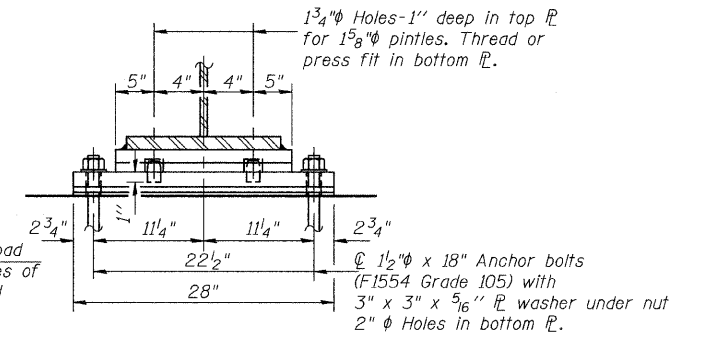


SECTION B-B


FIXED BEARING - PIERS 1, 2, 3 & 4

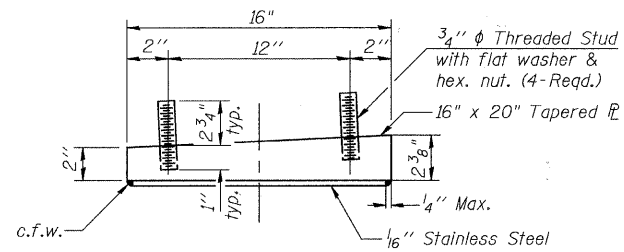

TOP BEARING ASSEMBLY

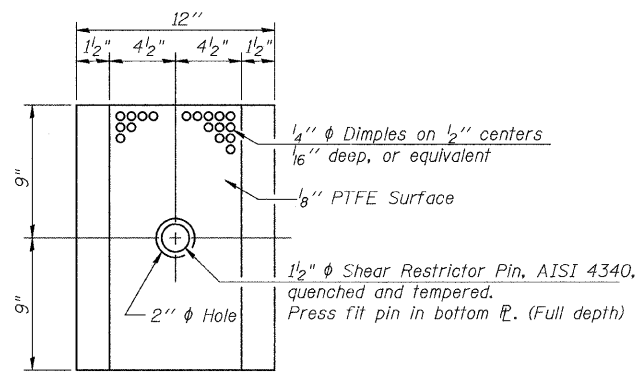

PLAN-PTFE ELASTOMERIC BRG.



PINTLE

Notes:
Anchor bolts shall be ASTM F1554 all-thread (or an Engineer-approved alternate material) of the grade(s) and diameter(s) specified. ASTM A307 Grade C anchor bolts may be used in lieu of ASTM F1554 Grade 36 (Fy=36ksi). The corresponding specified grade of AASHTO M314 anchor bolts may be used in lieu of ASTM F1554.

Anchor bolts at fixed bearings may be either cast in place or installed in holes drilled after the supported member is in place.

Anchor bolts for Type III bearings shall be placed in holes drilled in the concrete through holes in the bottom bearing plate after members are in place. Side retainers shall be placed after bolts are installed.


Drilled and set anchor bolts shall be installed according to Article 521.06 of the Standard Specifications.

Side retainers and other steel members required for the bearing assembly shall be included in the cost of Elastomeric Bearing Assembly, Type III.


The 1/8" PTFE sheet shall be bonded directly to the top steel plate with a two-component, medium viscosity epoxy resin, conforming to the requirements of the Federal Specification MMM-A-134, Type I. The bond agent shall be applied on the full area of the contact surfaces.

Bonding of 1/8" PTFE sheet during vulcanizing process will be permitted provided the process and method of adjusting assembly height is approved by the Engineer.


Two 1/8 in. adjusting shims shall be provided for each bearing in addition to all other plates or shims and placed as shown on bearing details.

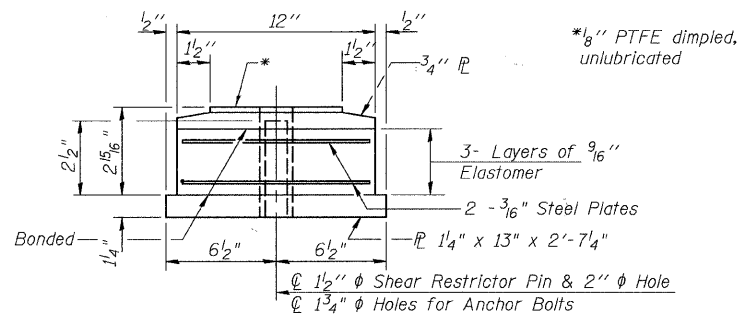


BOTTOM BEARING ASSEMBLY

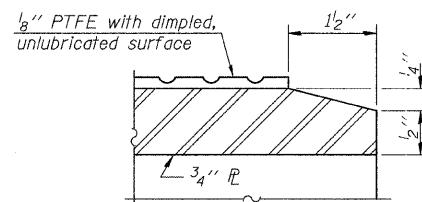

SECTION THRU PTFE




BELOW 50° F.
(Move bottom brg. away from fixed brg.)



ABOVE 50° F.
(Move bottom brg. toward fixed brg.)

SETTING ANCHOR BOLTS AT EXP. BRG.

D=1/8" per each 100' of expansion for every 15° temp. change from the normal temp. of 50° F.

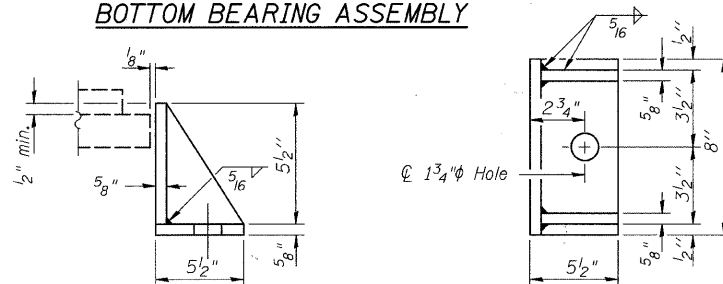

SIDE RETAINER

Equivalent rolled angle with stiffeners will be allowed in lieu of welded plates.

SHIM PLATES

Location	Girder 1	Girder 2A	Girder 2	Girder 3	Girder 4	Girder 5	Girder 5A	Girder 6
West Abutment	-	-	-	5/8"	1/8"	-	-	-
Pier 1	-	-	1/2"	-	-	-	-	-
Pier 2	-	-	-	-	-	-	-	-
Pier 3	-	-	-	-	3/8"	1/2"	-	-
Pier 4	-	-	-	-	3/8"	5/8"	1/8"	-
East Abutment	-	-	-	-	5/8"	-	-	1/2"

BILL OF MATERIAL

Item	Unit	Total
Elastomeric Bearing Assembly Type III	Each	6
Anchor Bolts 1 1/2"	Each	68

BEARING DETAILS
STRUCTURE NO. 099-4105

DESIGNED	JOH
CHECKED	BAN
DRAWN	TC
CHECKED	JOH

25458037

SHEET NO. 37 60 SHEETS	RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
	TR 55	90-16103-01-BR	WILL	255	181
		SN 099-4105	CONTRACT NO. 83126		
FED. ROAD DIST. NO. 7 ILLINOIS			FED. AID PROJECT BRS-		