



MEZZANINE LEVEL LIGHTING
NTS

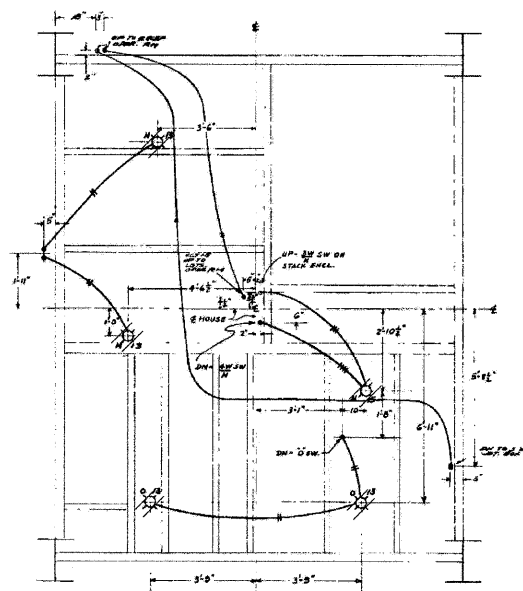


FLOOR CONDUITS ELEV +45.7 - OPERATORS LEVEL HOUSE
NTS

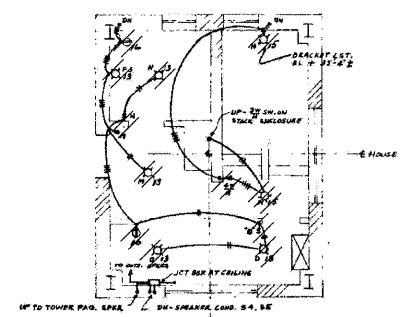


LIGHTING - SIDEWALK LEVEL - OPER. HOUSE
NTS

- SYMBOLS**
- DROP CORD
 - JCT. BOX
 - ▭ CEILING FIXTURE INC.
 - ▭ BRACKET FIXTURE INC.
 - ▭ FLUORESCENT FIXTURE 27-60W.
 - ⊥ 1 POLE SWITCH
 - ⊥ 3-POLE SWITCHES GANGED
 - ⊥ 3-WY SWITCH
 - ⊥ 4-WY SWITCH
 - ⊥ PLUS RECEPTACLE
 - ⊥ SILENCE
 - ⊥ INTERCOM. TELEPHONE
 - A, B, ETC. SWITCH CONTROL
 - 1/2, ETC. CIRCUIT NUMBER
 - LIGHTING CONDUIT EXPOSED
 - LIGHTING CONDUIT CONCEALED
 - INTERCOM. TEL. CONDUIT EXPOSED
 - INTERCOM. TEL. CONDUIT CONCEALED
 - BUZZER CONDUIT EXPOSED
 - BUZZER CONDUIT CONCEALED
 - SPEAKER CONDUIT EXPOSED
 - SPEAKER CONDUIT CONCEALED
 - STREET LIGHTING CONDUIT EXPOSED

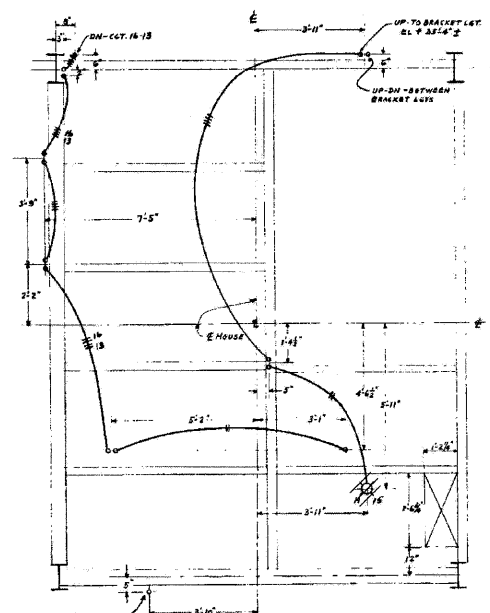

FLOOR CONDUITS ELEV +33.20 - SIDEWALK LEVEL HOUSE
NTS

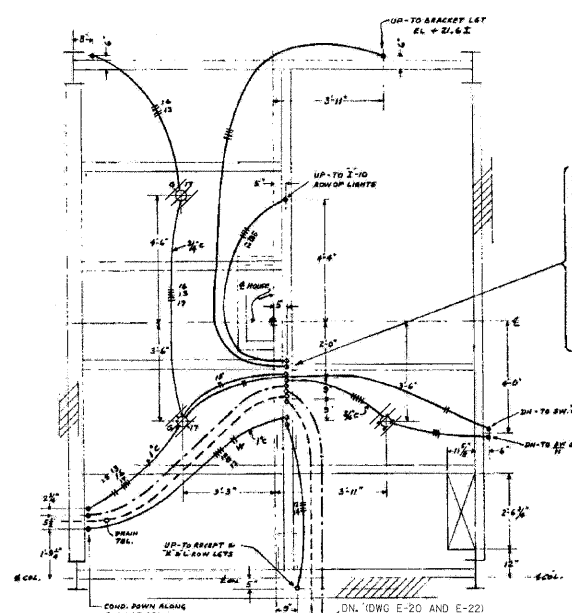

FLOOR CONDUITS ELEV +20.073 - MEZZANINE LEVEL HOUSE
NTS

- 1/2" ○ UP TO SW. X
- 3/4" ○ UP TO SW. SW (EXT. WALL LTS)
- 1 1/4" ○ UP TO 4 IN. SW. (CCT. 12)
- 3/4" ○ UP TO SW. SW.
- 1/2" ○ UP TO BUZZER (TO REMAIN)
- 1/2" ○ UP TO BUZZER (TO REMAIN)
- 1/2" ○ UP TO INTERCOM. TEL. (TO REMAIN)
- 3/8" ○ UP TO INTERCOM. TEL. (TO REMAIN)
- 1" ○ UP TO 9 GANG SW. (CCT. 12-12-12)
- 3/4" ○ UP TO SW. SW. (CCT. 12-12)

MEZZANINE AND SIDEWALK LEVELS
PLAN
NTS

- NOTES:**
- EAST SIDE SHOWN. WEST SIDE SAME WITH DIRECTION ARROW REVERSED AND AS NOTED.
 - PROVIDE TEMPORARY LIGHT AND POWER 24 HOURS PER DAY, 7 DAYS A WEEK.
 - DE-ENERGIZE AND DISCONNECT LIGHTING CIRCUITS 15, 18, 19 AND FOR BUZZER AT THE LIGHTING CABINET. REFER TO DWGS E-21 AND E-24. ALL LIGHTING CONDUIT RUNS CONCEALED IN FLOOR SLABS AND WALLS SHALL BE ABANDONED. WIRING SHALL BE REMOVED. ALL OPENINGS AS A RESULT OF DEMOLITION WORK SHALL BE CLOSED IN A MANNER APPROVED BY THE ENGINEER.
 - COORDINATE THIS DRAWING WITH DWG E-29.

PB Americas, Inc.
230 WEST MONROE STREET,
SUITE 900
CHICAGO, IL. 60606

USER NAME = sharma
FILE NAME = 0160d61-shr-elc-29.dgn
PLOT SCALE = NONE
PLOT DATE = 5/7/2009

DESIGNED - A. CENTENO
DRAWN - S. SHARMA
CHECKED - M. INTATANO
DATE - MAY 8, 2009

REVISED -
REVISED -
REVISED -
REVISED -

STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION

ELECTRICAL DEMOLITION
LIGHTING AND LOW TENSION SYSTEMS
MEZZANINE AND SIDEWALK LEVELS

SCALE: AS SHOWN SHEET NO. E-29 OF E-125 SHEETS STA. 379+06.09 TO STA. 382+45.28

F.A.P. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
389	2424-2B-R	COOK	398	300
CONTRACT NO. 60D61				

FED. ROAD DIST. NO. 1 ILLINOIS FED. AID PROJECT