


STREET LIGHTING ASSEMBLY COMPLETE TYPE F1

- - 150W HPS
- - 250W HPS

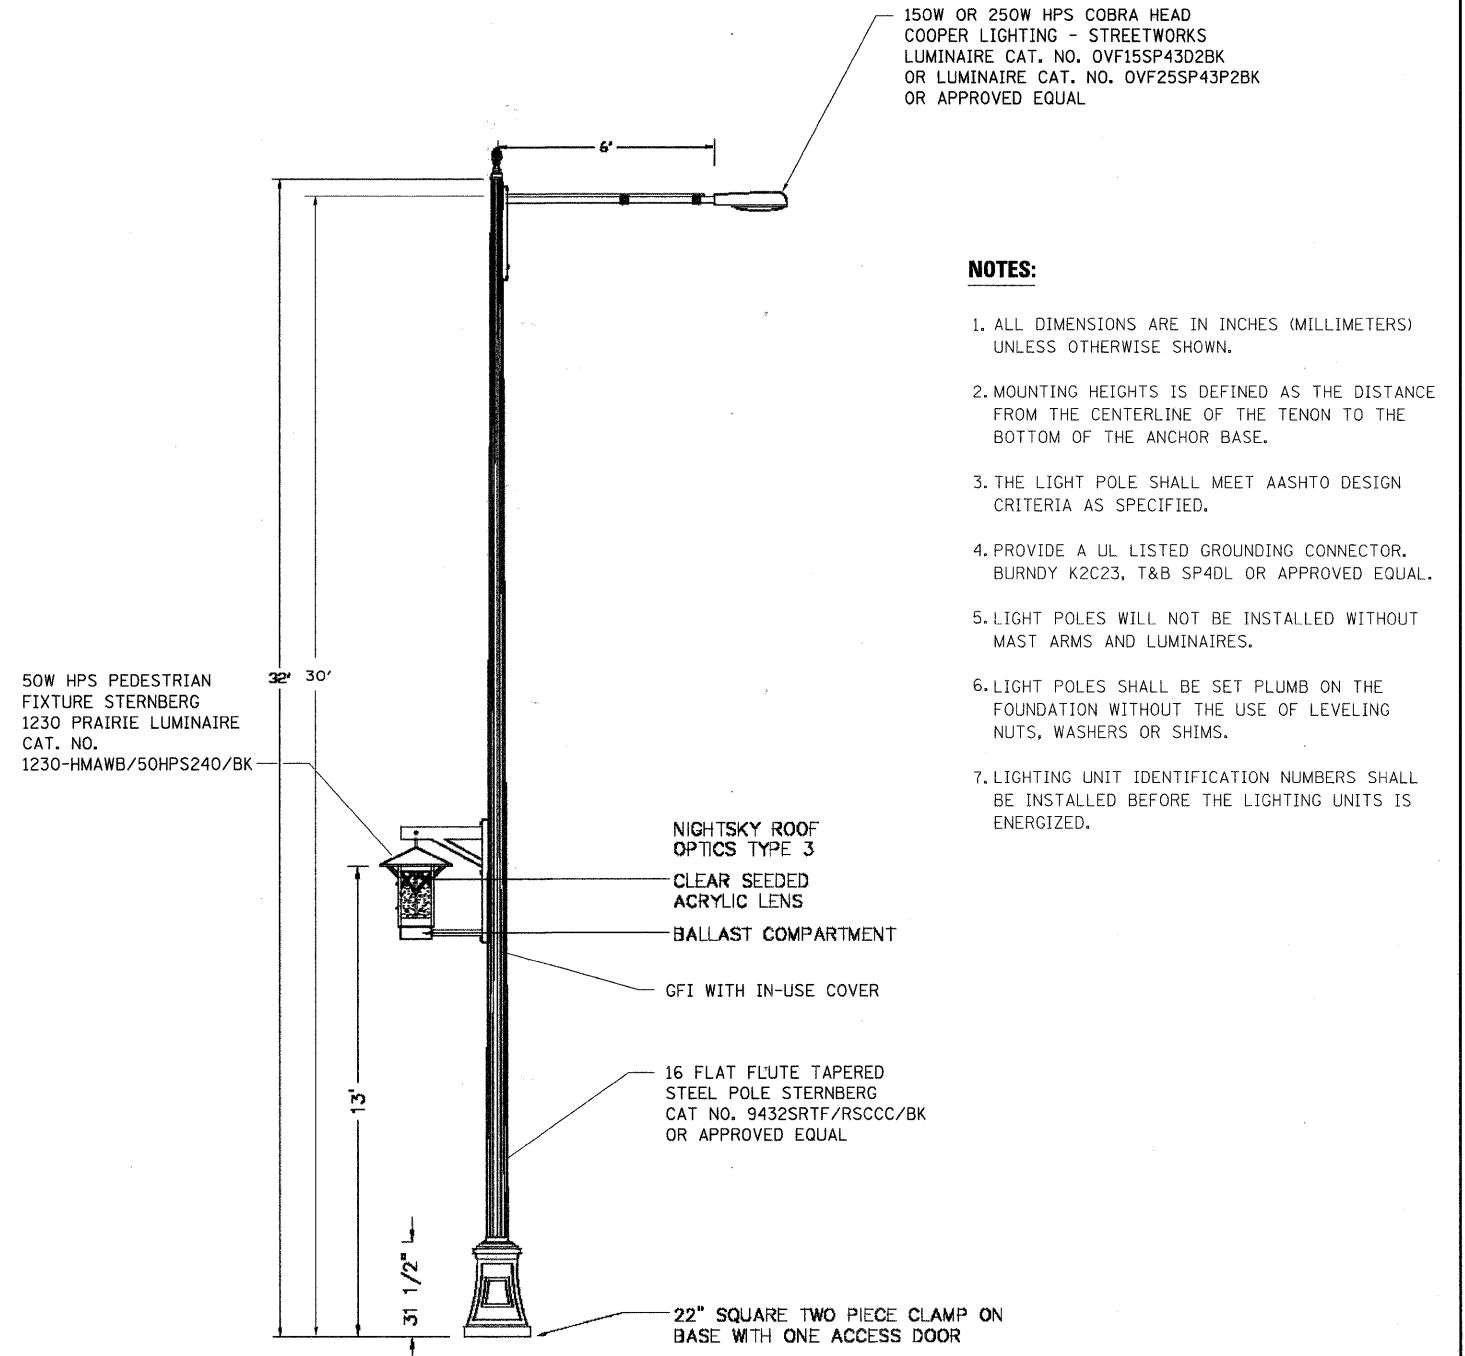

STREET LIGHTING ASSEMBLY COMPLETE TYPE F2

- - 150W HPS
- - 250W HPS

NOTES:

1. ALL DIMENSIONS ARE IN INCHES (MILLIMETERS) UNLESS OTHERWISE SHOWN.
2. MOUNTING HEIGHTS IS DEFINED AS THE DISTANCE FROM THE CENTERLINE OF THE TENON TO THE BOTTOM OF THE ANCHOR BASE.
3. THE LIGHT POLE SHALL MEET AASHTO DESIGN CRITERIA AS SPECIFIED.
4. PROVIDE A UL LISTED GROUNDING CONNECTOR, BURNDY K2C23, T&B SP4DL OR APPROVED EQUAL.
5. LIGHT POLES WILL NOT BE INSTALLED WITHOUT MAST ARMS AND LUMINAIRES.
6. LIGHT POLES SHALL BE SET PLUMB ON THE FOUNDATION WITHOUT THE USE OF LEVELING NUTS, WASHERS OR SHIMS.
7. LIGHTING UNIT IDENTIFICATION NUMBERS SHALL BE INSTALLED BEFORE THE LIGHTING UNITS IS ENERGIZED.



FILE NAME = 076_650edt05.dgn	USER NAME = #USER#	DESIGNED - L.B.	REVISED -	VILLAGE OF VILLA PARK, ILLINOIS	LIGHTING DETAIL	F.A. U. RTE. 2652	SECTION 00-00070-00-PV	COUNTY DuPAGE	TOTAL SHEETS 160	SHEET NO. 76		
PLOT SCALE = 1:1	CHECKED - S.K.	REVISED -	SCALE: 1"=20'			SHEET NO. 11 OF 12 SHEETS	STA. 63+19.78 TO STA. 116+71.35	CONTRACT NO. 63379				
PLOT DATE = 6/15/2010	DATE - 9/23/2009	REVISED -	FED. ROAD DIST. NO. [ILLINOIS] FED. AID PROJECT									