



GENERAL LIGHTING NOTES

1. ALL PROPOSED LIGHTING UNITS SHALL BE LABELED ACCORDING TO THE STANDARD SPECIFICATIONS, WITH POLE NUMBERS ATTACHED WITH STAINLESS STEEL BANDING. LIGHTING UNIT NUMBERING SHALL BE AS DIRECTED BY THE ENGINEER.
- ~~2. EXISTING LIGHT POLES AND FOUNDATIONS TO BE REMOVED, AND ALL ASSOCIATED HARDWARE AND APPURTENANCES, SHALL NOT BE SALVAGED BUT SHALL BECOME THE PROPERTY OF THE CONTRACTOR AND SHALL BE DISPOSED OF OFF SITE AT THE CONTRACTOR'S EXPENSE.~~
2. CONTRACTOR SHALL INSTALL LIGHT POLES AT THE LOCATIONS INDICATED ON THE PLANS, MAINTAINING ADEQUATE CLEARANCE FROM OVERHEAD UTILITY LINES. CONTRACTOR SHALL BE RESPONSIBLE TO VERIFY CLEARANCES PER THE NATIONAL ELECTRICAL SAFETY CODE AND/OR THE REQUIREMENTS OF THE UTILITY COMPANIES. THE LOCATION OF BURIED AND ABOVE GROUND UTILITIES SHOWN ARE APPROXIMATE AND ARE SHOWN FOR INFORMATION ONLY. REROUTING, DISCONNECTION, RELOCATION, PROTECTION ETC., OF ANY UTILITIES MUST BE COORDINATED BETWEEN THE CONTRACTOR, UTILITY COMPANY, AND OWNER. THE CONTRACTOR SHALL VERIFY THE EXACT LOCATION OF ALL UNDERGROUND UTILITIES PRIOR TO CONSTRUCTION.
3. THE CONTRACTOR IS RESPONSIBLE FOR UNCOVERING OR HAND DIGGING AROUND UTILITIES AS NECESSARY. THE COST OF THIS WORK IS TO BE INCLUDED WITH THE "TRENCH AND BACKFILL FOR ELECTRICAL WORK" PAY ITEM.
4. UNDERGROUND CABLE MARKING TAPE SHALL BE INSTALLED ACCORDING TO SECTION 819 OF THE STANDARD SPECIFICATIONS. THE COST OF THIS WORK IS TO BE INCLUDED IN THE "TRENCH AND BACKFILL FOR ELECTRICAL WORK" PAY ITEM.
5. CONTRACTOR SHALL INSTALL UNIT DUCT AT A MINIMUM OFFSET OF FIVE FEET FROM ALL EXISTING STORM SEWERS.
6. THE CONTRACTOR SHALL LOCATE THE TWIN DAVIT ARM POLES IN THE MEDIAN IN A STRAIGHT LINE TO PRODUCE A CLEAN VISUAL APPEARANCE WHENEVER POSSIBLE. IF CONFLICTS WITH UNDERGROUND FACILITIES ARE ENCOUNTERED, CONSULT THE ENGINEER.
7. THE CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINING THE LIGHTING SYSTEM UNTIL IDOT HAS TAKEN ACCEPTANCE OF THE SYSTEM. ALL EXISTING CIRCUITS AND CABLES TO THE LIGHT POLES SHALL BE MAINTAINED AS NEEDED AND THIS WORK SHALL BE INCIDENTAL TO THE CONTRACT.

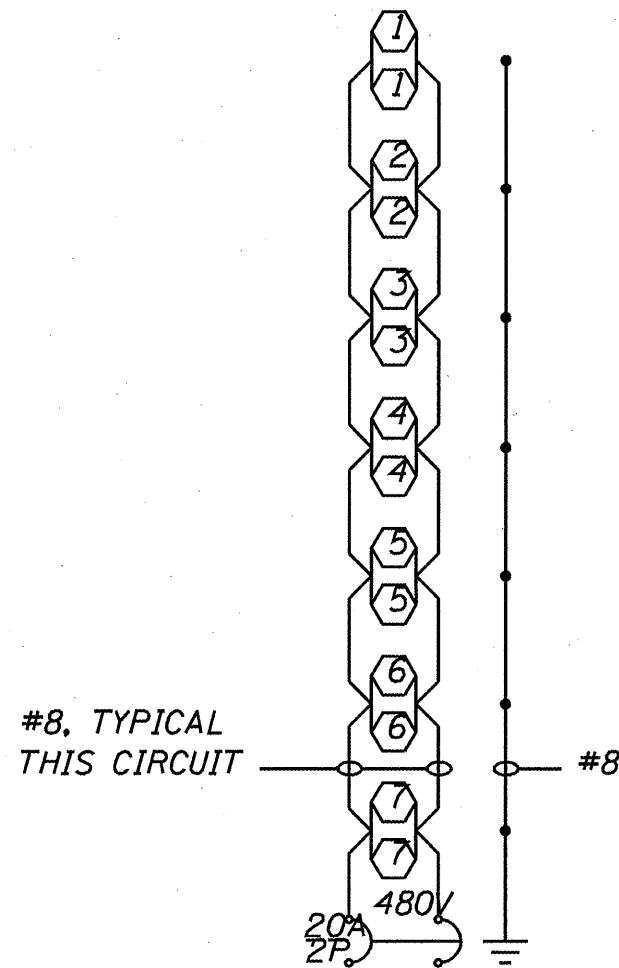

#8, TYPICAL
THIS CIRCUIT

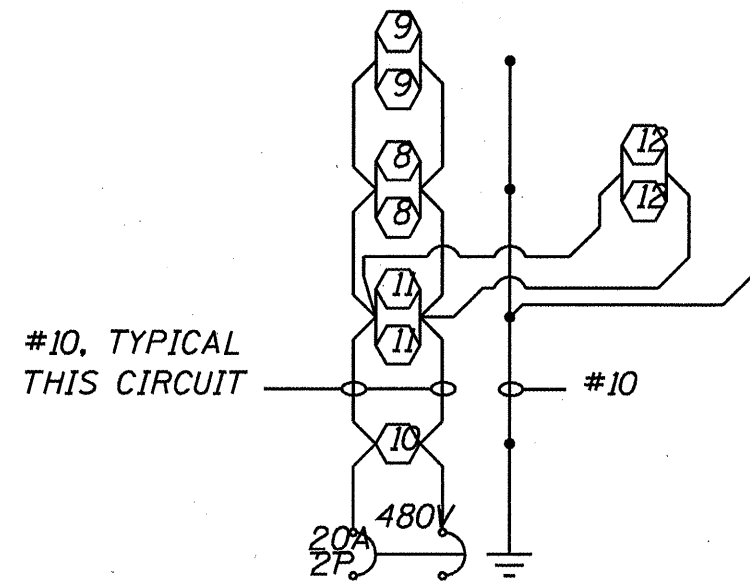

#10, TYPICAL
THIS CIRCUIT

LIGHTING CKT 1
PROPOSED LIGHTING CONTROLLER NO. 1

LIGHTING CKT 2
PROPOSED LIGHTING CONTROLLER NO. 1

NOTES:

1. ALL NECESSARY REVISIONS TO THE WIRING SHOWN ON THIS SHEET SHALL BE MADE AT NO ADDITIONAL COST TO THE DEPARTMENT AND TO THE SATISFACTION OF THE ENGINEER.

⬡ 400W ROADWAY LUMINAIRE

SCHEMATICS
STEVENSON DR/I 55 BUS
SECTION (15.110X)L
SANGAMON COUNTY

Rev.