# CONDUIT ENTRANCE INTO MANHOLE/HANDHOLE

APPLICABLE TO SWITCHGEAR AND TRANSFORMER VAULTS

### GENERAL

CONDUIT ENTRANCES INTO MANHOLES/HANDHOLES SHALL NORMALLY BE MADE WITH PLASTIC ENTRANCE BELLS PER FIGURE 1 OR 2. THE ENTRANCE CONDUIT SHALL BE PLASTIC OR STEEL ENCASED IN CONCRETE AS PER FIGURE 1 AND 2 BELOW, SPECIFIED BY THE ENGINEER ON THE CONSTRUCTION DRAWINGS. POCKETS

DUCT POCKETS SHALL BE PROVIDED IN WALLS WHERE SPECIFIED ON CONSTRUCTION DRAWINGS. POCKET NOT REQUIRED ON NEWER STYLE MANHOLE DESIGNS (FIGURE 2). TYPICAL POCKET DIMENSIONS ARE INDICATED BELOW ON FIGURE 1. CONDUIT SPACING

CONDUIT SHALL NORMALLY BE SUPPORTED BY VERTICAL AND HORIZONTALLY INTERLOCKED PLASTIC SPACERS TO PROVIDE ALIGNMENT WITH PLASTIC ENTRANCE BELL UNITS AT 8 1/4 IN. SPACING. ENTRANCE BELL UNITS

PLASTIC 6 INCH ENTRANCE BELLS, DPU-E# 285-103-00100 SHALL BE USED ON CONDUIT ENTRANCES TO MANHOLES.

GALVANIZED STEEL CONDUIT, M30-1550, SHALL BE USED FOR ALL BENDS. PIPES INTENDED FOR CABLES ON INITIAL INSTALLATION SHALL BE CAPPED WITH PLUGS (DPU-E# 285-103-00090) TO PREVENT CONTAMINATION FROM ENTERING THE PIPES.

### INSTALLATION METHODS

EVERY EFFORT SHALL BE MADE TO INSURE A WATERTIGHT INSTALLATION OF ENTRANCE PIPES. WHERE PIPES ARE INSTALLED THROUGH AN OPENING LEFT IN A MANHOLE, OR BROKEN OUT OF AN EXISTING MANHOLE WALL, SURFACES SHALL BE CLEANED, WETTED AND COVERED WITH A COATING OF 3 TO 1 SAND AND CEMENT MORTAR. IF BRICKWORK IS EXISTING ON THE INNER FACE OF WALL, IT SHALL ALSO BE COATED WITH A SAND AND CEMENT MORTAR. AN ALTERNATE PROCEDURE IS TO DRILL HOLES IN THE WALL AND GROUT THE PIPES IN PLACE WITH A SAND AND CEMENT MORTAR. THE INSIDE SURFACE OF THE HOLES SHALL BE ROUGHENED TO OBTAIN A STRONG AND WATERTIGHT BOYD.

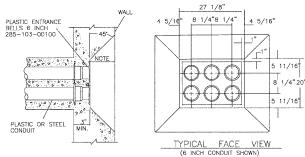


FIG. 1 MANHOLE ENTRANCE WITH PLASTIC TERMINATORS (OLDER STYLE)

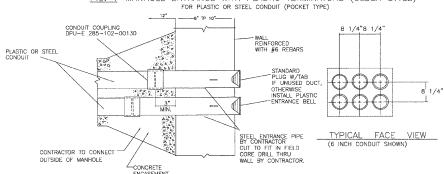


FIG. 2 ENTRANCE IN MANHOLE/HANDHOLE (NEWER STYLE)

NAPERVILLE PUBLIC	DUOTE AND CONTRACTOR	DATE: 04-24-07
UTILITIES DEPARTMENT	DUCTBANK CONSTRUCTION	Page 8 of 12
ELECTRIC STANDARDS	SPECIFICATION	C30-1900

# CONDUIT TO RISER AT POLE

# DUCTBANK

### APPLICATION


3' MINIMUM (1)

English Park

4.45.00 —6" PLASTIC CONDUIT


CONCRETE ENCASEMENT





STEEL BEND

## RISER CONSTRUCTION FOLLOW CONSTRUCTION STANDARD C20-5220

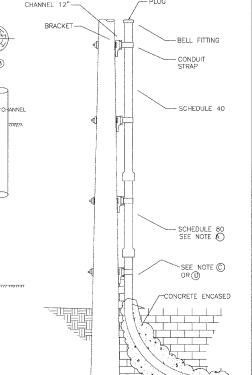

### SUPPLEMENTARY MATERIAL

① COUPLING ② ①

20 2 1 1 2 20 1 2 2 4 0 15 A 17 1 2

IF BELLED END OF PLASTIC CONDUIT CAN BE CONNECTED TO STEEL BEND OMIT COUPLING.

6" PLASTIC CONDUIT PLASTIC BEND (5)

ELEVATION

FOR PLASTIC CONDUIT

INSTALL U-GUARD\*\_ OR CONDUIT PIPE

3" MINIMUM

CONCRETE

- A). FIRST SECTION ABOVE ELBOW MUST BE SCHEDULE 80.
- B). FOR LARGER POLES (>50'), ADDITIONAL CONDUIT AND HARDWARE MAY BE REQUIRED.
- C). STEEL BEND AND POLE BRACKET EXISTING FROM PREVIOUS DUCT BANK INSTALLATION.
- D). INSTALL STEEL BEND AND POLE BRACKET AND CHANNEL.

NAPERVILLE PUBLIC

UTILITIES DEPARTMENT

ELECTRIC STANDARDS

E). INSTALL SPARE OF CONDUIT UP POLE WITH BEND, ATTACH TO BRACKET AND PLUG.

DATE: 04-24-07 DUCTBANK CONSTRUCTION Page 9 of 12 C30-1900 SPECIFICATION

(2) FIELD CUT SO THAT A GOOD CONNECTING FIT CAN BE MADE BETWEEN THE CONDUITS AND BENDS.

(3) LOCATE THE BEND ON A QUADRANT OF THE POLE WHERE IT IS THE LEAST SUSCEPTIBLE TO DAMAGE BY VEHICLES.

(4) IF SPARE DUCT IS INSTALLED, PLUG AT BOTH ENDS AND ENCASE IN CONCRETE WHEN NECESSARY.


(5) SCHEDULE 80 PVC DOES NOT REQUIRE CONCRETE ENCASEMENT.

6 CONDUIT TO A U-GUARD\* RISER FOLLOWS C20-5222, FOR USE

INFORMATION


COUNTY SECTION 00-00116-00-BR DUPAGE /06 74 3570 STA. 4+38.47 TO STA. 14+62.4 FED. ROAD DIST. NO. | ILLINOIS FED. AID PROJECT

# PLASTIC CONDUIT COUPLINGS FOR CONCRETE ENCASED PLASTIC CONDUIT



# PLASTIC TO STEEL COUPLING

SIZE	DPU-E #	MATERIAL / USE
3"	285-102-00040	PLASTIC TO PLASTIC
5"	285-102-00110	PLASTIC TO PLASTIC
6"	285-102-00140	PLASTIC TO PLASTIC
5"	285-102-00110	PLASTIC TO STEEL
6"	285-102-00140	PLASTIC TO STEEL




# PLASTIC TO PLASTIC 5° COUPLING

SIZE	DPU-E #	MATERIAL / USE
3"	285-102-00050	PLASTIC TO PLASTIC
5"	285-102-00120	PLASTIC TO PLASTIC
6"	285-102-00150	PLASTIC TO PLASTIC

# PLUG W/PULL TAB


SIZE	DPU~E #		
3"	285-103-00030		
5"	285-103-00070		
6"	285-103-00090		



### PLASTIC TO PLASTIC OR PLASTIC TO STEEL SLEEVE


CONTRACT 83827

SIZE	DPU-E #	MATERIAL / USE
3"	285-102-00060	PLASTIC TO PLASTIC
5"	285-102-00100	PLASTIC OR STEEL
6"	285-102-00130	PLASTIC OR STEEL



## PLASTIC BELL END FITTINGS

SIZE	DPU-E #	MATERIAL
3"	285-103-00040	PLASTIC
5"	285-103-00080	PLASTIC
6"	285-103-00100	PLASTIC



THE 6" EXPANDING PLUG W/EYE NUT DPU-E# 285-103-00150

NAPERVILLE PUBLIC UTILITIES DEPARTMENT ELECTRIC STANDARDS

DUCTBANK CONSTRUCTION SPECIFICATION

DATE: 04-24-07 Page 10 of 12 C30-1900

	CITY	OF	NAPE	RVILLE	DEPARTMENT	OF PUBLIC U	JTILITIES - EL	ECTRIC
			CALL	J.U.L.	.I.E. 48 HRS.	PRIOR TO CO	NSTRUCTION	(6
PROJECT TI		ON ST	. BRI	DGE	DUCTBANK IN	ISTALLATION	MAP NO.:	CAD FILE: 0054679001D19.DW
PROJECT DE	SCRIPTION	1		DETA	AILS		DRAWN BY: JK, PM	PROJECT NO.: EU13-04-06
DATE	4-01 09				WORK REQUEST NO.	CHKD:	SBC:	COMPLETED BY:
ISSUED					54679			
ENGINEER REVISION	PSM	1	2	3	01070	APRV:	SCALE : NTS	SHEET 19 OF 30