



**FOR CONCRETE ENCASED CONDUIT**  
PER S. UP TO 90° DEGREE ANGLES

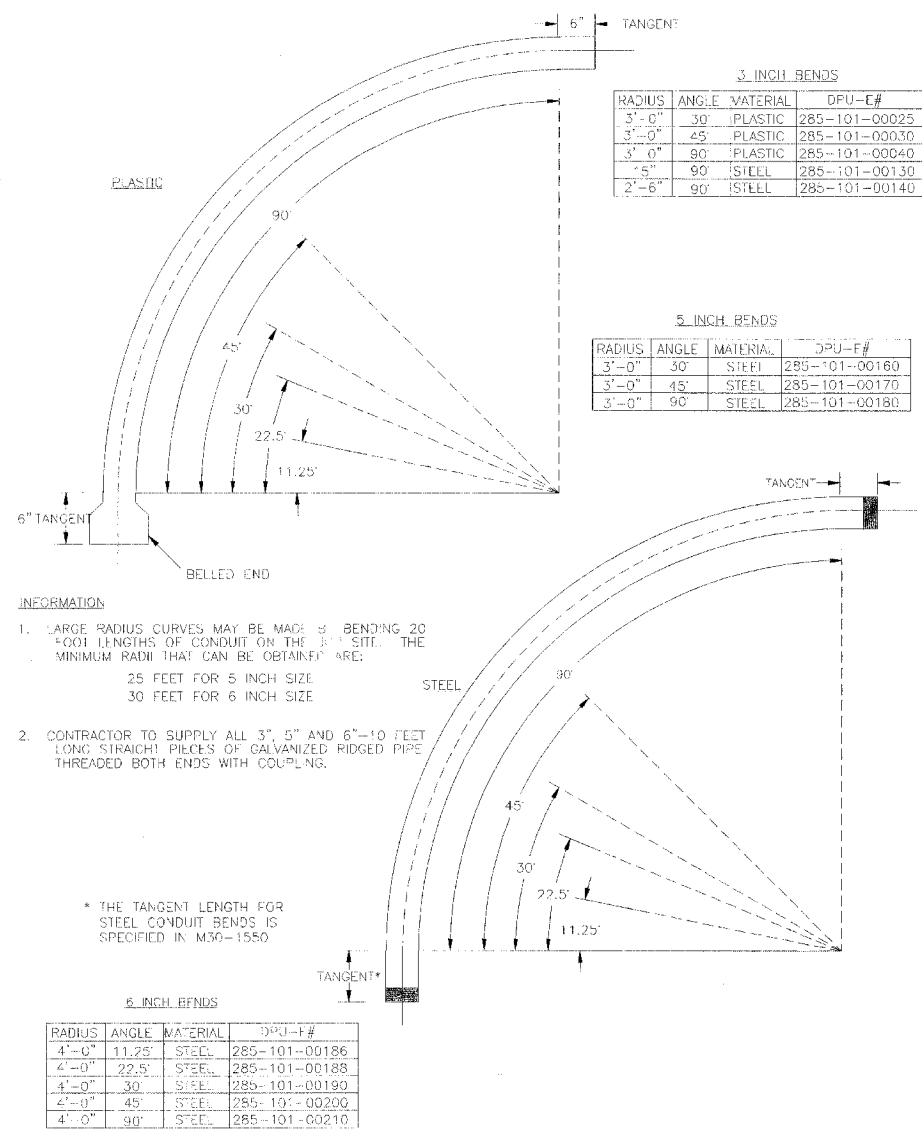

**EXCAVATION DETAIL ELECTRICAL**

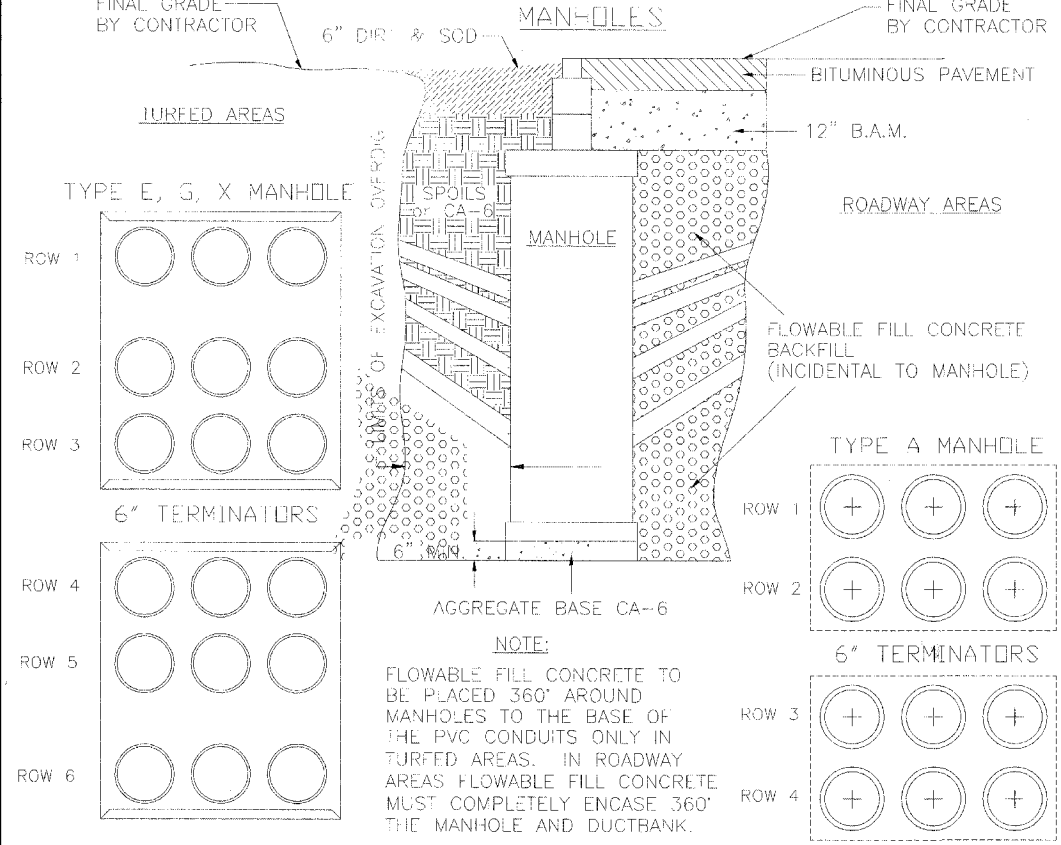

TYPICAL DUCT BANK ARRANGEMENT FOR PORT USAGE IN 6" MANHOLES

TYPE	ROW 1	ROW 2	ROW 3	ROW 4	ROW 5	ROW 6
4-WAY DUCT BANK	-----	-----	-----	2 X 6"	2 X 6"	-----
6-WAY DUCT BANK	-----	-----	-----	3 X 6"	3 X 6"	-----
8-WAY DUCT BANK	-----	-----	2 X 6"	3 X 6"	3 X 6"	-----
9-WAY DUCT BANK	-----	-----	3 X 6"	3 X 6"	3 X 6"	-----
10-WAY DUCT BANK	-----	1 X 6"	3 X 6"	3 X 6"	3 X 6"	-----
12-WAY DUCT BANK	-----	3 X 6"	3 X 6"	3 X 6"	3 X 6"	-----

FILL THE OUTSIDE DUCTS IN EACH ROW FIRST

<b>WF# INFORMATION</b>		<b>CITY OF NAPERVILLE/DEPARTMENT OF PUBLIC UTILITIES - ELECTRIC</b>			
WF# 59481 WASHINGTON ST. 75TH TO OLYMPUS DR. EAST SIDE	JOB 1 EU-73	CALL J.U.U.L.E. 48 HRS. PRIOR TO CONSTRUCTION		MAP NO.:	CAD FILE:
WF# 59482 75TH WASHINGTON ST. TO OLYMPUS DR. NORTH SIDE	JOB 2 EU-73	<b>75TH ST. AND WASHINGTON ST. ROAD IMPROVEMENTS</b>		0056270001D39.DWG	
WF# 59484 75TH WASHINGTON ST. TO CLYDE DR. SOUTH SIDE	JOB 3 EU-73	TRENCH SECTION DETAILS		DRAWN BY: JK, JLM	PROJECT NO.: EU12-06-03 EU73
WF# 59485 WASHINGTON ST. 75TH TO BAILEY RD. EAST SIDE	JOB 4 EU-73	DATE: 4-01-08	WORK REQUEST NO.:	56270	CHRG:
		ISSUED:			SBC:
		ENGINEER: RPS			COMPLETED BY:
		REVISION:			SCALE: NTS
					SHEET 39 OF 73