

STEEL PILE TABLE


Designation	Depth d	Flange width b _f	Web and Flange thickness t	Encasement diameter A
HP 14x117	14 4"	14 ⁷ 8"	¹³ 16 "	30"
x102	14"	14 ³ 4"	″ ₁₆ "	30"
x89	13 ⁷ 8"	14 ³ 4"	5 ₈ "	30"
x73	13 ⁵ 8"	14 ⁵ 8 "	2"	30"
HP 12x84	121/4"	12 4"	¹ 16"	24"
x74	12 ^l 8"	12 4"	⁵ 8"	24"
x63	12"	12 ^l 8"	12"	24"
x53	11 ³ 4 "	12"	⁷ 16 "	24"
HP 10x57	10"	1014"	⁹ 16 "	24"
x42	9 ³ 4"	10 ¹ 8 "	⁷ 16 "	24"
HP 8x36	8"	818"	⁷ 16 "	18"




ELEVATION




H-PILE SHOE ATTACHMENT



DETAIL "B"

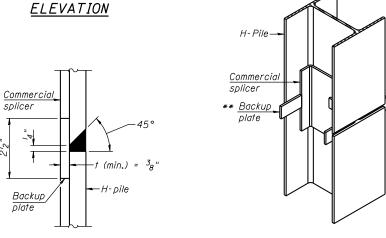

WELDED COMMERCIAL SPLICE

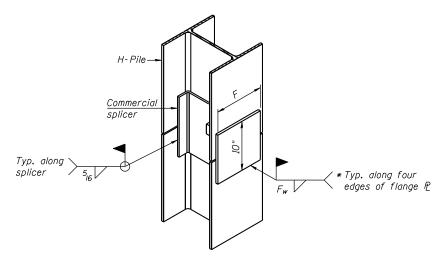

ISOMETRIC VIEW

Bottom of pile cap


ELEVATION


Welded wire fabric 6 x 6-W4.0 x W4.0 weighing 58#/100 sq. ft. Bend as required to fit into wall.

Forms for encasement may be omitted when soil conditions permit.

SECTION A-A


PILE ENCASEMENT

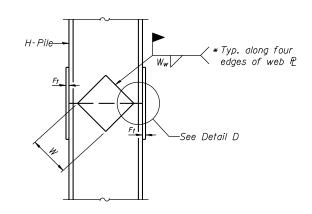

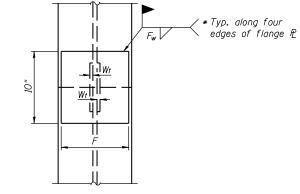

ELEVATION

END VIEW



DETAIL D

$ \begin{array}{c ccccccccccccccccccccccccccccccccccc$	Designation	F	F _t	F _w	W	W _f	Ww
$\begin{array}{c ccccccccccccccccccccccccccccccccccc$	HP 14x117	12 ¹ 2"	1"	⁷ 8"	7 ³ 4"	⁵ 8"	12"
$\begin{array}{c ccccccccccccccccccccccccccccccccccc$	x102	12 ¹ 2"	⁷ 8"	34"		5 ₈ "	12"
$\begin{array}{c ccccccccccccccccccccccccccccccccccc$	x89	12 ¹ 2"	34"	"16"	7 ³ 4"	5 ₈ "	¹ 2"
$ \begin{array}{c ccccccccccccccccccccccccccccccccccc$	x73	12 ¹ 2"	⁵ 8"	916 "	7 ³ 4"	5 ₈ "	12"
$ \begin{array}{c ccccccccccccccccccccccccccccccccccc$	HP 12x84	10"	⁷ 8"	"16"	6½"	5 ₈ "	¹ 2"
$ \begin{array}{c ccccccccccccccccccccccccccccccccccc$	x74	10"	⁷ 8"	"16"	6½"	5 ₈ "	12"
HP 10x57 8" 34" 96" 514" 12" 38" x42 8" 58" 96" 514" 12" 38"	x63	10"	⁵ 8"	12"	6½"	2"	3 ₈ "
x42 8" 58" 916" 514" 12" 38"	x53	10"	⁵ 8"	12"	6½"	2"	3 ₈ "
	HP 10x57	8"	34"	9 ₁₆ "	5¼"	2"	3 ₈ "
	x42	8"	⁵ 8"	916 "	5¼"	2"	3 ₈ "
HP 8x36 7" ⁵ 8" ⁷ 16" 4 ¹ 4" ¹ 2" ³ 8"	HP 8x36	7"	⁵ 8"	⁷ /6 "	414"	2"	³ 8"

WELDED PLATE FIELD SPLICE

WELDED COMMERCIAL SPLICE ALTERNATE

- * Interrupt welds $^{l}_{4}$ " from end of web and/or each flange.
- ** Remove portions of backup plates that extend outside the flanges.

*** Weld size per pile shoe manufacturer (${}^{5}_{16}$ " min.).

The steel H-piles shall be according to AASHTO M270 Grade 50.

1170 SOUTH HOUBOLT ROAD USER NAME = brianf JOLIET, ILLINOIS 60431

STRAND
ASSOCIATES IDFPR NO. 184-001273

DESIGNED - RRD REVISED CHECKED - AJS REVISED BJF REVISED PLOT DATE = 1/29/2013 CHECKED - RRD REVISED

STATE OF ILLINOIS **DEPARTMENT OF TRANSPORTATION**

ISOMETRIC VIEW

HP PILE DETAILS STRUCTURE NO. 016-0587 SHEET NO. 35 OF 42 SHEETS

SECTION COUNTY COOK/DUPAGE 161 123
CONTRACT NO. 6OK77 55 22-1HB-R

1-27-12