
SEWER AND WATER MAIN CROSSINGS

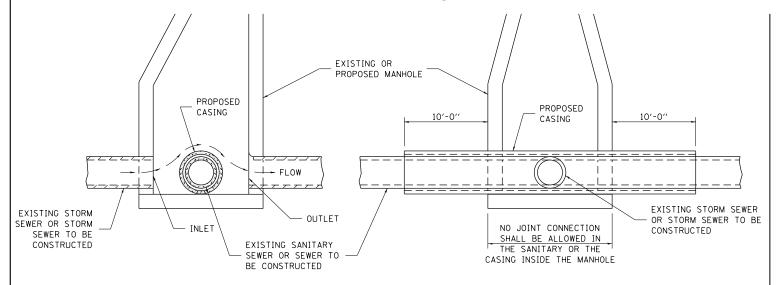

ELEVATION - ECCENTRIC

AT GRADE CROSSING OF

ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE NOTED

SANITARY AND STORM SEWER

TOTAL SEWER

POINT LOADS SHALL NOT BE ALLOWED BETWEEN SEWER OR SEWER CASING AND WATER MAIN PROVIDE ADEQUATE SUPPORT FOR EXISTING WATER MAIN TO PREVENT DAMAGE DUE TO SETTLEMENT OF SEWER TRENCH

CASING SHALL BE CAST IRON WITH AN INSIDE

ENCASED PIPE OUTSIDE DIAMETER WITH BOTH

DIAMETER 2" LARGER IN DIAMETER THAN

ENDS OF CASING SEALED


PROPOSED SEWER

10'-0"

STORM SEWER
WATER MAIN

PROVIDE ADEQUATE SUPPORT FOR EXISTING WATER MAIN
TO PREVENT DAMAGE DUE TO SETTLEMENT OF SEWER TRENCH

MAINTAIN 18 MINIMUM VERTICAL SEPARATION FOR 10 FT. HORIZONTALLY

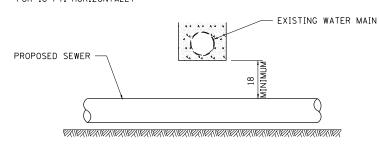


ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE NOTED

PROPOSED SEWER LINE BELOW EXISTING WATER MAIN PROVIDE ADEQUATE SUPPORT FOR EXISTING SEWER LINE TO PREVENT DAMAGE DUE TO SETTLEMENT


PLACE TRENCH BACKFILL FOR 10 FT. ON EITHER SIDE OF SEWER LINE

ELEVATION - CONCENTRIC

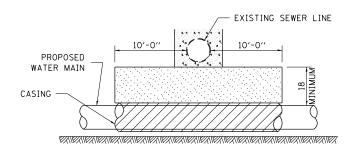

CASING SHALL BE CAST IRON WITH AN INSIDE DIAMETER 2" LARGER IN DIAMETER THAN ENCASED PIPE OUTSIDE DIAMETER WITH BOTH ENDS OF CASING SEALED

PROVIDE ADEQUATE SUPPORT FOR EXISTING WATER MAIN TO PREVENT DAMAGE DUE TO SETTLEMENT OF SEWER TRENCH MAINTAIN 18 MINIMUM VERTICAL SEPARATION



NOT ALLOWED

MUST MAINTAIN 18 VERTICAL SEPARATION

ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE NOTED


FOR 10 FT. HORIZONTALLY


PROPOSED WATER MAIN BELOW EXISTING SEWER LINE


THIS DETAIL IS FOR UNKNOWN UTILITIES UNLESS QUANTITIES ARE INCLUDED IN THE PLANS THE EXTRA WORK WILL BE PAID FOR IN ACCORDANCE WITH ARTICLE 109.04.

WHEN PROPOSED SEWER (OR WATER) IS LOCATED 10'-0" OR MORE FROM EXISTING WATER (OR SEWER) NO SPECIAL CONSTRUCTION REQUIRED.

WHEN PROPOSED SEWER (OR WATER) IS LOCATED LESS THAN 10'-0" FROM EXISTING WATER (OR SEWER) DETAILS BELOW SHALL APPLY.

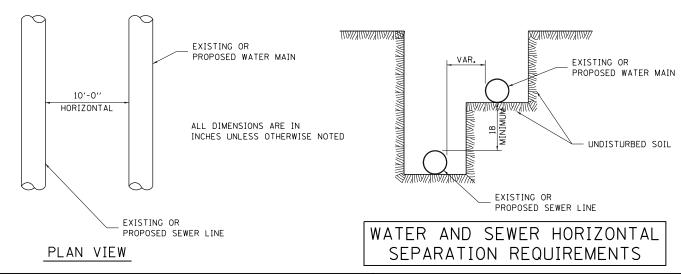



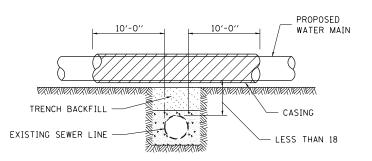

CASING SHALL BE CAST IRON WITH AN INSIDE DIAMETER 2" LARGER IN DIAMETER THAN ENCASED PIPE OUTSIDE DIAMETER WITH BOTH ENDS OF CASING SEALED

ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE NOTED

SCALE.

PROPOSED WATER MAIN ABOVE EXISTING SEWER LINE

PROVIDE ADEQUATE SUPPORT FOR SEWER TO PREVENT SETTLING AND BREAKING THE WATER MAIN.

WATER MAIN 10'-0" PROPOSED SEWER

TRENCH WIDTH SEWER WATER MAIN MINIMUM 18

EXISTING WATER MAIN INCHES

UNLESS OTHERWISE NOTED

EXISTING WATER MAIN BELOW
PROPOSED SEWER LINE WITH MINIMUM
18 VERTICAL SEPARATION

STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION

REGION 2 / DISTRICT 2 STANDARD

SHEET NO. OF SHEETS STA.

TO STA.