



F.A. ILL. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
8419	99-00048-01-PV	FAYETTE	142	98
STA.	TO STA.			
FED. ROAD DIST. NO.		ILLINOIS FED. AID PROJECT		
CONTRACT NO. 95500				

STERNBERG CAMBRIDGE SERIES PRISMATIC ACORN WITH FINIAL AND 5P FITTER (A780/5P), 100 WATT METAL HALIDE LAMP (100MH), ROOF OPTICS TYPE 3 (R03H-S), HOUSE SIDE SHEILD (HSS). (OR EQUIVALENTS APPROVED BY THE CITY)

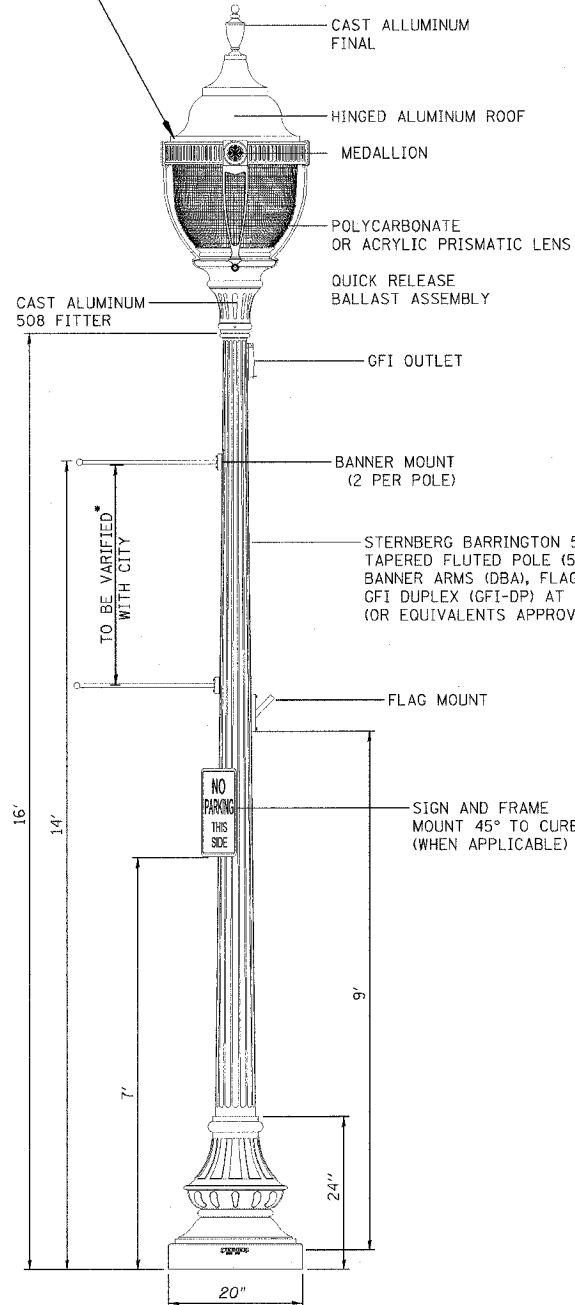


VINTAGE STYLE STREET LIGHT ON BLACK ORNAMENTAL POLE


• POLE MUST BE IN ACCORDANCE WITH AASHTO LOADING REQUIREMENTS AS REFERENCED IN SEC 830 OF THE STANDARD SPECIFICATIONS

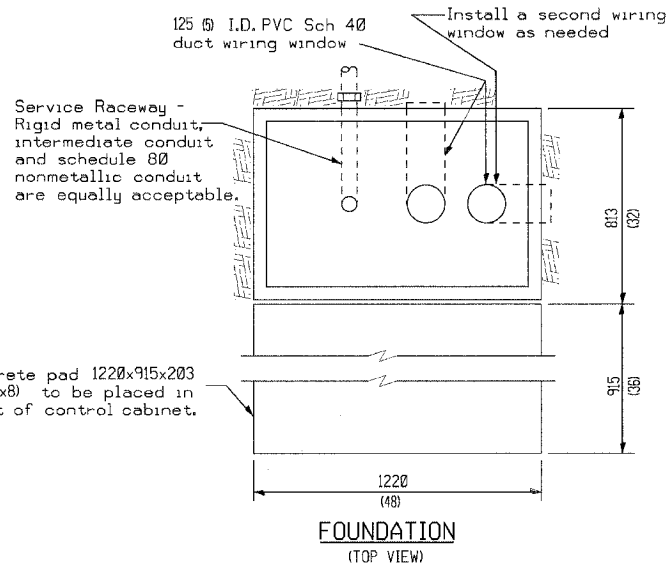

FOUNDATION (TOP VIEW)

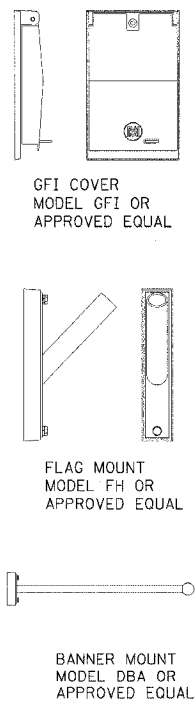


LIGHT POLE ACCESSORIES

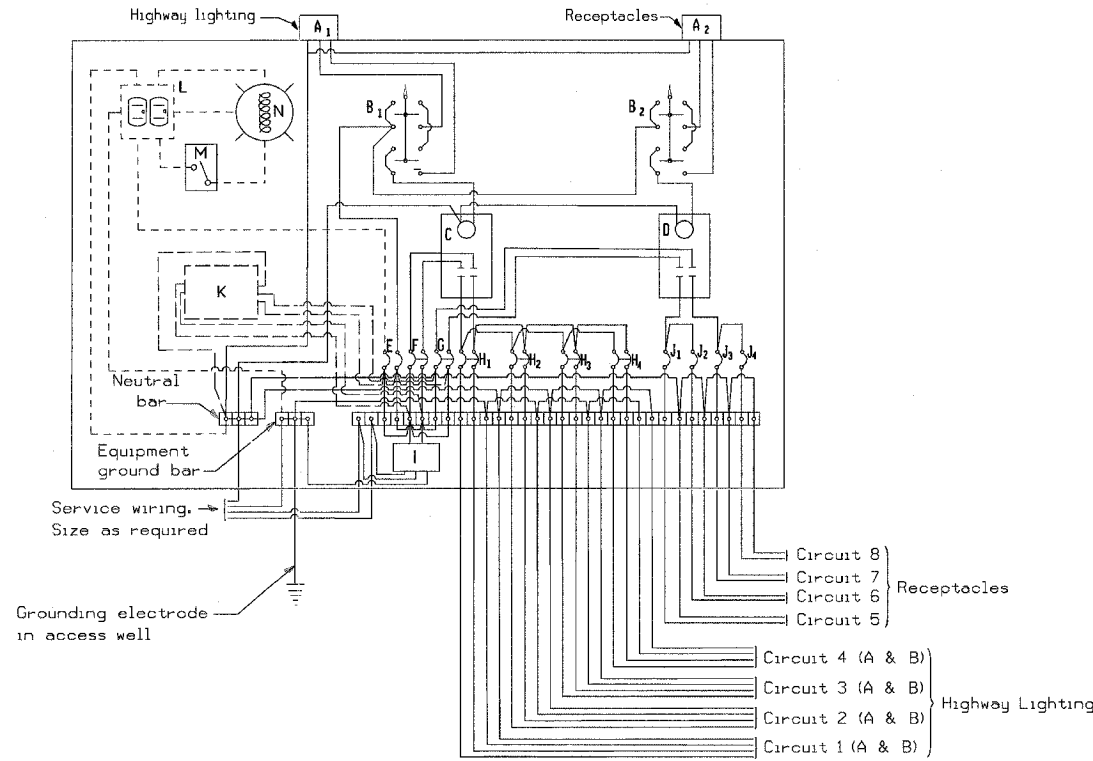

LIGHTING CONTROLLER SCHEMATIC

- A1 Photocell (remote mount in urban areas)
 - A2
 - B1 3 position selector switch
 - B2
 - C,D 150 amp* & 60 amp* electrically held contactors
 - E 15 amp, 1 pole, circuit breaker
 - F 60 amp*, 2 pole, main circuit breaker
 - G 40 amp*, 2 pole, main circuit breaker
 - H 30 amp*, 2 pole, branch circuit breaker
 - I Surge arrester
 - J 15 amp*, single pole circuit breaker
 - K Transformer (see notes), 1 KVA*, 240/480V primary, 120/240V sec, single phase
 - L GFCI duplex receptacle
 - M Single pole, single throw switch
 - N Shielded security fixture with 100W lamp
- (* = Size larger as needed)

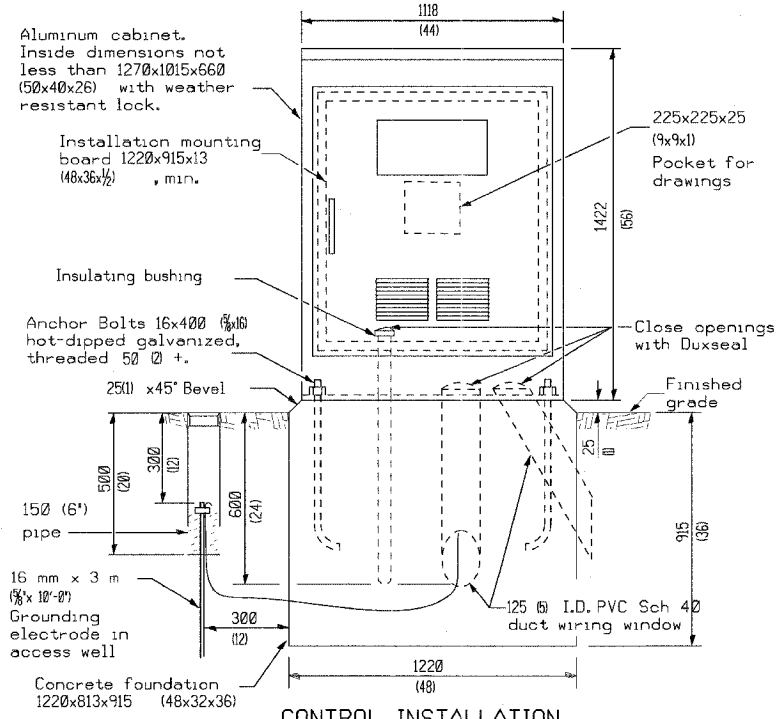

CONTROL INSTALLATION (FRONT VIEW)

GENERAL NOTES

Wiring shall be panel board fashion. All bends shall be right angles. All runs shall be vertical or parallel to panel board. Wires shall be grouped or laced.

All control installation components shall be U.L. listed.

Label equipment ground and neutral.

The underground service entrance wiring shall not exceed 46 m (150'). Total aerial and underground service between the control installation and primary transformer shall not exceed 76 m (250').

Receaways shall terminate 75 (3) above top of concrete foundation.

For 480 V service, a step down transformer (dashed lines) is required.

Two (2) spare branch breakers are required but are not shown.

All dimensions are in millimeters (inches) unless otherwise shown.

REVISIONS	
NAME	DATE
DLD	4-13-07
DLD	5-09-07

ILLINOIS DEPARTMENT OF TRANSPORTATION

LIGHTING DETAILS

SCALE: VERT. HORIZ. DATE

DRAWN BY KOJ CHECKED BY BWC

CADD FILE: 4812/DI.LightingA.dgn PLOTTED: 5/9/2007

H.M. & G. NO. 4612