F.A. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
	06-00026-01-MS	MADISON	43	34

FEDERAL AID PROJECT

KEYED NOTES

1. E.C. SHALL FURNISH AND INSTALL SINGLE RECEPTACLE SURFACE MOUNTED IN ELEVATOR PIT FOR SUMP PUMP CONTROL PANEL. PROVIDE SURFACE MOUNTED 4" PVC CONDUIT BETWEEN CONTROL PANEL AND PUMP. E.C. SHALL INSTALL CABLES WHICH ARE PROVIDED WITH THE PUMP BETWEEN CONTROL PANEL AND PUMP WITHIN 4"C.
2. EXTEND AND CONNECT TO PANEL VIA RELAY PANEL. SEE SHEET E4-01 FOR LOCATION OF RELAY PANEL.

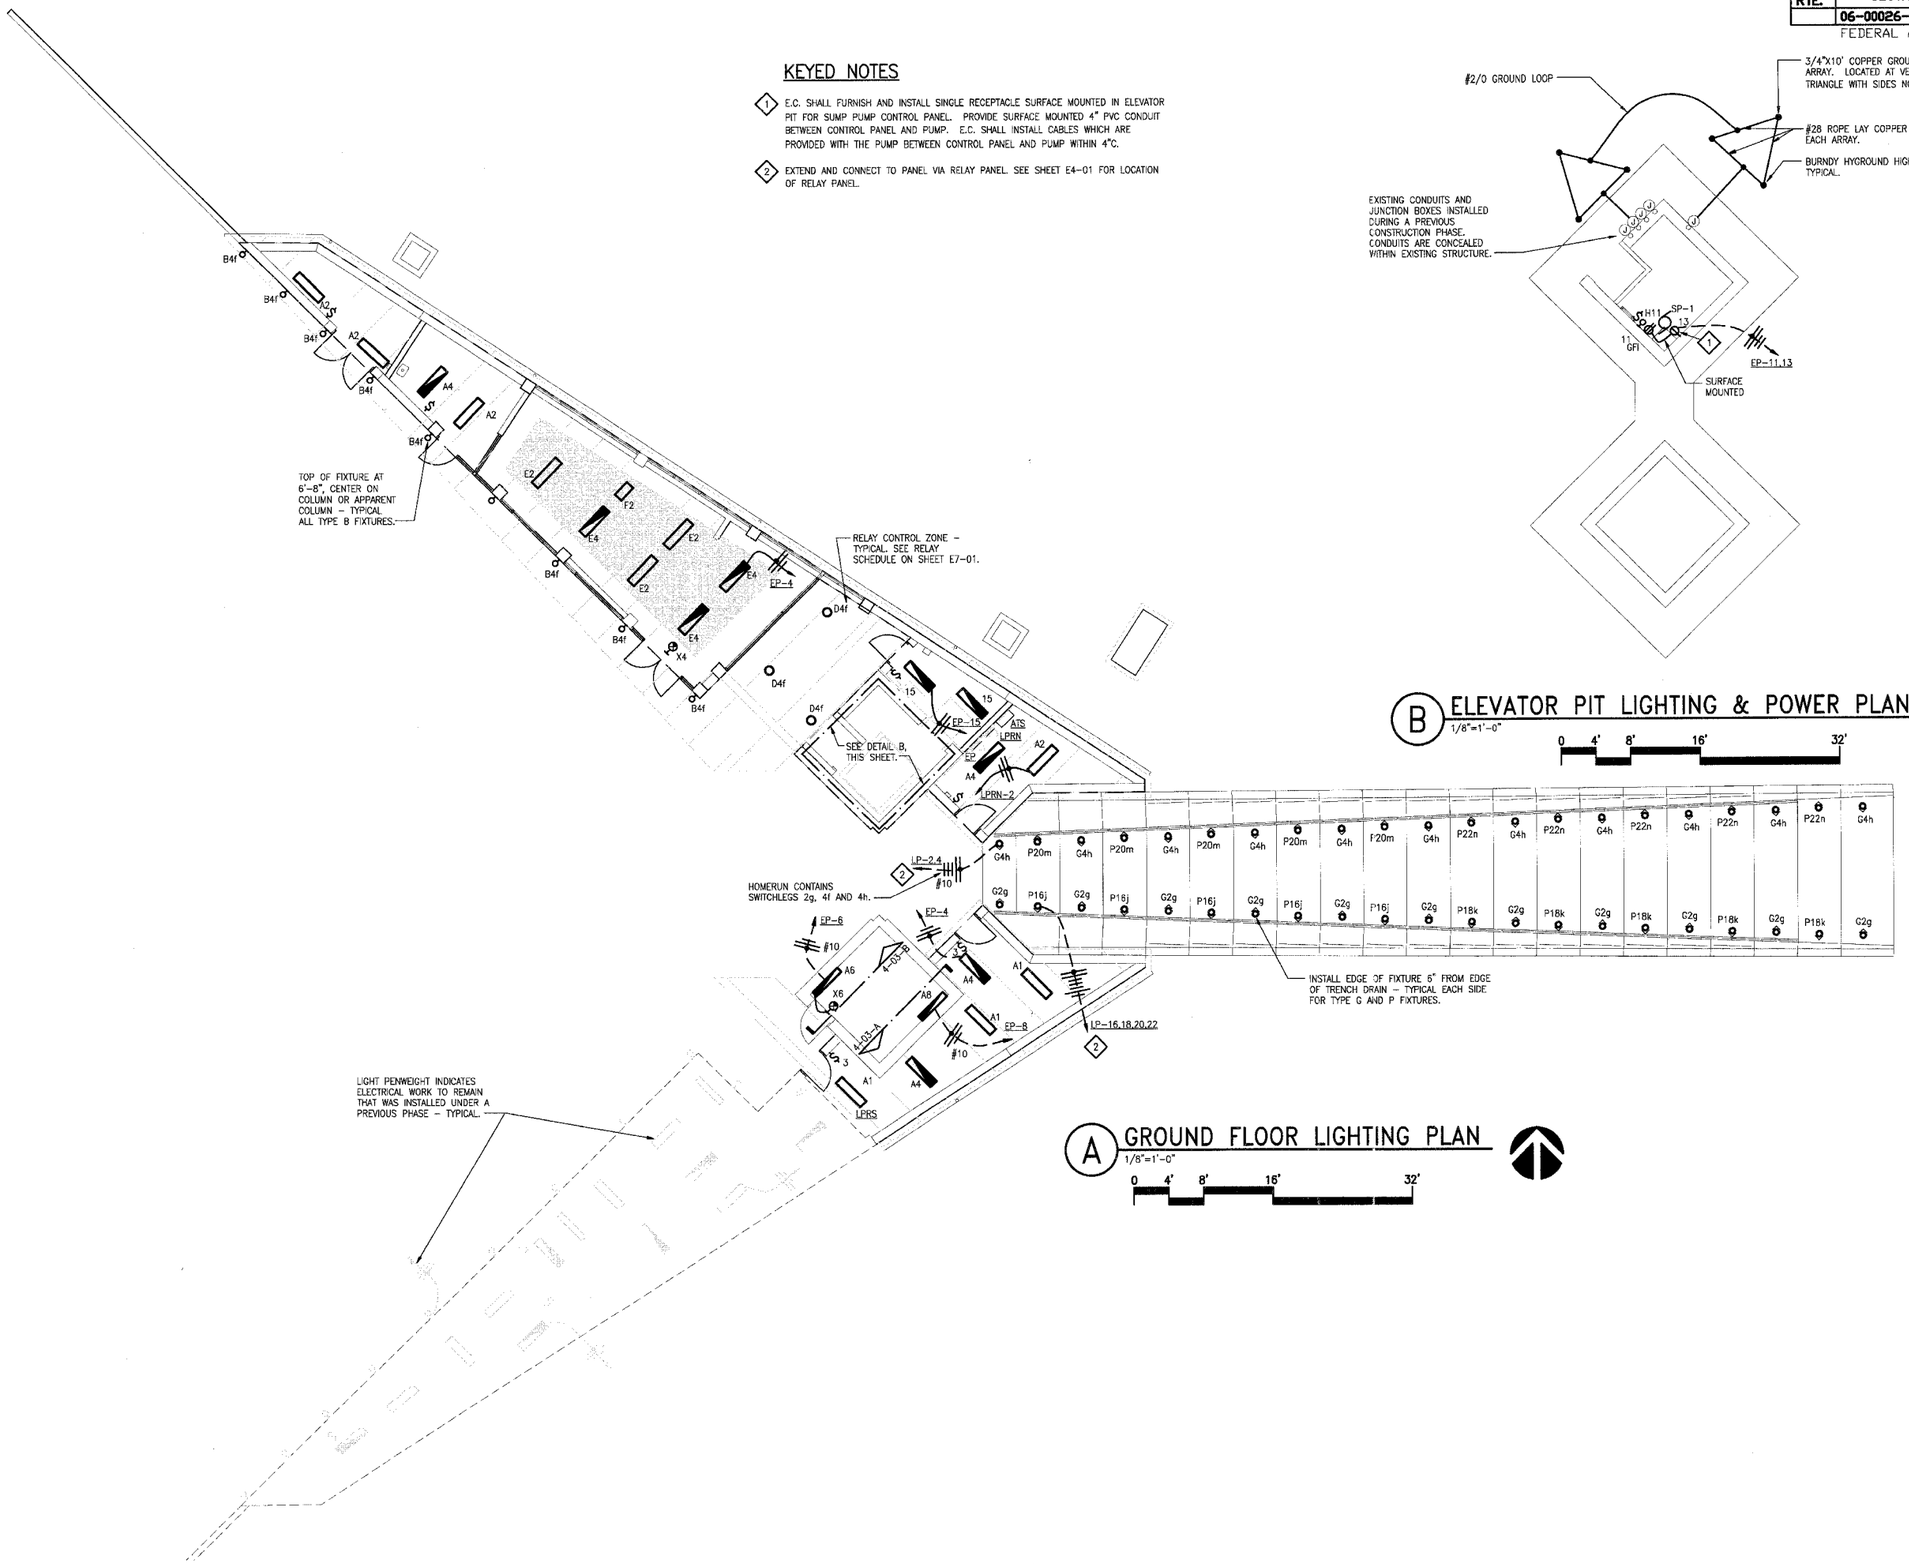

A GROUND FLOOR LIGHTING PLAN
1/8"=1'-0"
0 4' 8' 16' 32'

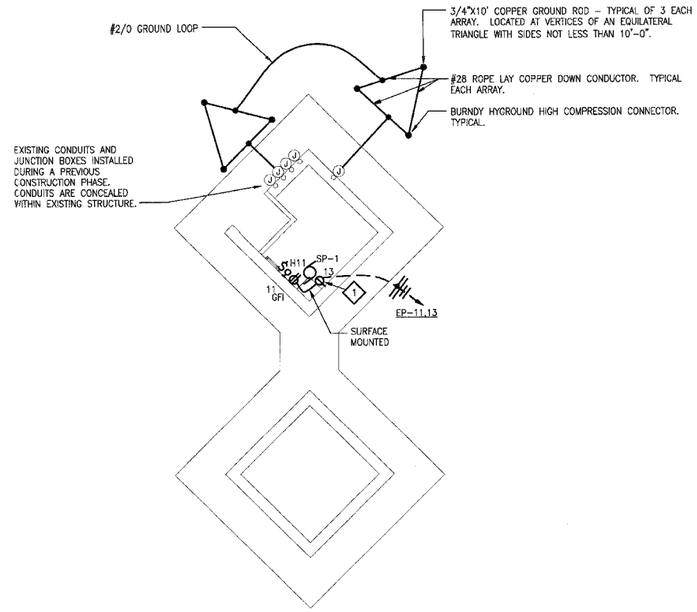

B ELEVATOR PIT LIGHTING & POWER PLAN
1/8"=1'-0"
0 4' 8' 16' 32'

KAI
211 N. Broadway
Suite 1900
St. Louis, MO
63102
(314) 241-8188
FAX (314) 241-0125

PHASE 2A
LEWIS AND CLARK MEMORIAL TOWER
VILLAGE OF HARTFORD, ILLINOIS
HARTFORD, ILLINOIS 62049

SHEET TITLE:
GROUND FLOOR LIGHTING PLAN

REV. NO.	REMARKS	DATE

KENNEDY PROJECT NO
KAI# 10-02048

ISSUE DATE
12-JULY-05

SHEET NO
EA3-01

© 2005 KENNEDY ASSOCIATES INCORPORATED

P:\2002\10-02048\60DDISC\E2A3-01.DWG | 7/2/2007 10:16:01 AM | Xref's: TB2436CDL BS-PLAN-2A E2ABS301 BS-PLANS-2+ E2ABS401 E2BBS301 | Images: none