
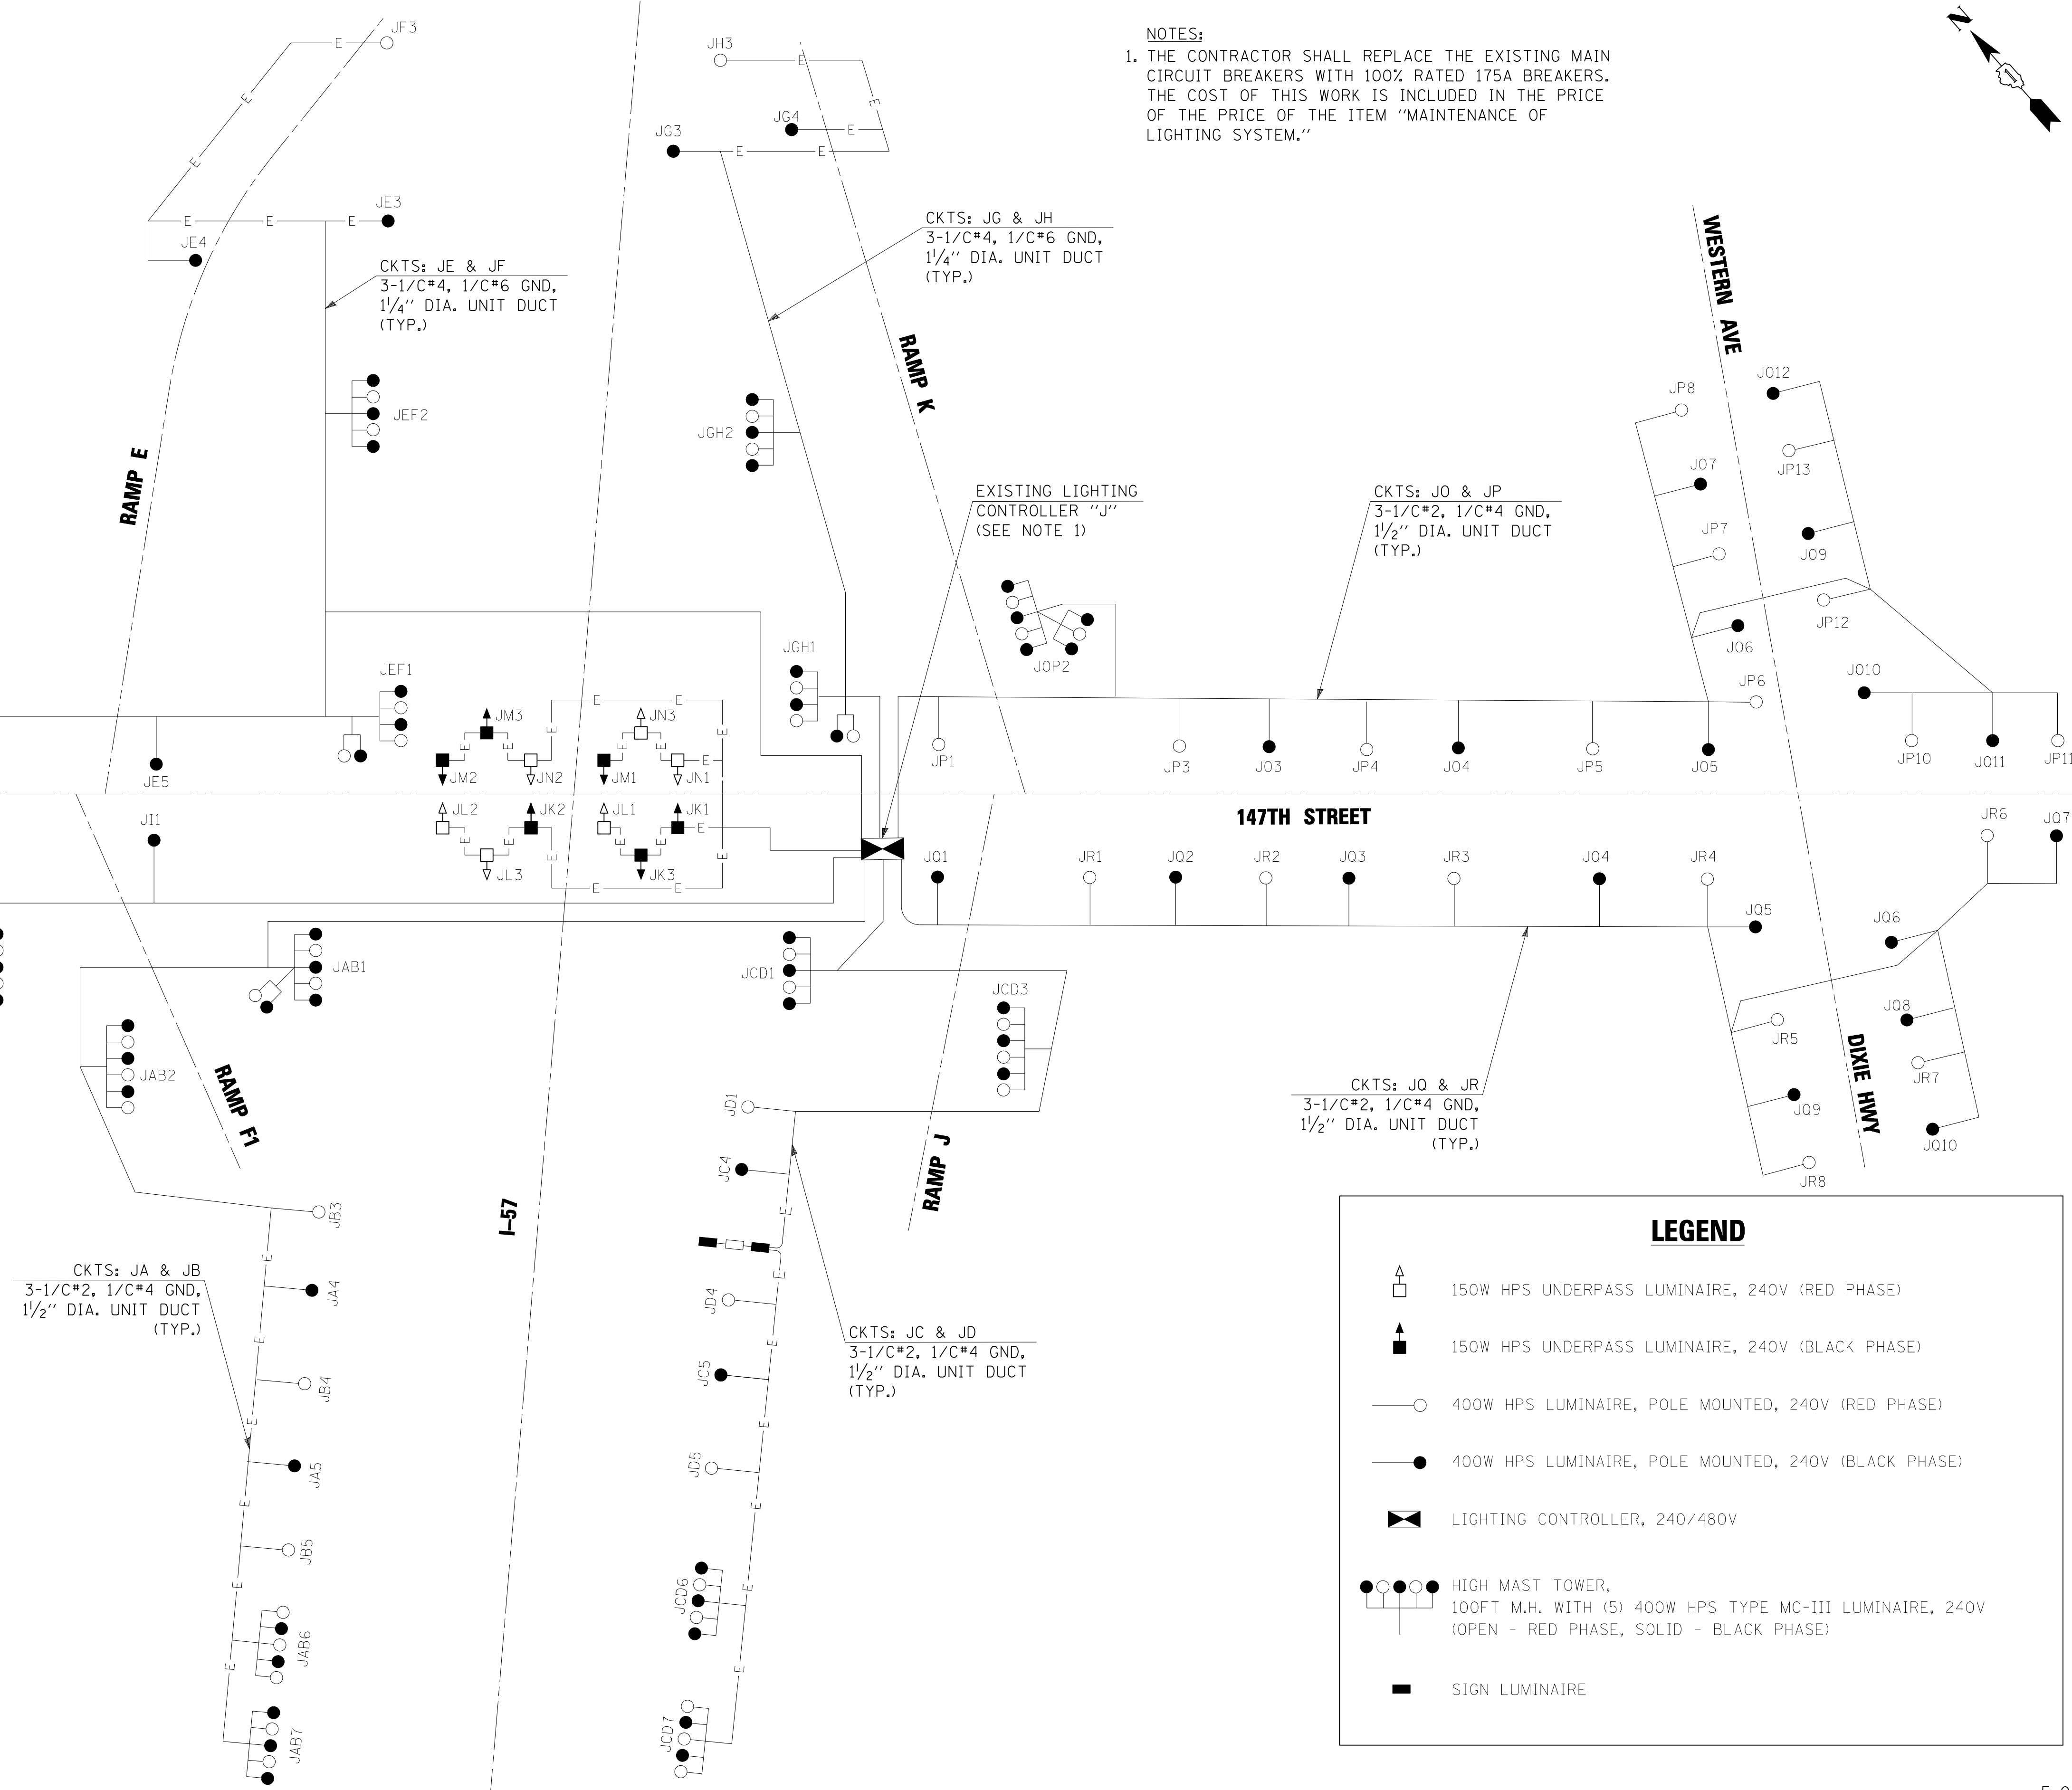
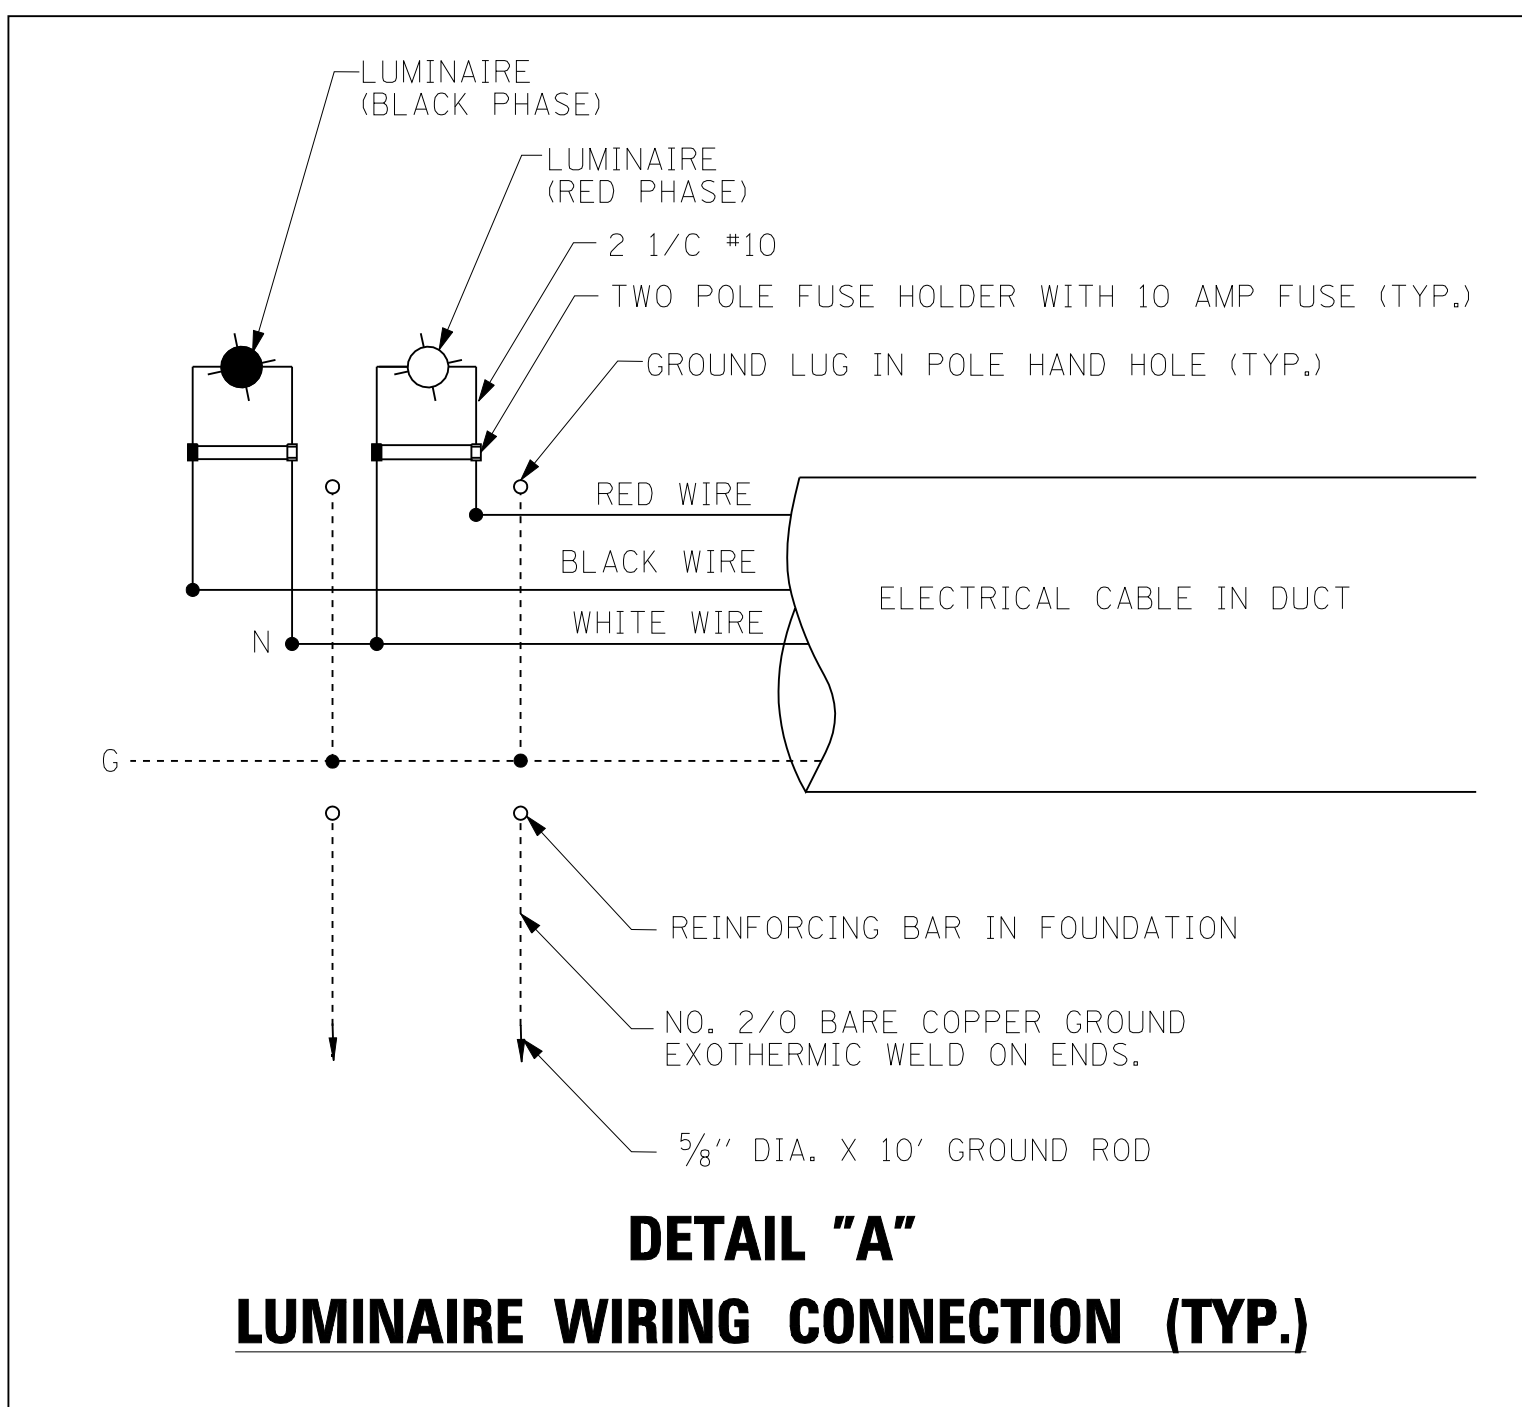


LOAD TABLE EXISTING LIGHTING CONTROLLER "J" (@ 240 VOLT)					
CIRCUIT	BLACK PHASE		CIRCUIT	RED PHASE	
	AMPS	WATTS		AMPS	WATTS
A	28	6,720	B	28	6,720
C	27.7	6,640	D	26.8	6,440
E	24	5,760	F	18	4,320
G	16	3,840	H	12	2,880
I	16	3,840	J	12	2,880
K	2.4	570	L	2.4	570
M	2.4	570	N	2.4	570
O	26	6,240	P	28	6,720
Q	20	4,800	R	16	3,840
TOTAL	162.4	38,980	TOTAL	145.6	34,940

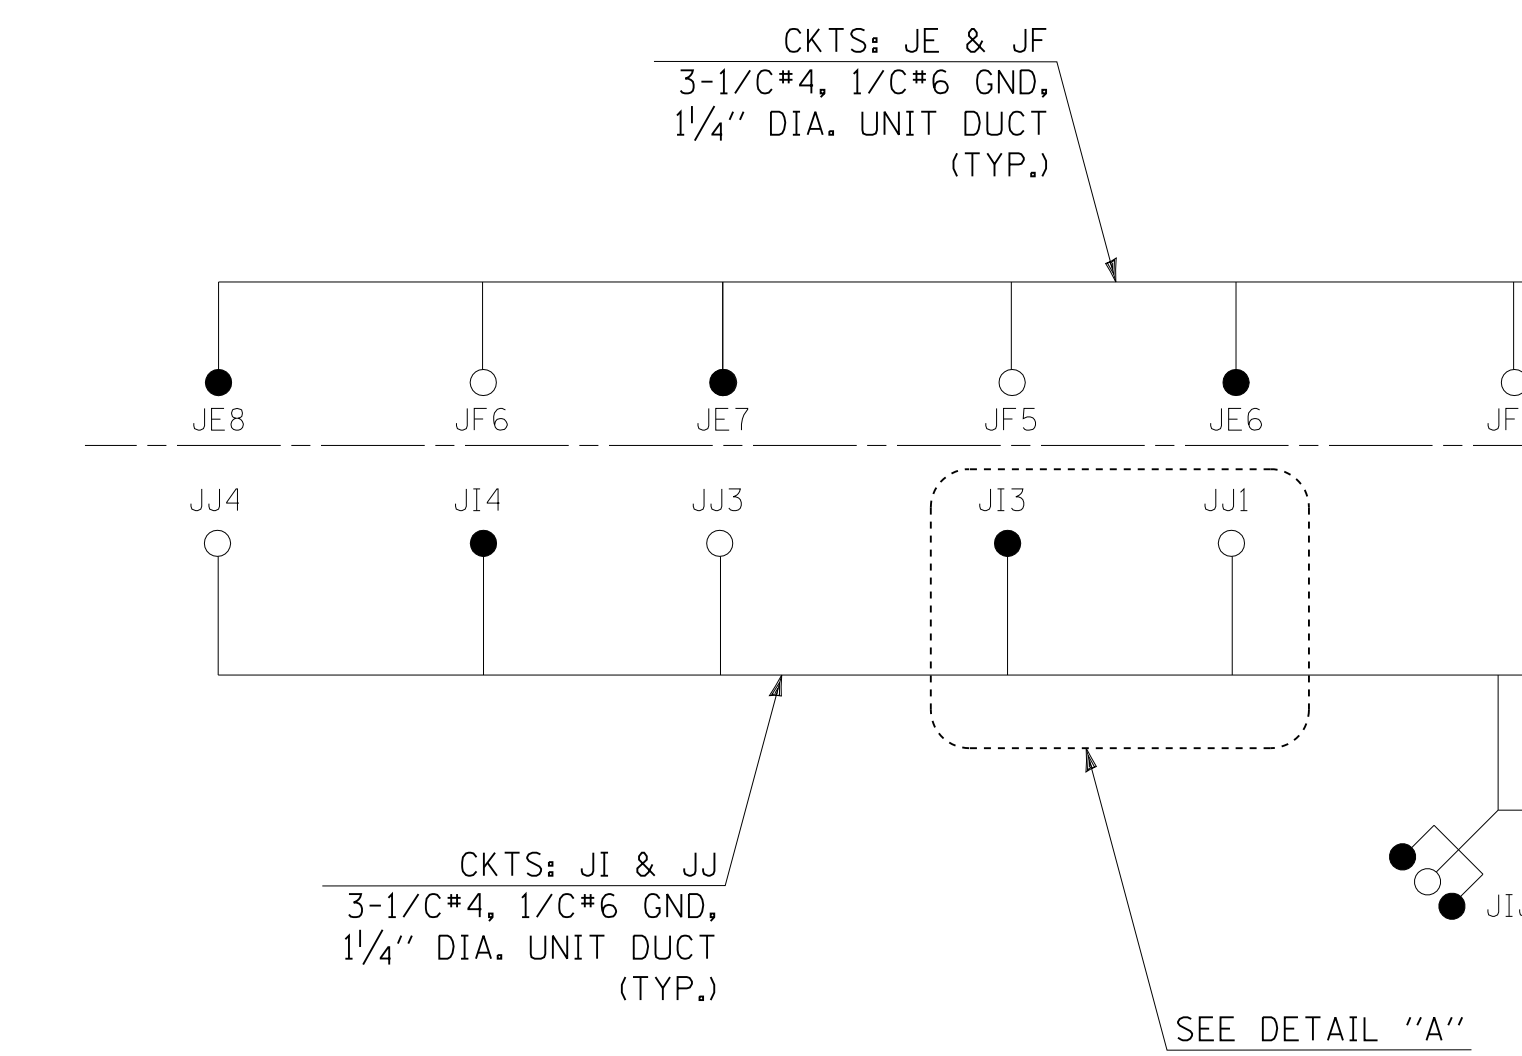

LEGEND	
	150W HPS UNDERPASS LUMINAIRE, 240V (RED PHASE)
	150W HPS UNDERPASS LUMINAIRE, 240V (BLACK PHASE)
	400W HPS LUMINAIRE, POLE MOUNTED, 240V (RED PHASE)
	400W HPS LUMINAIRE, POLE MOUNTED, 240V (BLACK PHASE)
	LIGHTING CONTROLLER, 240/480V
	HIGH MAST TOWER, 100FT M.H. WITH (5) 400W HPS TYPE MC-III LUMINAIRE, 240V (OPEN - RED PHASE, SOLID - BLACK PHASE)
	SIGN LUMINAIRE

**NOTES:**  
1. THE CONTRACTOR SHALL REPLACE THE EXISTING MAIN CIRCUIT BREAKERS WITH 100% RATED 175A BREAKERS. THE COST OF THIS WORK IS INCLUDED IN THE PRICE OF THE PRICE OF THE ITEM "MAINTENANCE OF LIGHTING SYSTEM."