
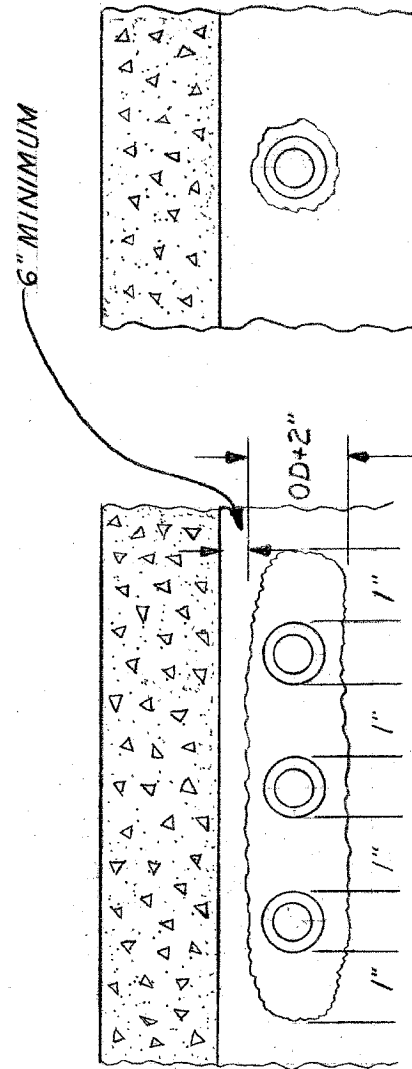


*CONDUIT INSTALLATION THROUGH EXISTING
MANHOLE OR HANDHOLE WALL*

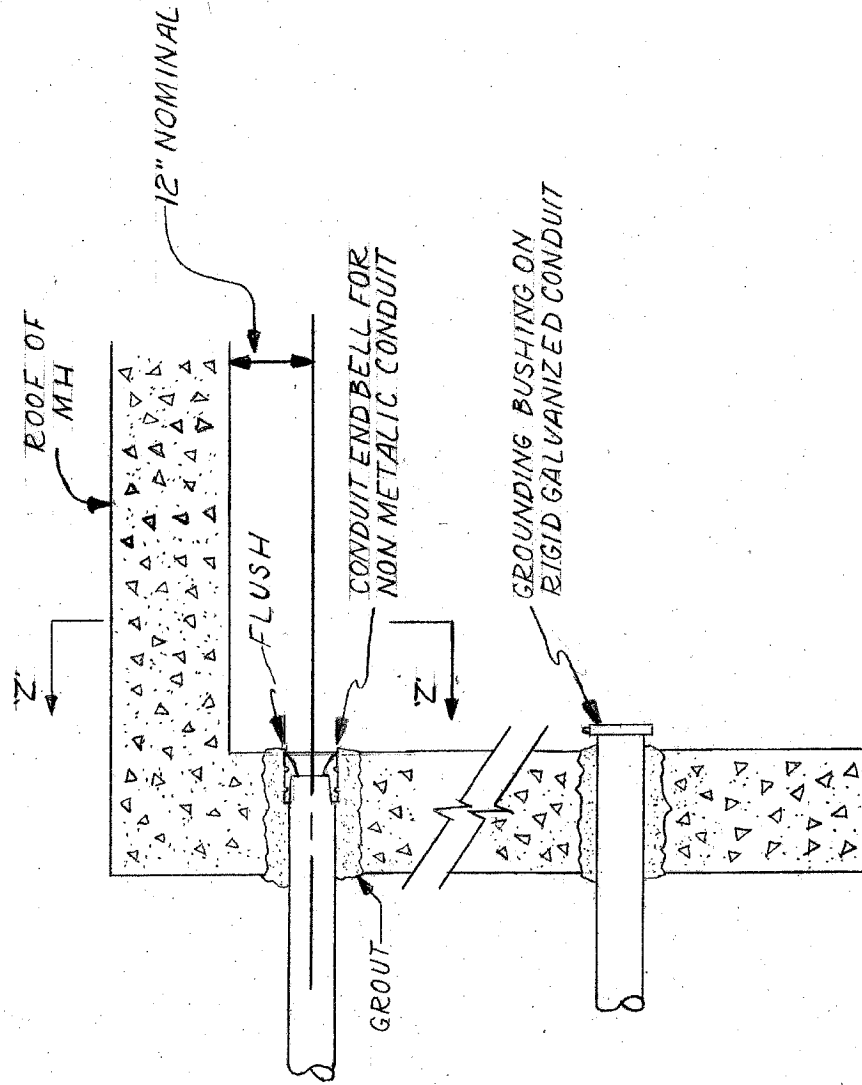

OPENING THROUGH WALL TO BE KEPT TO MINIMUM SIZE TO ADMIT CONDUIT AND SUFFICIENT GROUT TO ASSURE SEALING WALL.

INSTALLATION METHOD OF INSTALLING CONDUIT THRU MANHOLE WALL	
CITY OF CHICAGO DEPT. OF STREETS AND SANITATION BUREAU OF ELECTRICITY DIVISION OF ELECTRICAL ENGINEERING	
DRAWN A.M. JOHANSON	CHECKED R. SYC KOWSKI ENGINEER
DRG. NO. 814	
DATE 5/13/81	
SIZE 8 1/2" X 14"	SCALE N.T.S.

NO.	BY	DATE	REVISIONS	DESCRIPTION
EJM ENGINEERING, INC. 411 South Wells Street Suite 800 Chicago, Illinois 60607				
FOSTER AVE. BRIDGE OVER I-94				
STANDARD ELECTRICAL DRAWINGS				
CONSULTANT: R/JN GROUP, INC. 200 W. FRONT ST. WHEATON, IL 60187				
CITY OF CHICAGO DEPARTMENT OF TRANSPORTATION DIVISION OF ENGINEERING CITY OF CHICAGO DEPT. OF STREETS AND SANITATION BUREAU OF ELECTRICITY DIVISION OF ELECTRICAL ENGINEERING				
DRAWN JIM	CHECKED RES	APPROVED	DATE JUNE 30, 2006	SHEET NO. E-14
CONTRACT NO.				PROJECT NO. E-4-442