


240/480 VOLT, 1Ø, 3 WIRE, 60HZ SERVICE 13.52 KVA LOAD, CONTROLLER #1

NOTES:

- 1. SERVICE VOLTAGE SHALL BE AS INDICATED ELSEWHERE IN THE DRAWINGS.
- 2. UNLESS OTHERWISE INDICATED, ITEMS AND WORK SHALL BE INCLUDED AND PAID AS PART OF ELECTRIC UTILITY SERVICE INSTALLATION.
- CONDUIT AND CONNECTOR DIAMETER SHALL MATCH THE DIAMETER OF THE SERVICE
 CONDUICTOR RACEWAY AS INDICATED.
- PVC COATED RACEWAYS AND ACCESSORIES SHALL BE CAREFULLY INSTALLED WITH ME RECOMMENDED TOOLS AND PROCEDURES TO AVOID DAMAGE. ANY DAMAGE SHALL BE REPAIRED WITH COMPATIBLE PVC TOUCH-UP MATERIAL TO THE SATISFACTION OF THE ENGINEER OR THE DAMAGED MATERIAL SHALL BE REPLACED AT NO ADDITIONAL COST.
- 5. THE CONTRACTOR SHALL DBTAIN INSPECTION AND APPROVAL BY THE PISINEER OF SERVICE BISER BROUND ELECTRODE. RISER ELBOW, MIPPE AND CONNECTION TO SERVICE CONDUCTOR RACEWAY EXTENSION BEFORE BACKFILL AND SHALL ALSO OBTAIN INSPECTION OF SERVICE RISER AND SEALING BUSHING BEFORE UTILITY 'U' GUARD INSTALLATION AND SERVICE CONNECTION.
- THE SERVICE METER SOCKET, AS APPLICABLE, MOUNTED ELSEWHERE AS INCLUDED SHALL BE INCLUDED AND PAID AS PART OF THE ELECTRICAL UTILITY SERVICE INSTALLATION PAY ITEM.
- 7. THE SERVICE CONDUCTOR RACEWAY SHALL BE AS INDICATED AND SHALL BE MEASURED SEPARATELY FOR PAYMENT. WHEN THE PACEWAY IS PVC-COATED RIGID GALVANAZED STEEL, THE COUPLING SHALL BE THE SAME. WHEN THE RACEWAY IS PVC CONDUIT (IN CONDETE), THE COUPLING SHALL BE A METALLOT ON DOM-METALLO ADAPTER. WHEN THE RACEWAY IS ENCASED IN CONCRETE, THE CONCRETE SHALL EXTEND TO COVER THE COUPLING.
- PLANS AND DETAILS INDICATE THE GENERAL NATURE AND REQUIREMENTS. THEY DO NOT SHOW EVERY ACCESSORY AND ATTACHMENT, AND THEY DO NOT RELIEVE THE CONTRACTOR OF THE REQUIREMENTS OF THE SPECIFICATIONS AND SPECIAL PROVISION TO ASCERTAIN UTILITY REQUIREMENTS AND TO COORDINATE ACCORDINGLY, FURNISHING ALL ITEMS AND WORK NOT PROVIDED BY THE UTILITY, BUT NECESSARY FOR A COMPLETE SERVICE INSTALLATION.

SERVICE CONNECTION FOR CONTROLLER NO.1

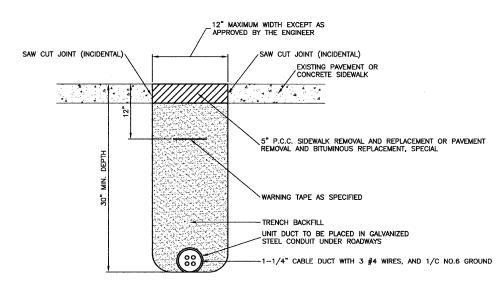

HOT-MIX ASPHALT PAVEMENT OR CONCRETE SIDEWALK REMOVAL AND REPLACEMENT

12" MAXIMUM WIDTH EXCEPT AS
APPROVED BY THE ENGINEER

4" TOPSOIL WITH SEED OR SODDING

WARNING TAPE AS SPECIFIED

COMPACTED BACKFILL

COMPACTED BACKFILL

1-4" CABLE DUCT WITH 3 #4 WIRES, AND 1/C NO.6 GROUND

TRENCH DETAIL



FILE NA	ME = 08295_02-DTLS-01 - P04	USER NAME =	DESIGNED PAP	REVISED —		115TH STREET		F.A.U.	SECTION	COUNTY	TOTAL SHEET	
į.			CHECKED — EJT	REVISED	STATE OF ILLINOIS		RIDGELAND AVENUE TO CENTRAL AVENUE		08-00086-00-LT	COOK	11 9	
		PLOT SCALE = N/A	DRAWN — MJD	REVISED	DEPARTMENT OF TRANSPORTATION	STREET LIGHTING DETAILS			CONTRACT N		NO. 63270	
		PLOT DATE = 08-10-09	CHECKED — DWS	REVISED —		SCALE: N/A	SHEET NO. 9 OF 11 SHEETS STA. TO STA.	FED. ROAD D	FED. ROAD DIST. NO. 1 ILLINOIS FED. AID PROJECT M-9003 (087)			