



Illinois Department of Transportation

2300 South Dirksen Parkway / Springfield, Illinois / 62764

October 29, 2018

SUBJECT: Route FAU 1504 (55th Street)
Section 11-00302-04-CH
DuPage County
Contract No. 61E06
Item 078
November 9, 2018 Letting
Addendum B

NOTICE TO PROSPECTIVE BIDDERS:

Attached is an addendum to the plans or proposal. This addendum involves revised and/or added material.

1. Revised pages 37 and 42 and added page 37A to the Special Provisions.

Prime contractors must utilize the enclosed material when preparing their bid and must include any changes to the Schedule of Prices in their bid.

Very truly yours,

Jack A. Elston, P.E.
Bureau Chief
Engineer of Design and Environment

A handwritten signature in cursive script, reading "Ted B. Walschleger P.E.".

By: Ted B. Walschleger, P.E.
Engineer of Project Management

Concrete anchors shall be stainless steel type 303 or 304 wedge anchors and shall be furnished by the handrail manufacturer. The anchor design shall include the appropriate reduction factors for spacing and edge distances in accordance with the manufacturers published data.

Coating. Color shall be black. Posts, rails, caps, base plates and all components shall be cleaned and powder coated (electrostatically applied), in accordance with Article 1006.29(b)(5) of the Standard Specifications except as follows:


The powder coating color shall be approved by the Engineer prior to application.

Testing and certification shall be in accordance with Articles 1006.29(c)(3) and 1006.29(c)(4) of the Standard Specifications.

The Contractor shall provide a manufacturer's warranty against peeling or flaking of the powder coating from all rail components for two (2) years following final acceptance of the project. This manufacturer's warranty will cover corrosion and any imperfections due to normal wear and weathering conditions.


Height. Top of gripping surfaces of handrails shall be 34 inches minimum and 38 inches maximum vertically above stair nosings.

Handrail Height

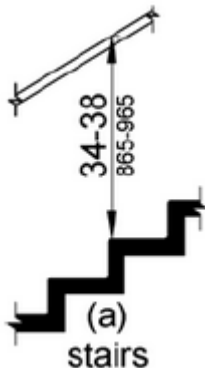

Clearance between handrail gripping surfaces and adjacent surfaces shall be 1½ (38 mm) minimum.

Handrail Clearance



Gripping Surface. Handrail gripping surfaces shall be continuous along their length and shall not be obstructed along their tops or sides. The bottoms of handrail gripping surfaces shall not be obstructed for more than 20 percent of their length. Where provided, horizontal projections shall occur 1½ (38 mm) minimum below the bottom of the handrail gripping surface.

37A

Added 10-29-18

A, 6'-DIAMETER, WITH 2 TYPE 1 FRAME, CLOSED LID, RESTRICTOR PLATE shall not include the cost of furnishing and installing the specified frames and grates or lids. The cost of furnishing and installing frames and grates or lids shall be paid for at the contract unit price each in accordance into Section 604 of the Standard Specifications.

MANHOLES, TYPE A, 8'-DIAMETER

Description: This work shall consist of constructing a manhole, type A, 8'-diameter at locations shown on the plans or as directed by the Engineer.

General: The 8'-diameter manhole shall be constructed in accordance with the applicable sections of Section 602 of the Standard Specifications and Highway Standard 602416-06.

Method of Measurement: This work will be measured per EACH unit installed.

Basis of Payment: This work will be paid for at the contract unit price of MANHOLES, TYPE A, 8'-DIAMETER which price shall include sand cushion and all excavation and backfilling. The contract unit price each for MANHOLES, TYPE A, 8'-DIAMETER shall not include the cost of furnishing and installing the specified frames and grates or lids. The cost of furnishing and installing frames and grates or lids shall be paid for at the contract unit price each in accordance into Section 604 of the Standard Specifications.

PEDESTRIAN RAIL (SPECIAL)

Description: This work shall consist of furnishing and erecting a pedestrian railing as shown in the plans, in accordance with the details.

General: Materials shall be in accordance with the requirements shown on the Plans and as listed below:

Coating. Color shall be black. Posts, rails, caps, base plates and all components shall be cleaned and powder coated (electrostatically applied), in accordance with Article 1006.29(b)(5) of the Standard Specifications except as follows:

The powder coating color shall be approved by the Engineer prior to application.

Testing and certification shall be in accordance with Articles 1006.29(c)(3) and 1006.29(c)(4) of the Standard Specifications.

The Contractor shall provide a manufacturer's warranty against peeling or flaking of the powder coating from all rail components for two (2) years following final acceptance of the project. This manufacturer's warranty will cover corrosion and any imperfections due to normal wear and weathering conditions.