
* Section 03-00160-00-PV

Contract #85503



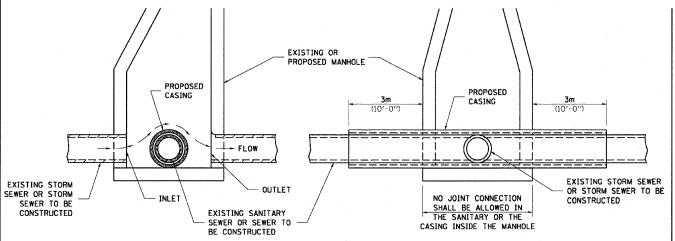

ELEVATION - ECCENTRIC


AT GRADE CROSSING OF

SANITARY AND STORM SEWER

ALL DIMENSIONS ARE IN MILLIMETERS
(INCHES) UNLESS OTHERWISE NOTED

THIS DETAIL IS FOR UNKNOWN UTILITIES UNLESS QUANTITIES ARE INCLUDED IN THE PLANS THE EXTRA WORK WILL BE PAID FOR IN ACCORDANCE WITH ARTICLE 109.04.

WHEN PROPOSED SEWER (OR WATER) IS LOCATED 3.1 m (10'-0") OR MORE FROM EXISTING WATER (OR SEWER) NO SPECIAL CONSTRUCTION REQUIRED. WHEN PROPOSED SEWER (OR WATER) IS LOCATED LESS THAN 3.1 m (10'-0'') FROM EXISTING WATER (OR SEWER) DETAILS BELOW SHALL APPLY.

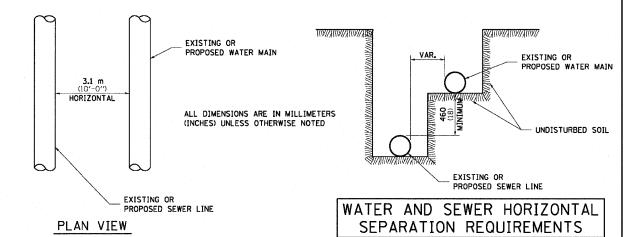


DIAMETER 50 (2) LARGER IN DIAMETER THAN ENCASED PIPE OUTSIDE DIAMETER WITH BOTH ENDS OF CASING SEALED


POINT LOADS SHALL NOT BE ALLOWED BETWEEN SEWER OR

CASING SHALL BE CAST IRON WITH AN INSIDE

PROVIDE ADEQUATE SUPPORT FOR EXISTING WATER MAIN TO PREVENT DAMAGE DUE TO SETTLEMENT OF SEWER TRENCH

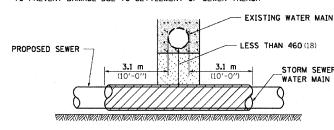

PROVIDE ADEQUATE SUPPORT FOR EXISTING WATER MAIN TO PREVENT DAMAGE DUE TO SETTLEMENT OF SEWER TRENCH MAINTAIN 460 (18) MINIMUM VERTICAL SEPARATION

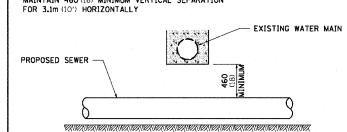


PLOT DATE = August 23 2007

ALL DIMENSIONS ARE IN MILLIMETERS (INCHES) PROPOSED SEWER LINE BELOW EXISTING WATER MAIN PROVIDE ADEQUATE SUPPORT FOR EXISTING SEWER LINE TO PREVENT DAMAGE DUE TO SETTLEMENT


PLACE TRENCH BACKFILL FOR 3.1 m (10') ON EITHER SIDE OF SEWER LINE

ELEVATION - CONCENTRIC

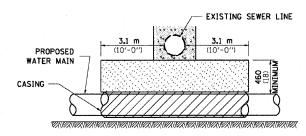

CASING SHALL BE CAST IRON WITH AN INSIDE DIAMETER 50 (2) LARGER IN DIAMETER THAN ENCASED PIPE OUTSIDE DIAMETER WITH BOTH ENDS OF CASING SEALED

PROVIDE ADEQUATE SUPPORT FOR EXISTING WATER MAIN TO PREVENT DAMAGE DUE TO SETTLEMENT OF SEWER TRENCH MAINTAIN 460 (18) MINIMUM VERTICAL SEPARATION FOR 3.1 m (10°) HORIZONTALLY




NOT ALLOWED
 MUST MAINTAIN 460 (18) VERTICAL SEPARATION

ALL DIMENSIONS ARE IN MILLIMETERS (INCHES) UNLESS OTHERWISE NOTE

REVISED

PROPOSED WATER MAIN BELOW EXISTING SEWER LINE

POINT LOADS SHALL NOT BE ALLOWED BETWEEN WATER MAIN OR WATER MAIN CASING AND SEWER

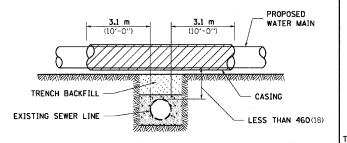

CASING SHALL BE CAST IRON WITH AN INSIDE DIAMETER 50 (2) LARGER IN DIAMETER THAN ENCASED PIPE OUTSIDE DIAMETER WITH BOTH ENDS OF CASING SEALED

ALL DIMENSIONS ARE IN MILLIMETERS (INCHES) UNLESS OTHERWISE NOTED

SCALE:

PROPOSED WATER MAIN ABOVE EXISTING SEWER LINE

SHEET NO. OF SHEETS STA.

WATER
MAIN
(10'-0")
TRENCH
WIDTH

TRENCH
WIDTH

SEWER

STORM SEWER
WATER MAIN
MINIMUM 460 (18)

PROVIDE ADEQUATE SUPPORT FOR SEWER TO

PREVENT SETTLING AND BREAKING THE WATER MAIN.

ALL DIMENSIONS ARE IN MILLIMETERS (INCHES) UNLESS OTHERWISE NOTED

EXISTING WATER MAIN BELOW PROPOSED SEWER LINE WITH MINIMUM 460 (18) VERTICAL SEPARATION

SECTION

UNLESS OTHERWISE NOTED BELOW EXISTING WATER MAIN UNLESS OTHERWISE NOTED BELOW EXISTING SEWER LINE

FILE NAME = DISTRICT 2 DESIGNED - REVISED - 10-15-04

DISTRICT 2 Standard PLOT SCALE = 1.00000 1/ IN. CHECKED - REVISED - DEPARTMENT OF TRANSPORTATION

REGION 2 / DISTRICT 2 STANDARD

DEPARTMENT OF TRANSPORTATION

SEWER AND WATER MAIN CROSSINGS

32.1

EXISTING WATER MAIN

COUNTY TOTAL SHEE SHEETS NO.

CONTRACT NO.