








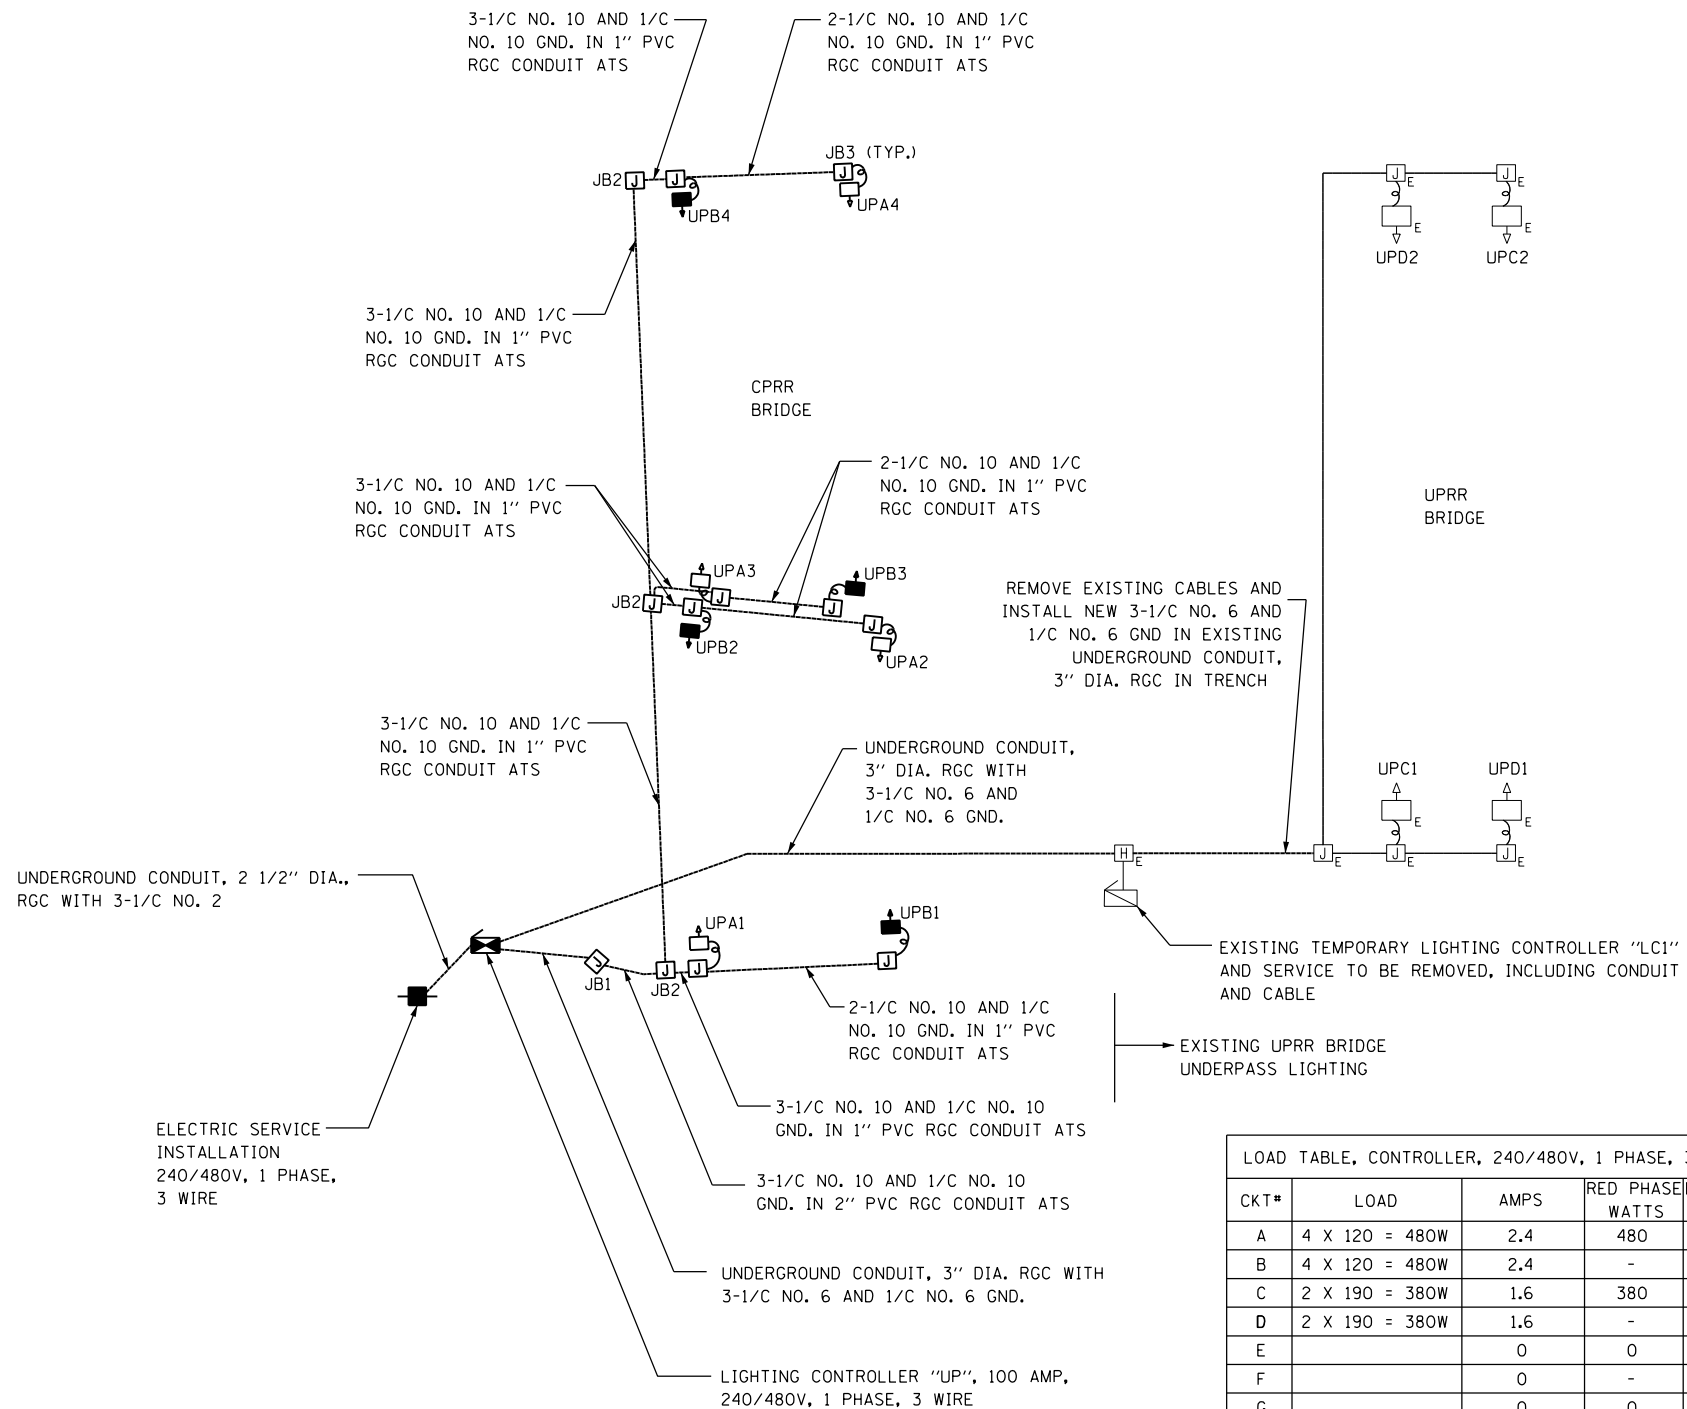
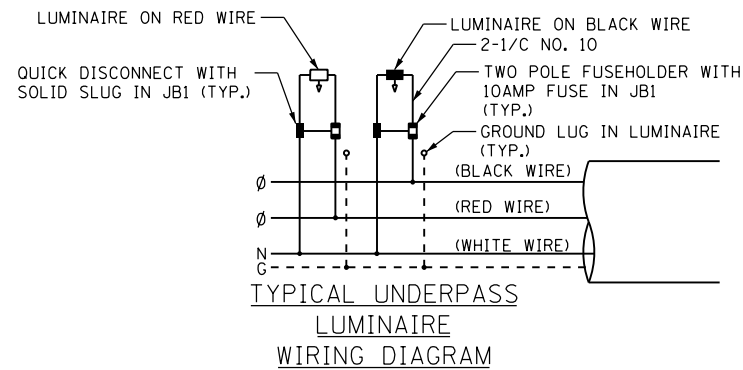


**ELECTRICAL SYMBOLS**

-  100W HPS, UNDERPASS LUMINAIRE ON BLACK WIRE
-  100W HPS, UNDERPASS LUMINAIRE ON RED WIRE
-  JUNCTION BOX AS NOTED ON PLANS
-  PROPOSED LIGHTING CONTROL CABINET
-  PROPOSED ELECTRIC SERVICE POLE
-  EXISTING 150W HPS, UNDERPASS LUMINAIRE
-  EXISTING JUNCTION BOX
-  EXISTING HANDHOLE
-  EXISTING TEMPORARY LIGHTING CONTROLLER



LOAD TABLE, CONTROLLER, 240/480V, 1 PHASE, 3 WIRE

CKT#	LOAD	AMPS	RED PHASE WATTS	BLACK PHASE WATTS
A	4 X 120 = 480W	2.4	480	-
B	4 X 120 = 480W	2.4	-	480
C	2 X 190 = 380W	1.6	380	-
D	2 X 190 = 380W	1.6	-	380
E		0	0	-
F		0	-	0
G		0	0	-
H		0	-	0
TOTAL	1,720W	8.0	860	860