



HANSON PROFESSIONAL SERVICES INC.

815 Commerce Drive, Suite 200
Oak Brook, Illinois 60523
Telephone: 630.990.3800
Fax: 630.990.3801



WAUKEGAN REGIONAL AIRPORT
WAUKEGAN PORT DISTRICT

3580 North McAre Road
Waukegan, Illinois 60087
Telephone: 847.244.0066
Fax: 847.244.3813


AIRFIELD SIGNAGE IMPROVEMENTS

AIP PROJECT NO. 3-17-0105-B35
IDA PROJECT NO. UGN-3650

VAULT LEGEND PLATE SCHEDULE	
DEVICE	LABEL
SERVICE DISCONNECT (BLACK LETTERING, WHITE BACKGROUND)	SERVICE DISCONNECT 240/120 VAC, 3PH, 4W
SERVICE DISCONNECT (BLACK LETTERING, WHITE BACKGROUND)	NOTE GENERATOR NEUTRAL IS ALSO BONDED TO GROUND AT THE SERVICE DISCONNECT
MAIN DIST. PANEL	MAIN DISTRIBUTION PANEL 240/120 VAC, 3PH, 4W
CIRCUIT BREAKER FOR RWY 5-23 CCR	CCR #1 RUNWAY 5-23
RUNWAY 5-23 CCR	CCR #1 RUNWAY 5-23
CUTOUT ENCLOSURE FOR RUNWAY 5-23 CCR	CCR #1 RUNWAY 5-23
CIRCUIT BREAKER FOR RWY 14-32 CCR	CCR #2 RUNWAY 14-32
RUNWAY 14-32 CCR	CCR #2 RUNWAY 14-32
CUTOUT ENCLOSURE FOR RUNWAY 14-32 CCR	CCR #2 RUNWAY 14-32
CIRCUIT BREAKER FOR TAXIWAY A NORTHEAST CCR	CCR #3 TAXIWAY A NORTHEAST
TAXIWAY A NORTHEAST CCR	CCR #3 TAXIWAY A NORTHEAST
CUTOUT ENCLOSURE FOR TAXIWAY A NORTHEAST CCR	CCR #3 TAXIWAY A NORTHEAST
CIRCUIT BREAKER FOR TAXIWAY A SOUTHWEST CCR	CCR #4 TAXIWAY A SOUTHWEST
TAXIWAY A SOUTHWEST CCR	CCR #4 TAXIWAY A SOUTHWEST
CUTOUT ENCLOSURE FOR TAXIWAY A SOUTHWEST CCR	CCR #4 TAXIWAY A SOUTHWEST
CIRCUIT BREAKER FOR TAXIWAY B CCR	CCR #6 TAXIWAY B
TAXIWAY B CCR	CCR #6 TAXIWAY B
CUTOUT ENCLOSURE FOR TAXIWAY B CCR	CCR #6 TAXIWAY B
CIRCUIT BREAKER FOR TAXIWAY C CCR	CCR #5 TAXIWAY C
TAXIWAY C CCR	CCR #5 TAXIWAY C
CUTOUT ENCLOSURE FOR TAXIWAY C CCR	CCR #5 TAXIWAY C
CIRCUIT BREAKER FOR TAXIWAY D CCR	CCR #7 TAXIWAY D
TAXIWAY D CCR	CCR #7 TAXIWAY D
CUTOUT ENCLOSURE FOR TAXIWAY D CCR	CCR #7 TAXIWAY D
CIRCUIT BREAKER FOR TAXI GUIDANCE SIGNS CCR	CCR #8 TAXIWAY GUIDANCE SIGNS
TAXI GUIDANCE SIGNS CCR	CCR #8 TAXIWAY GUIDANCE SIGNS
CUTOUT ENCLOSURE FOR TAXI GUIDANCE SIGNS CCR	CCR #8 TAXIWAY GUIDANCE SIGNS

VAULT LEGEND PLATE SCHEDULE CONTINUED	
DEVICE	LABEL
EACH CCR LOAD DISCONNECT CUTOUT INPUT SIDE (TYP. FOR 8)	INPUT
EACH CCR LOAD DISCONNECT CUTOUT (TYP. FOR 8)	LOAD DISCONNECT
EACH INTENTIONAL GROUND SWITCH CUTOUT (TYP. FOR 8)	INTENTIONAL GROUND SWITCH
EACH CUTOUT ENCLOSURE (TYP. FOR 8)	CAUTION OPERATE CUTOUTS WITH CCR SHUT OFF
EACH GROUND FAULT INDICATOR LIGHT (TYP. FOR 8)	GROUND FAULT
HIGH VOLTAGE WIREWAY (TYP. FOR 4)	HIGH VOLTAGE
LOW VOLTAGE WIREWAY (TYP. FOR 4)	LOW VOLTAGE
TRANSFER PANEL #1/ AIRPORT LIGHTING CONTROL PANEL	TRANSFER PANEL #1
TRANSFER PANEL #2	TRANSFER PANEL #2

LEGEND PLATES SHALL BE WEATHERPROOF ENGRAVED PLASTIC OR PHENOLIC MATERIAL, 1/4" HIGH WHITE LETTERS ON A RED BACKGROUND UNLESS NOTED OTHERWISE. SECURE WITH WEATHERPROOF ADHESIVE AND MACHINE SCREWS, FURNISH ADDITIONAL LEGEND PLATES WHERE REQUIRED BY CODE, FOR ADDITIONAL EQUIPMENT AS DETAILED HEREIN ON THE PLANS, AND AS NOTED IN THE SPECIAL PROVISION SPECIFICATIONS.

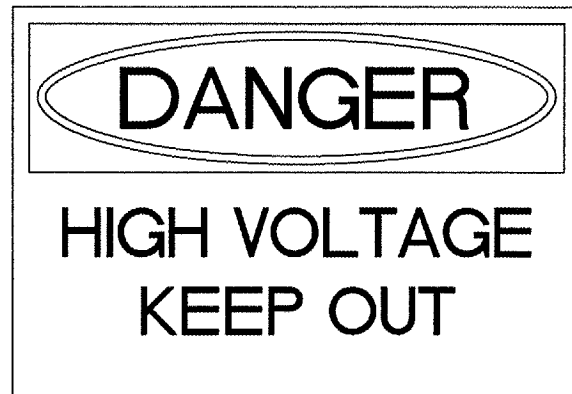

PROVIDE WARNING SIGN ON VAULT EXTERIOR DOORS LABELED "DANGER - HIGH VOLTAGE - KEEP OUT" PER THE REQUIREMENTS OF NEC 110.34 (C).

- DIRECTIONS TO TEST FOR AIRFIELD GROUND FAULTS IN LIGHTING CIRCUITS.
- TURN OFF RESPECTIVE CCR.
 - PULL INTENTIONAL GROUND SWITCH CUTOUT.
 - TURN ON RESPECTIVE CCR.
 - IF GROUND FAULT LIGHT IS DIM CHECK AIRFIELD CIRCUIT FOR LOCATION OF BRIGHT TO DIM LIGHTS TO ASSIST IN LOCATING AREA OF GROUND FAULT.

PROVIDE PLACARD OR LEGEND PLATE FOR GROUND FAULT TESTING PROCEDURE. LETTERING TO BE MIN. 1/4" HIGH BLACK ON WHITE BACKGROUND. LOCATE PLACARD IN REGULATOR ROOM, COORDINATED WITH AIRPORT MAINTENANCE STAFF AND RESIDENT ENGINEER.

No.	Drawing	Issue	Description	Date	By

Date
NOVEMBER 10, 2006

Sheet Title

LEGEND PLATE SCHEDULE

831-06A8004
Project Number
KNL 09/01/06
Layout By Date
KNL 09/01/06
Designed By Date
RMH 11/10/06
Reviewed By Date
MV
Drawn By Sheet No.