




STEEL RAILING ELEVATION

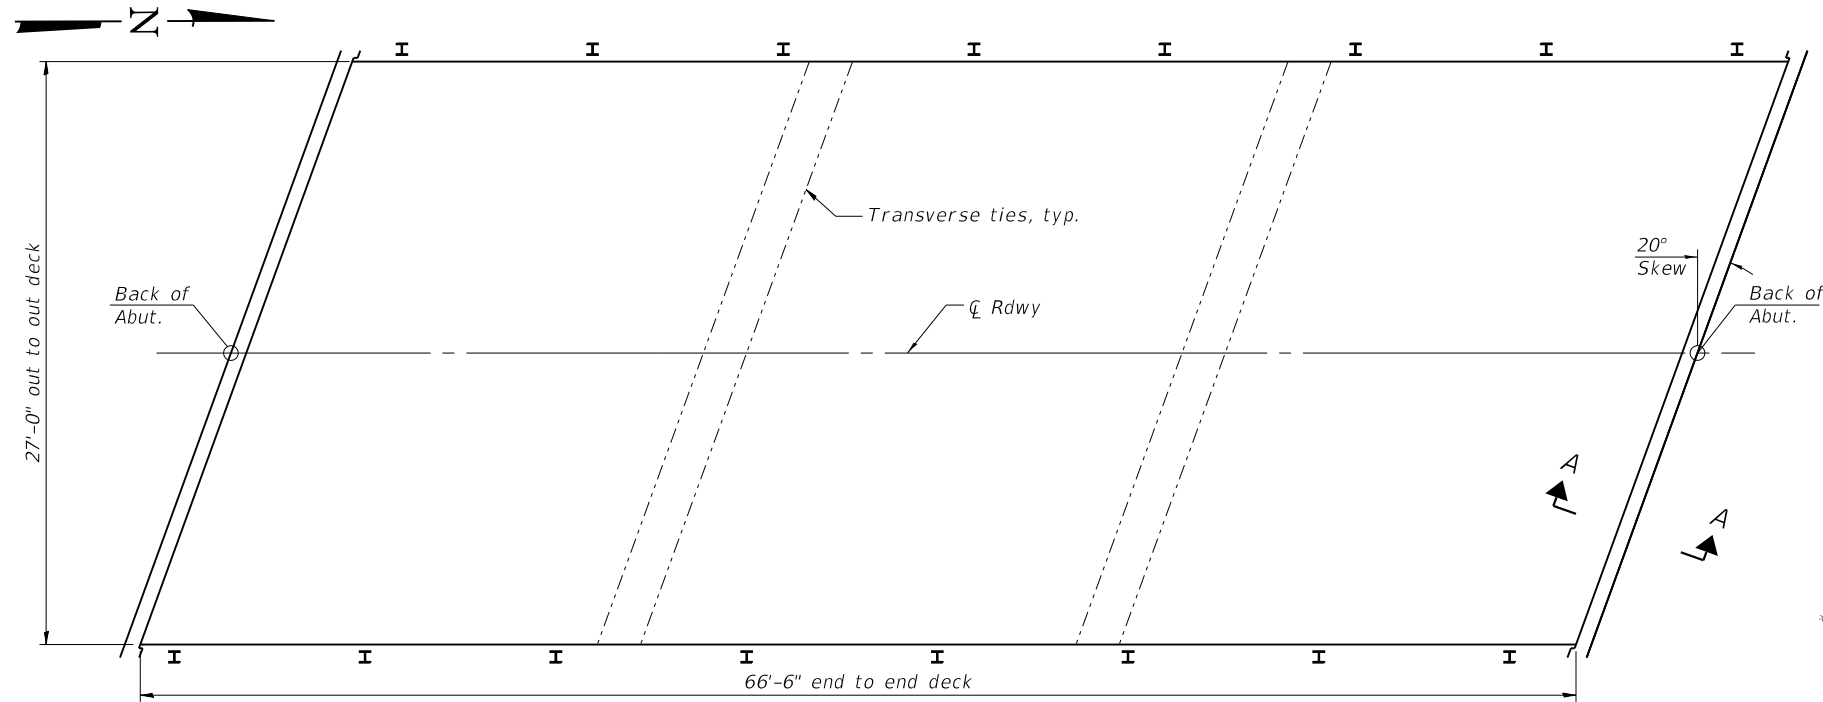

PLAN

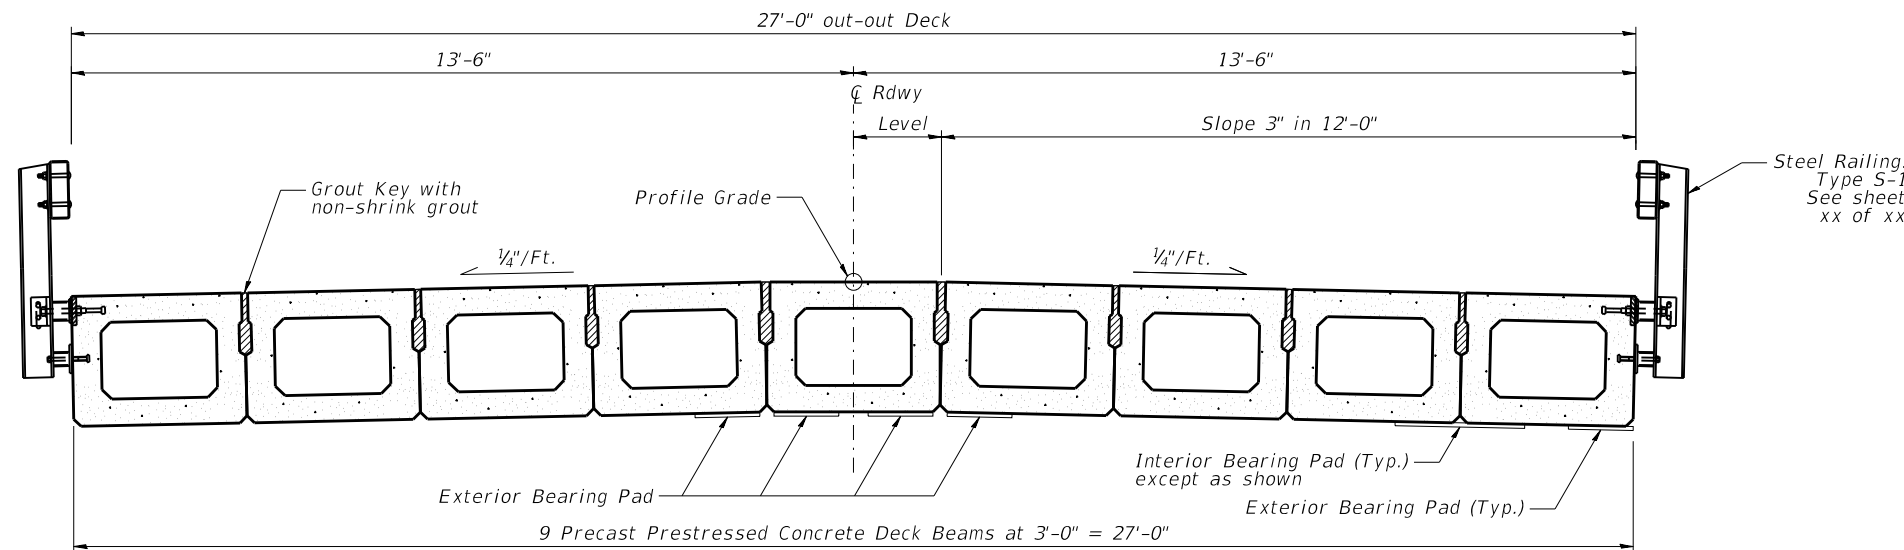

CROSS SECTION

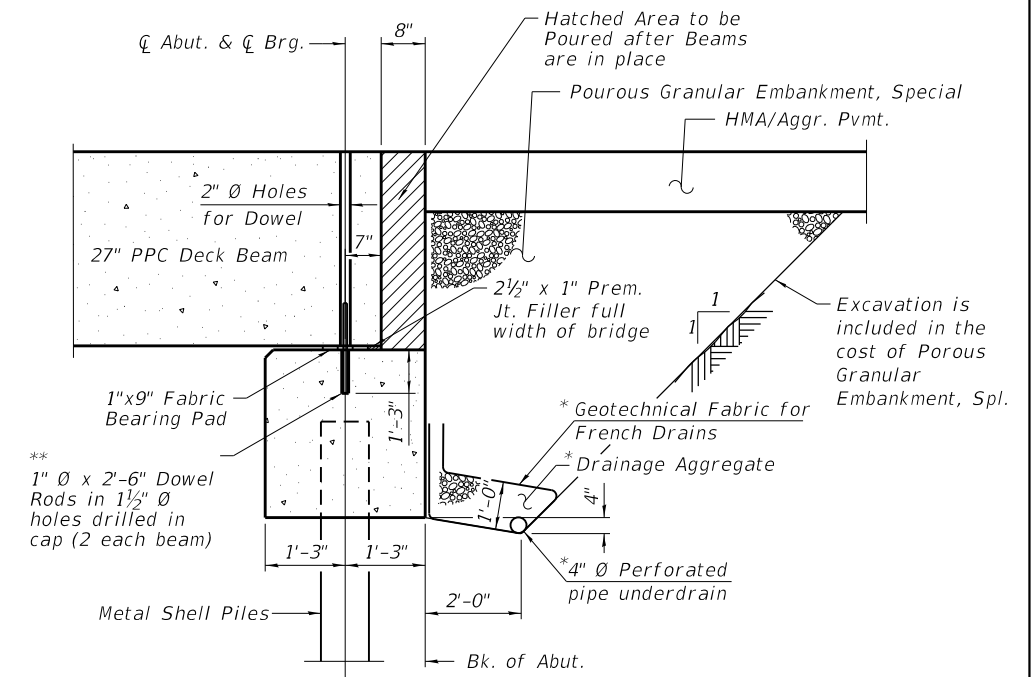

SECTION A-A THRU ABUTMENT

(Horiz. dim. @ Rt. L's)

*Included in the cost of Pipe Underdrains for Structures. (See Special Provisions).

**After beams are in place, 1 1/2" holes shall be drilled into the Substructure, and the dowel rods grouted in place and allowed to cure (Min. 24 Hrs.) prior to grouting shear key.

Note:

Outlet pipe underdrains to East only, as directed by the Engineer.

REVISIONS		
REV. NO.	DESCRIPTION	DATE
1	DTE	12/27/23