REINFORCED CONCRETE PIPE TEE

STORM SEWER REPLACEMENT WITH PREFABRICATED "T" OR "Y" SECTION

PROP. LATERAL 30"

EXIST. SEWER

EXIST. SEWER 48"

12" MIN (300)

4' (1.2 m) MIN

CONCRETE COLLAR

CONSTRUCTION SEQUENCE

1. CUT THE EXISTING END OF THE PIPE SO AS TO PRESENT A FLUSH BUTT JOINT. BRUSH AND CLEAN ALL PIPES.

2. APPLY THE MASTIC JOINT SEALANT TO THE FIRST 12" OF EACH PIPE.

3. BUTT THE PIPES TOGETHER LEAVING A MINIMUM OF 21" X 12" DEEP EXCAVATION UNDER AND AROUND EACH PIPE END.

4. CUT A PIECE OF SHEET METAL GAGE NO. 19 1.1 (0.041B) 30" WIDE BY THE OUTSIDE CIRCUMFERANCE OF THE PIPE PLUS 3" (75) LONG.

5. WRAP THE SHEET METAL AROUND THE PIPES, 15" ON EACH SIDE OF THE JOINT, STARTING AT THE TOP OF THE PIPE.

6. LAP THE SHEET METAL AT LEAST 3" (75) AT THE TOP OF THE PIPE AND PLACE THE MASTIC JOINT SEALANT BETWEEN THE LAP.

7. PLACE TWO METAL BANDS AROUND THE SHEET METAL AND TIGHTEN.

8. WIPE OFF ANY EXCESS MASTIC JOINT SEALANT THAT OOZES OUT FROM BETWEEN THE SHEET METAL AND THE PIPES.

9. PLACE CLASS SI CONCRETE AROUND THE JOINT.

MASTIC JOINT SEALANT

EXISTING PIPE TO BE CUT FLUSH

PROPOSED SEWER LATERAL

EXISTING SEWER LATERAL

PROPOSED SAND BEDDING

EXISTING SAND BEDDING

21" 21"

#6" (150)

SHEET METAL

SHEET METAL (75)

15" 15"

STORM SEWER MASTIC JOINT SEALANT

METAL BINDING

3" (75) 3" (75)

21" MIN.

O.D. + 12" (300) MIN.

CLASS SI CONCRETE

CLASS SI CONCRETE COLLAR

UNDERDRAIN CONNECTION TO STRUCTURE

PROPOSED PIPE UNDERDRAIN

MORTAR

EXIST. CULVERT

BASIS OF PAYMENT

TEE OR WYE CONNECTIONS SHALL BE PAID FOR AT THE CONTRACT UNIT PRICE EACH FOR STORM SEWER TEE OR WYE OF THE TYPE AND SIZE SPECIFIED IN THE PLANS. THIS PRICE SHALL INCLUDE ALL EXCAVATION OF THE TRENCH, REMOVAL OF THE EXISTING STORM SEWER, FURNISHING AND INSTALLING THE SPECIFIED TEE OR WYE SECTION, FURNISHING AND INSTALLING THE REQUIRED CONCRETE COLLAR, AND ALL OTHER MATERIAL NECESSARY TO COMPLETE THIS WORK AS SHOWN AND SPECIFIED.

REMOVAL AND REINSTALLATION OF EXISTING STORM SEWER ADJACENT TO THE PROPOSED TEE OR WYE SECTION, FOR THE PURPOSE OF FACILITATING THE INSTALLATION OF THE TEE OR WYE SECTION, WILL NOT BE PAID FOR SEPARATELY BUT SHALL BE INCLUDED IN THE UNIT PRICE BID FOR THE WORK.

TRENCH BACKFILL, EXCAVATION IN ROCK AND REMOVAL AND REPLACEMENT OF UNSUITABLE MATERIAL BELOW PLAN BEDDING GRADE WILL BE PAID FOR SEPARATELY.

CONCRETE COLLAR FOR CONNECTING A PROPOSED STORM SEWER TO AN EXISTING STORM SEWER WILL NOT BE PAID PAID FOR SEPARATELY BUT SHALL BE INCLUDED IN THE COST OF THE PROPOSED STORM SEWER.

MATERIAL

MATERIAL USED FOR THE TEE OR WYE SECTION SHALL BE COMPATIBLE WITH THE EXISTING STORM SEWER OR THE PROPOSED STORM SEWER.

CONSTRUCTION METHODS

1. THIS WORK SHALL BE CONSTRUCTED IN CONFORMANCE WITH THE APPLICABLE PORTIONS OF SECTION 550 OF THE STANDARD SPECIFICATIONS.
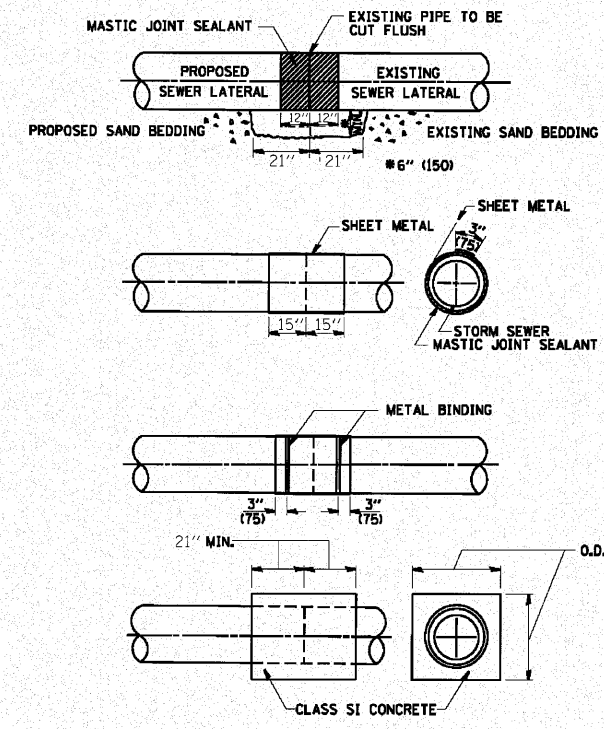
IF THE EXISTING SEWER PIPE IS CRACKED, BROKEN OR OTHERWISE DAMAGED BY THE CONTRACTOR IN MAKING THE CIRCULAR OPENING, THE CONTRACTOR SHALL REPLACE THAT SECTION OF PIPE WITH PIPE EQUAL AND SIMILAR IN ALL RESPECTS TO THE PIPE IN THE EXISTING SEWER, IN A CAREFUL WORKMANLIKE MANNER, WITHOUT EXTRA COMPENSATION.

NOTES

GENERAL

CARE MUST BE TAKEN TO PREVENT DEBRIS FROM ENTERING THE SEWER. ALL DEBRIS WHICH ENTERS THE SEWER MUST BE REMOVED. THE SEWER MUST BE LEFT CLEAN AND UNOBSTRUCTED UPON COMPLETION OF THE CONTRACT.
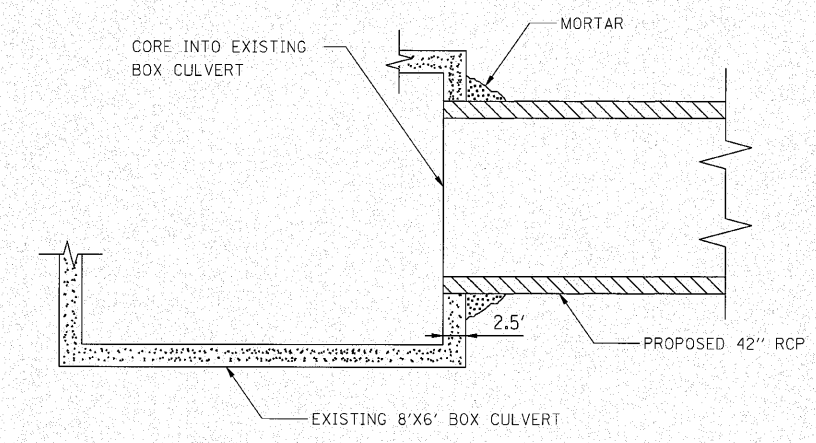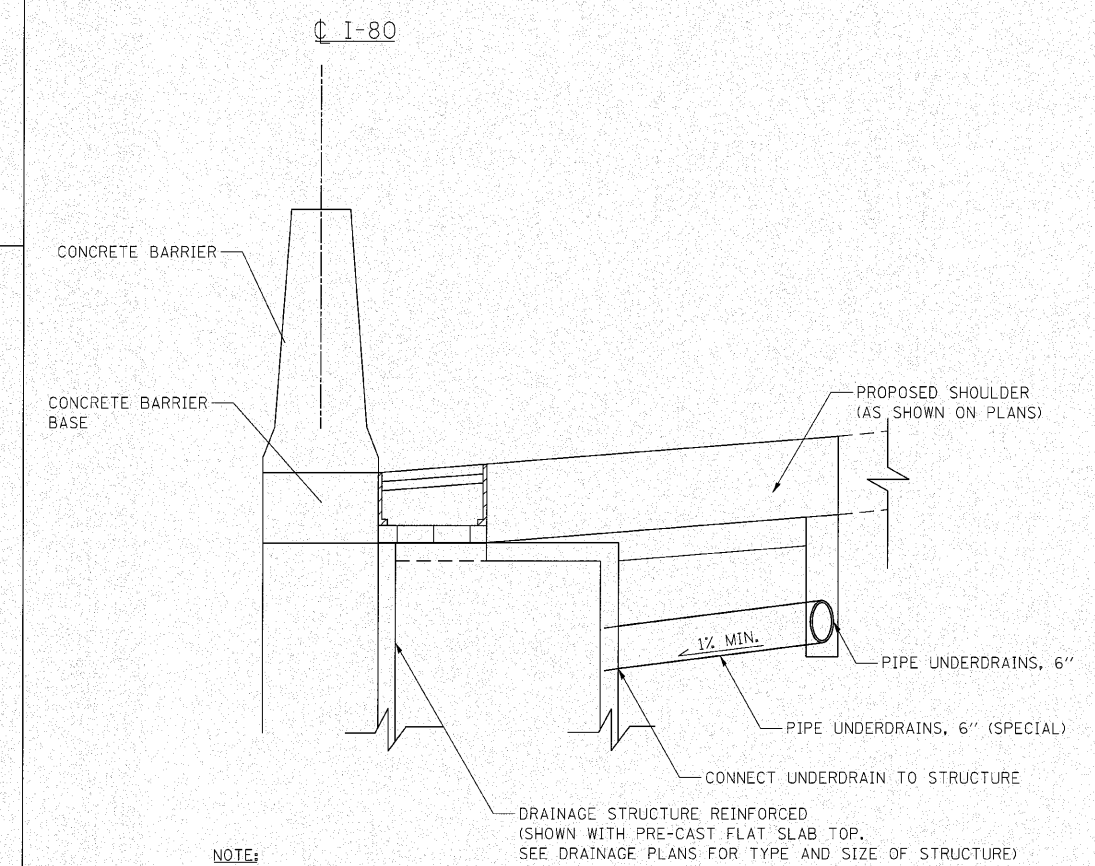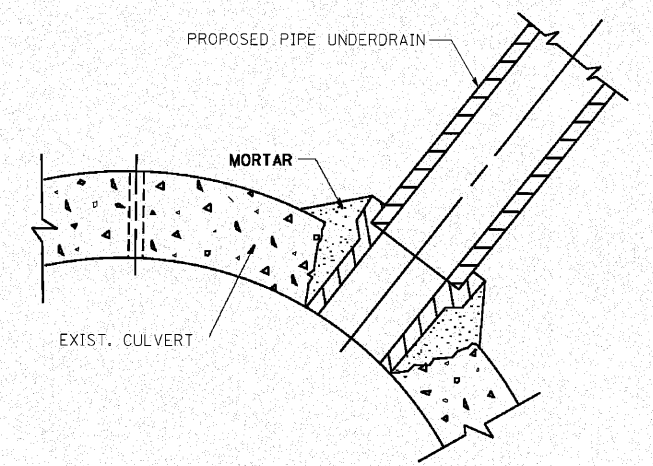
CARE MUST BE TAKEN TO PREVENT ANY PART OF THE NEW PIPE CONNECTION FROM PROJECTING INTO THE EXISTING SEWER.

PROPOSED STORM SEWER CONNECTION TO EXISTING CULVERT

CORE INTO EXISTING BOX CULVERT

MORTAR

2.5'

PROPOSED 42" RCP

EXISTING 8'X6' BOX CULVERT

₵ I-80

CONCRETE BARRIER

CONCRETE BARRIER BASE

PROPOSED SHOULDER (AS SHOWN ON PLANS)

1% MIN.

PIPE UNDERDRAINS, 6"

PIPE UNDERDRAINS, 6" (SPECIAL)

CONNECT UNDERDRAIN TO STRUCTURE

DRAINAGE STRUCTURE REINFORCED (SHOWN WITH PRE-CAST FLAT SLAB TOP. SEE DRAINAGE PLANS FOR TYPE AND SIZE OF STRUCTURE)

NOTE:

THE CONTRACTOR SHALL CAREFULLY CORE INTO THE EXISTING DRAINAGE STRUCTURE THE SAME SIZE AS THE EXTERNAL DIAMETER OF THE PROPOSED PIPE UNDERDRAIN AT THE LINE AND GRADE AS SHOWN IN THE PLANS. THE PROTRUSION OF THE PROPOSED PIPE UNDERDRAIN INTO THE DRAINAGE STRUCTURE MUST NOT EXCEED A MAXIMUM OF ONE INCH. AFTER THE PIPE UNDERDRAIN IS INSTALLED, THE DRAINAGE STRUCTURE SHALL BE MORTARED WITH A NON-SHRINK CONCRETE GROUT.

ALL DIMENSIONS ARE IN INCHES (MILLIMETERS) UNLESS OTHERWISE SHOWN.