


CONTRACTOR TO EXERCISE CAUTION WHEN INSTALLING PROPOSED CABLE AND LIGHTS IN THE LOCATION OF EXISTING UNDERGROUND STORM SEWER, WATERMAIN, TELEPHONE, AND ELECTRICAL UTILITY PRIMARY CABLE (TYPICAL EACH SIDE OF TWY. B)

PROPOSED 1-NO. 8, 5KV, TY. C, 1/C STR. CABLE IN UNIT DUCT

TWY. B CURVE DATA

P.I.	= STA. 2142+87.50
a	= 90°00'00"
D	= 76°23'40"
R	= 75.00'
T	= 75.00'
L	= 117.81'
E	= 31.07'
P.C.	= STA. 2142+12.50
P.T.	= STA. 2143+30.31

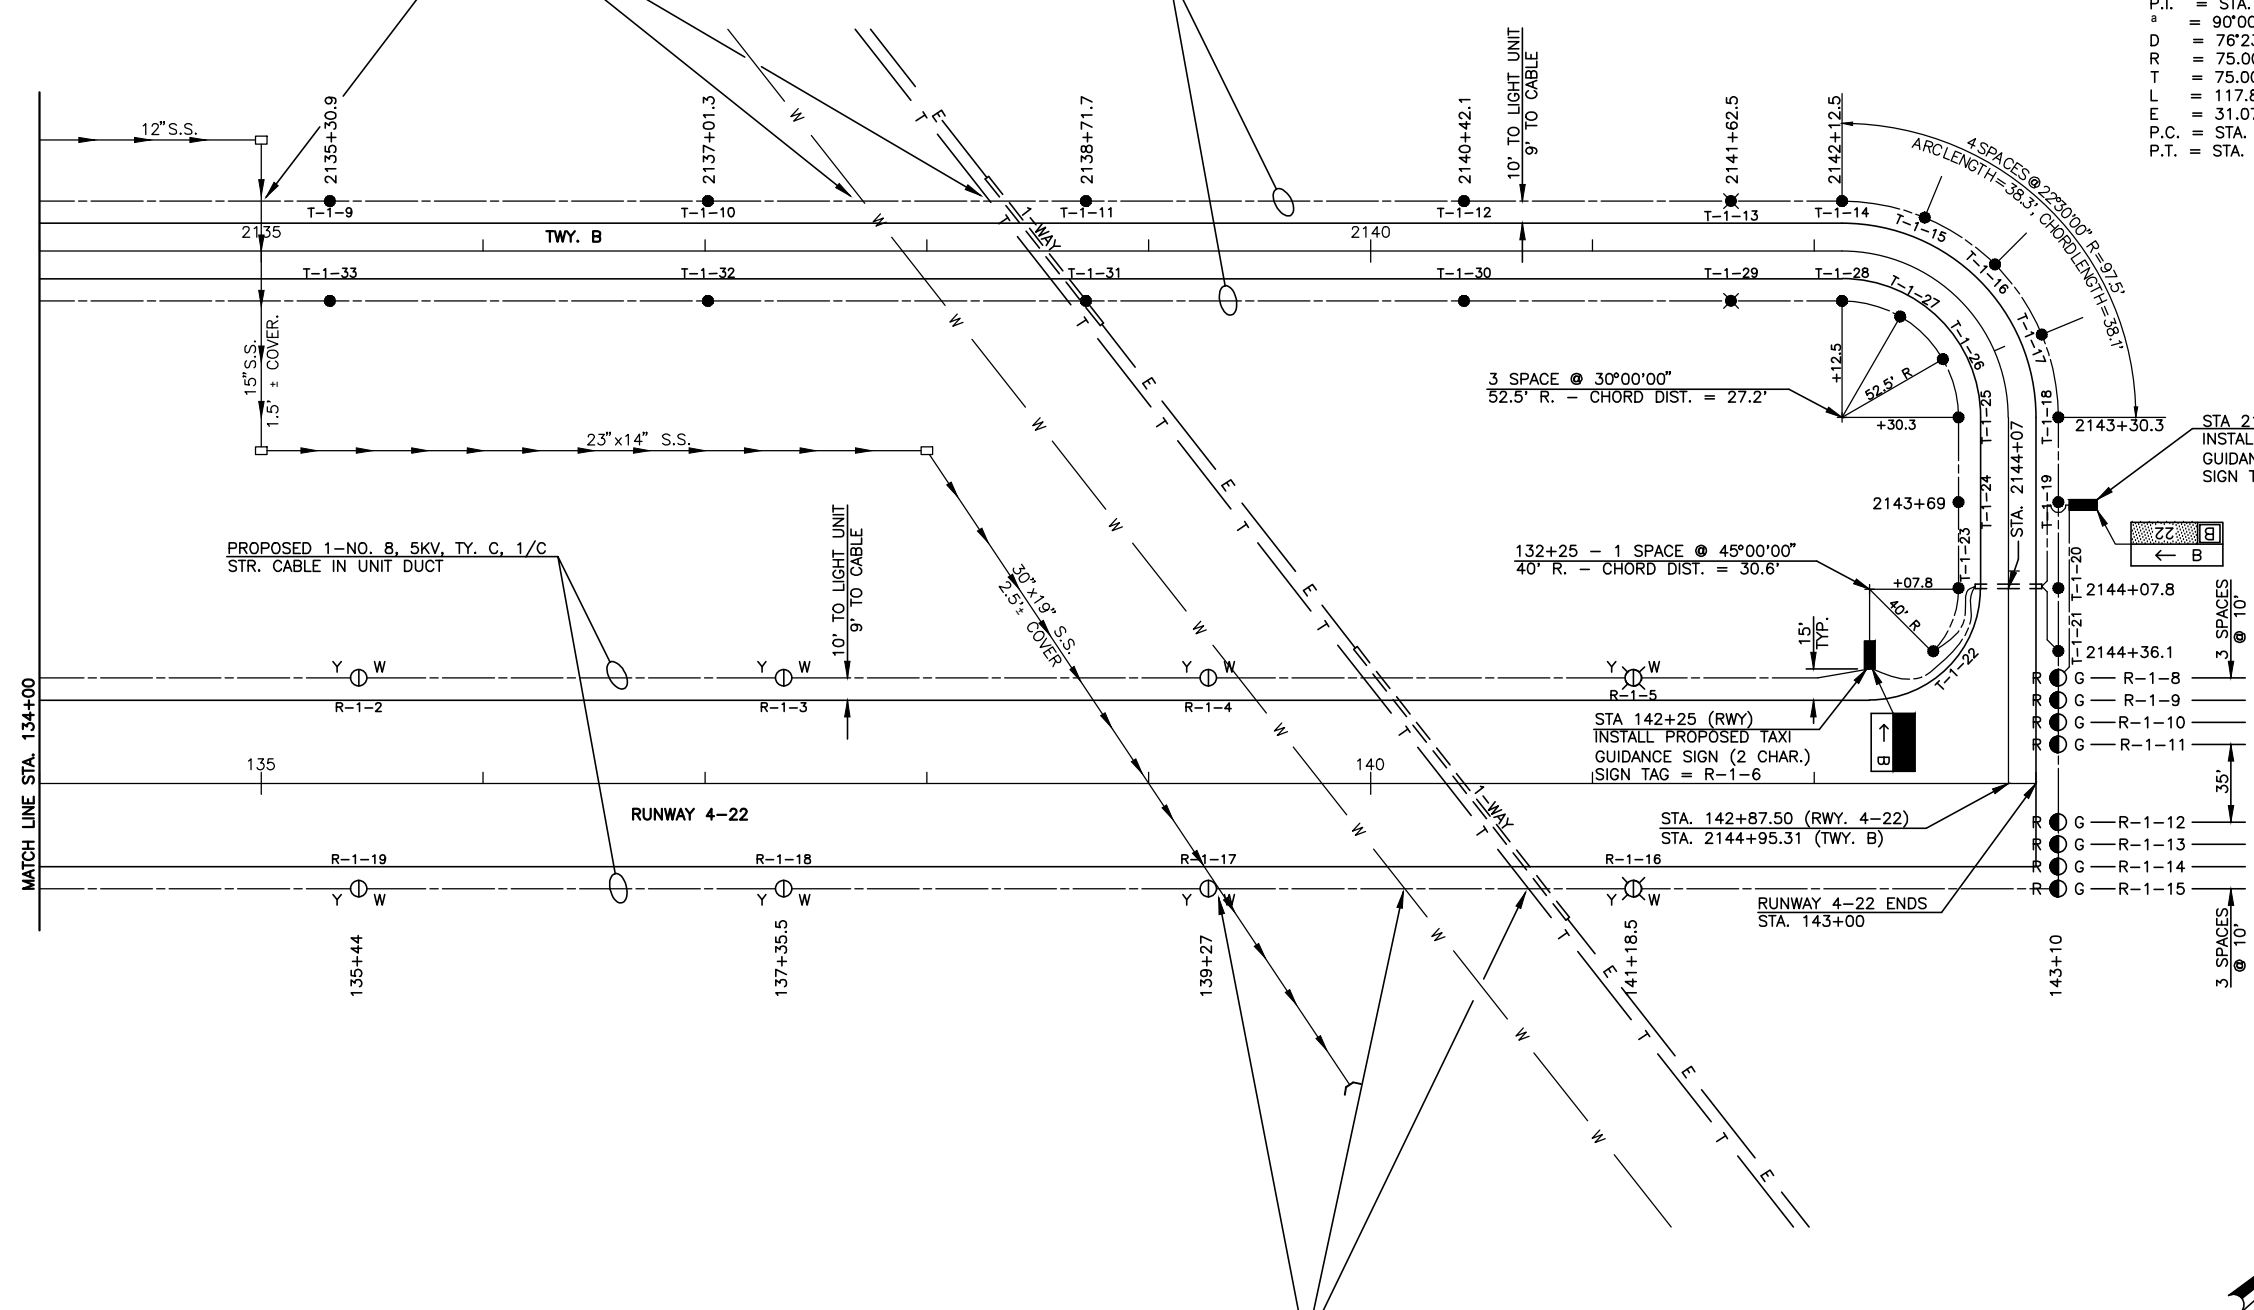

MATCH LINE STA. 134+00

CONTRACTOR TO EXERCISE CAUTION WHEN INSTALLING PROPOSED CABLE AND LIGHTS IN THE LOCATION OF EXISTING UNDERGROUND STORM SEWER, WATERMAIN, TELEPHONE, AND ELECTRICAL UTILITY PRIMARY CABLE (TYPICAL EACH SIDE OF RUNWAY 4-22)

FOR GENERAL NOTES AND LEGEND APPLICABLE TO THIS LAYOUT SHEET, SEE SHEET 4 IN THESE PLANS.

CASEY MUNICIPAL AIRPORT CASEY, ILLINOIS	
RUNWAY 4-22 AND TAXIWAY LIGHTING LAYOUT	
HUTCHISON ENGINEERING, INC. JACKSONVILLE, ILLINOIS	
DRAWN BY: R.L.R. & J.C.W. DATE: OCTOBER, 2014	ILL. PROJ. NO. 1H8-4369 SBG PROJ. NO. 3-17-SBGP-XX