



THE LOCATION OF THE UTILITIES SHOWN ARE DETERMINED FROM THE BEST AVAILABLE DATA. THEY ARE FOR INFORMATIONAL PURPOSES ONLY AND ARE NOT INTENDED TO PURPORT THE ACTUAL LOCATIONS OF SUCH UTILITIES. THE CONTRACTOR SHALL VERIFY THE LOCATIONS OF THE UTILITIES IN THE FIELD AT THE TIME OF CONSTRUCTION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTING ALL UTILITIES AND SHALL BE LIABLE FOR ANY DAMAGES TO THEM RESULTING FROM HIS OPERATIONS.

NOTICE
SEE "EXISTING WATERMAIN SHUT-OFF"
SHEET G0.03, FOR REQUIRED PROCEDURES
TO CUT AND PLUG EXISTING MAIN

NEW WATERMAIN SHALL BE 12-INCH D.I.P.
TYTON JOINT, PRESSURE CLASS 350
WITH 8 MIL POLYETHYLENE PIPE WRAP

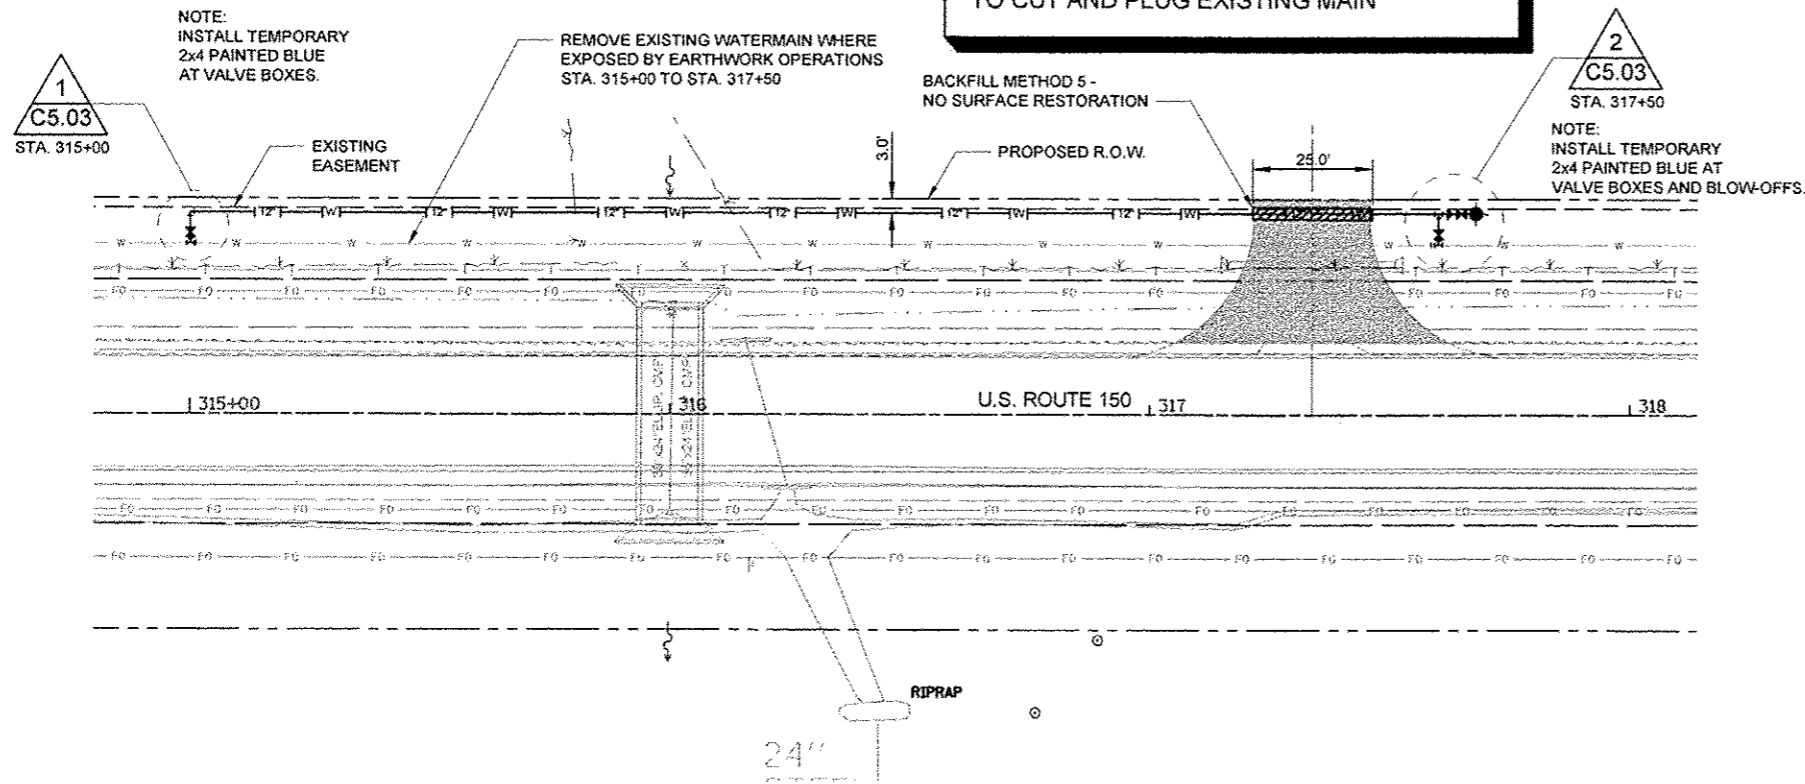

- TEMPORARY BLOW-OFF**
1. INSTALL BLOW-OFF DISCHARGE 3 FEET ABOVE GRADE.
 2. DIRECT BLOW-OFF FLOW TOWARD LOCAL DRAINAGE.
 3. REMOVE BLOW-OFF AT THE REQUEST OF ILAW.

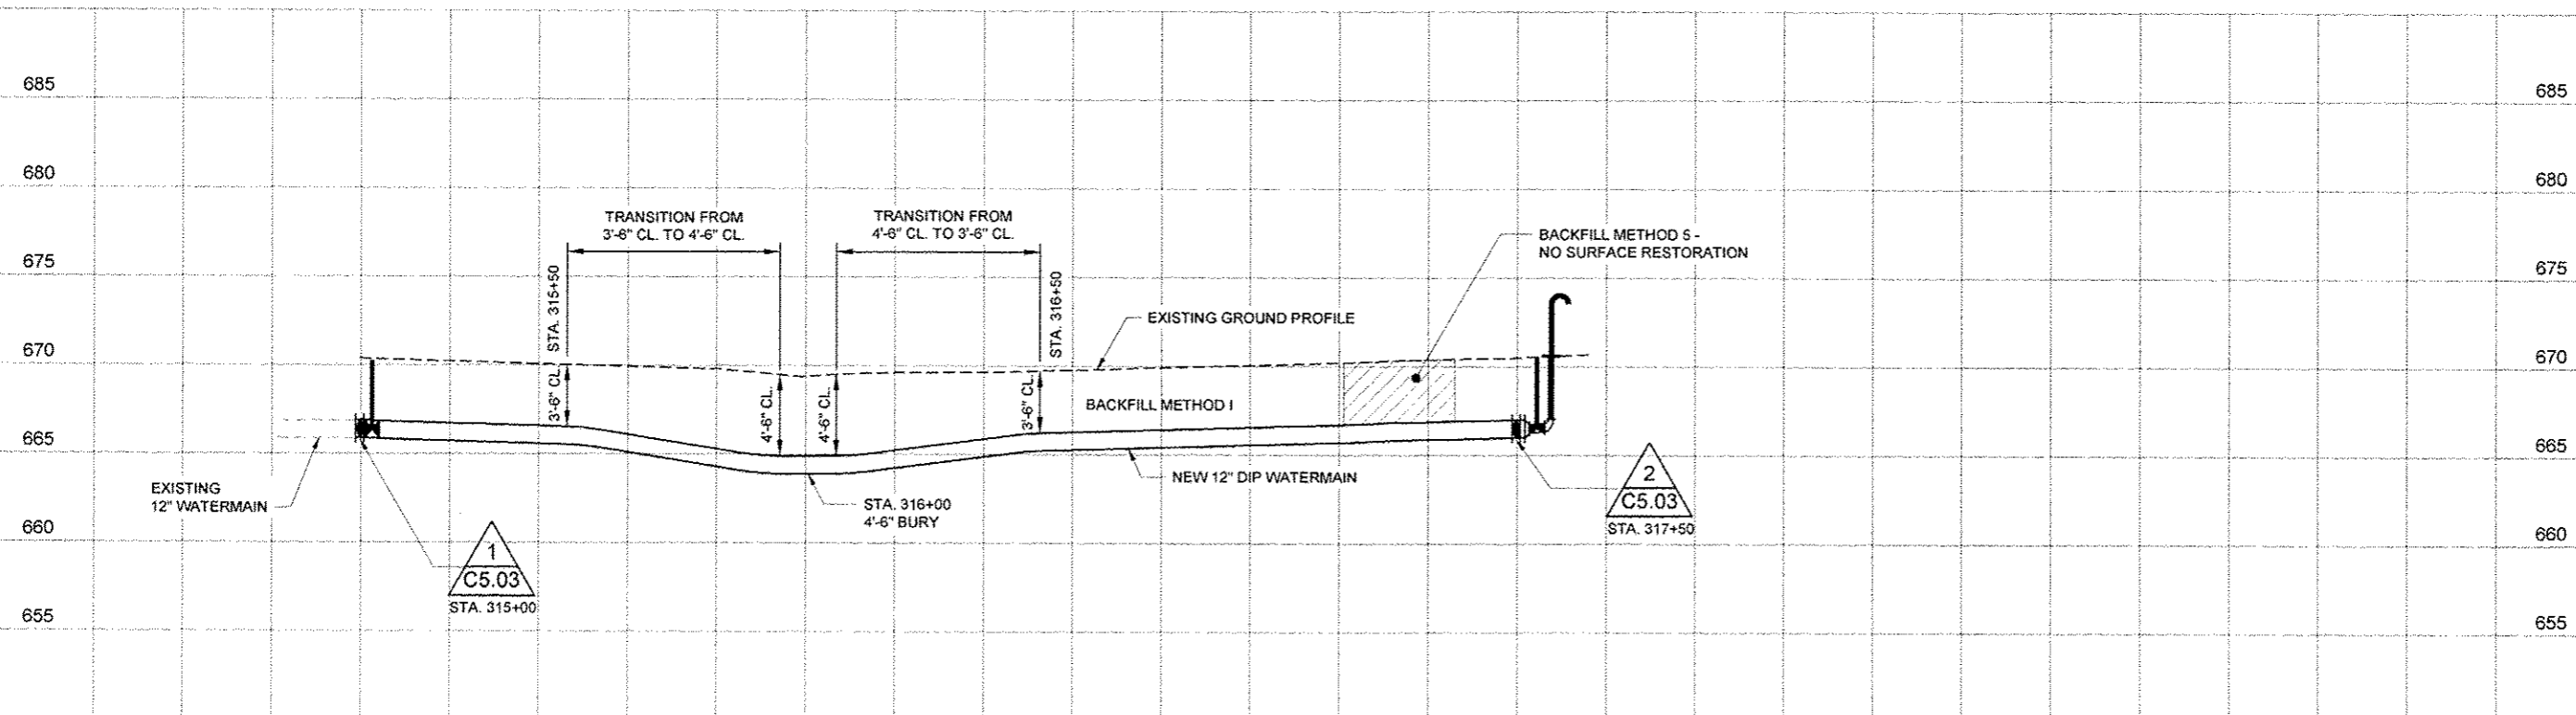


42" MINIMUM COVER TO 48" MAXIMUM COVER FOR WATERMAIN INSTALLATION UNLESS NOTED ON DRAWINGS OR APPROVED BY ILLINOIS AMERICAN WATER.

CUSTOMER NOTIFICATION OF SERVICE INTERRUPTION, IF NECESSARY, WILL BE THE RESPONSIBILITY OF ILLINOIS-AMERICAN. CONTRACTOR SHALL ADHERE TO THE SUBMITTED CONSTRUCTION SCHEDULE OR NOTIFY ILLINOIS-AMERICAN OF ANY DELAYS ONE WEEK PRIOR TO SCHEDULED WORK.

TRAFFIC CONTROL SHALL BE IN ACCORDANCE WITH IDOT STD 701101 UNLESS NOTED OTHERWISE.

WATERMAIN BACKFILL, FINAL GRADING, TOPSOIL STORAGE AND REPLACEMENT, SEEDING AND MULCHING SHALL BE AS REQUIRED IN THE STANDARD SPECIFICATIONS FOR WATER AND SEWER MAIN CONSTRUCTION IN ILLINOIS.

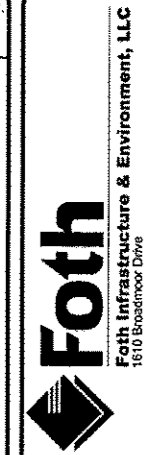

**ROUTE 150 WATERMAIN RELOCATION
BETWEEN URBANA AND ST. JOSEPH**
ILLINOIS AMERICAN WATER COMPANY
IDOT CONTRACT NO. 70663

CHAMPAIGN COUNTY URBANA, ILLINOIS


NO.	BY	DATE	DESCRIPTION

RECORD DRAWING OF COMPLETED CONSTRUCTION BY: _____
RECORD DRAWINGS OF COMPLETED CONSTRUCTION CONFORMING TO CONTRACTOR AND/OR OWNERS RECORDS BY: _____
DATE: _____

Date of Preparation: July 17, 2013

BY	DATE
SURVEYED: FOTH	07-13-2013
DRAWN: WKH	07-17-2013
DESIGNED: MAJ	07-17-2013
CHECKED: MAJ	07-17-2013

SHEET NAME
STA. 315+00 TO
STA. 317+50



C1.18
SHEET 21 OF 29