




VE048

REVISIONS		
NUMBER	BY	DATE




DUCT BANK NOTES

1. DIMENSIONS SHOWN ARE MINIMUM.
2. TOP OF CONCRETE ENCASUREMENT TO BE NOT LESS THAN 24" BELOW FINISHED SUBGRADE.
3. DUCT CONCRETE TO BE ITEM 610 STRUCTURAL P.C.C. CONCRETE.
4. ALL DUCT WILL BE 4" INSIDE DIAMETER.
5. LOCATIONS SHOWN ARE APPROXIMATE. DUCT BANKS TO BE INSTALLED AT LOCATIONS DESIGNATED BY THE ENGINEER.
6. CONTRACTOR WILL INSTALL DUCT BANKS AT A DEPTH WHICH WILL NOT CONFLICT WITH ELEVATION SENSITIVE UTILITIES.
7. A PULL WIRE MUST BE PROVIDED IN EACH UNUSED CONDUIT. UNUSED DUCT MUST BE SEALED AT CAN PLAZA TO THE SATISFACTION OF THE ENGINEER.

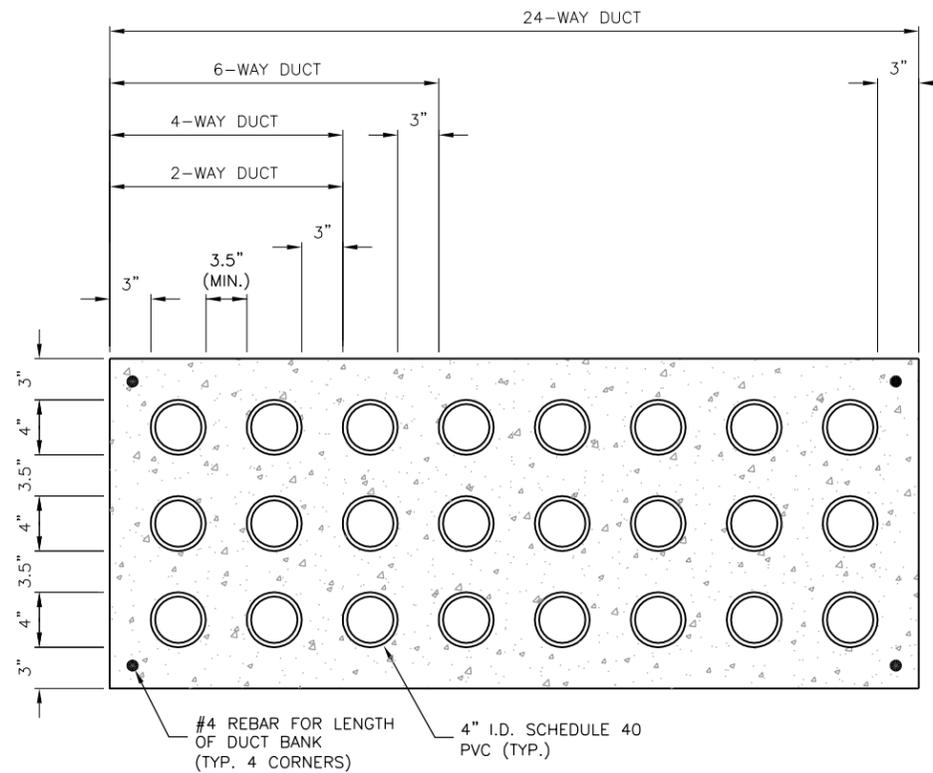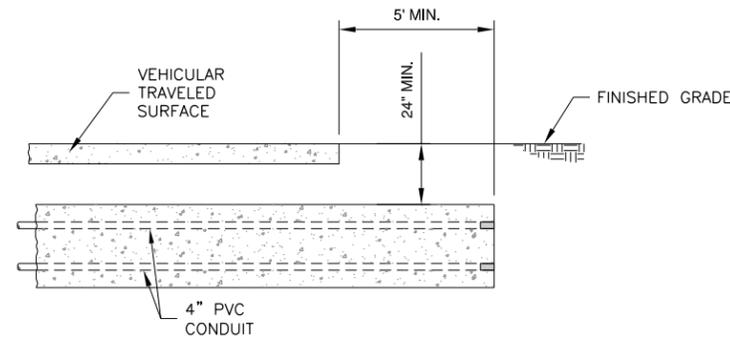


DUCT BANK DETAILS

N.T.S.

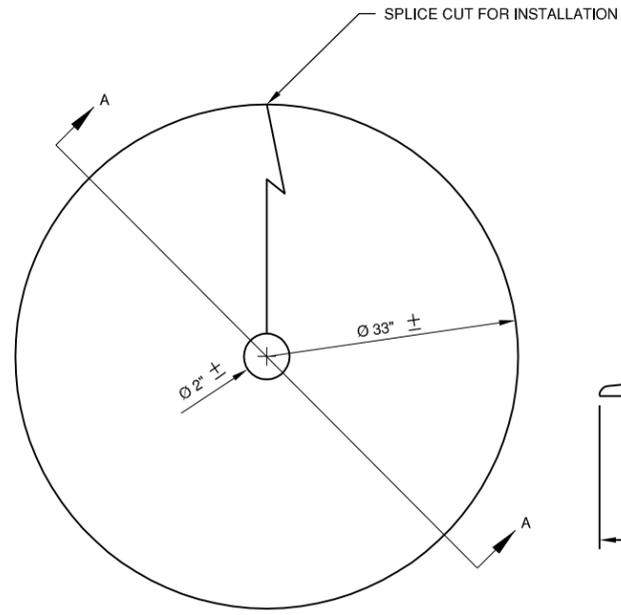

PLAN VIEW

N.T.S.

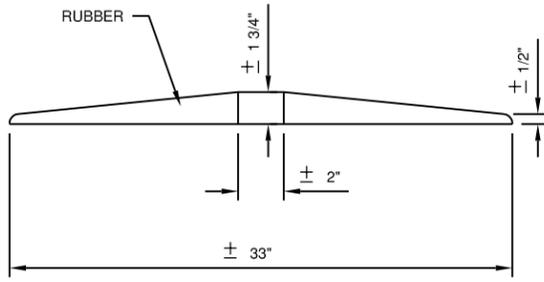


SECTION A-A

N.T.S.

VEGETATION CONTROL RING DETAIL


N.T.S.

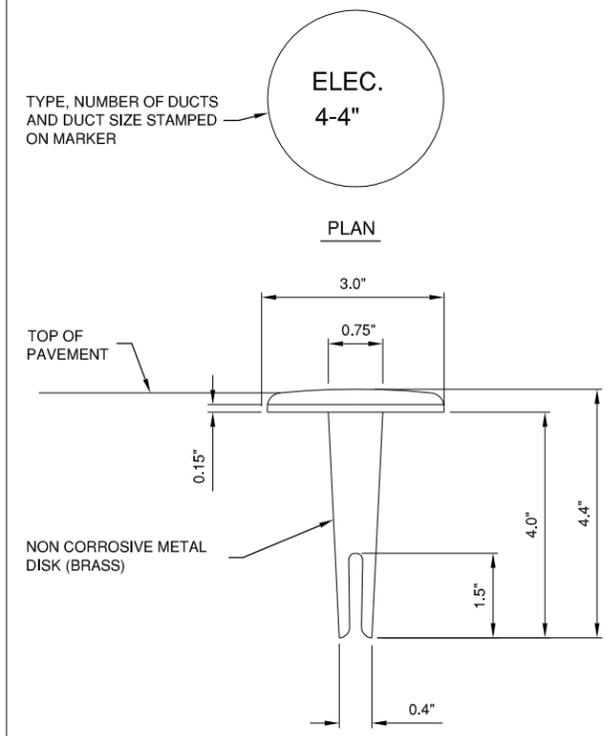

PLAN

SECTION

NEW DUCT MARKERS SHALL BE INSTALLED AT BOTH EDGES OF PAVEMENT AT ALL NEW DIRECTIONAL BORE, SPLIT DUCT, AND CONCRETE ENCASED DUCT LOCATIONS.

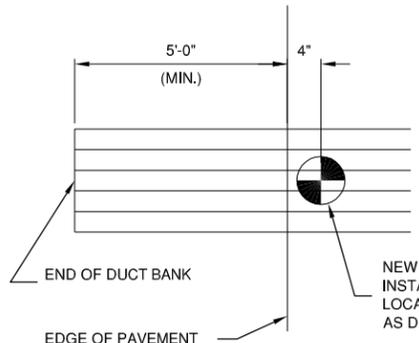

NEW DUCT MARKER SHALL BE INSTALLED AT ALL DUCT BANK LOCATIONS AND UTILITY CROSSINGS AS DIRECTED BY THE ENGINEER.

DUCT MARKERS SHALL BE RECESSED AND GROUTED INTO THE PAVEMENTS.

MARKER PLACEMENT

DUCT MARKER DETAILS

N.T.S.

VERMILION REGIONAL AIRPORT
 VERMILION REGIONAL AIRPORT AUTHORITY
 DANVILLE, ILLINOIS

RELOCATE TAXIWAY C AND WIDEN FILLETS
 ELECTRICAL DETAILS 2

© Copyright CMT, Inc.
CMT
 CRAWFORD, MURPHY & TILLY, INC.
 CONSULTING ENGINEERS
 License No. 184-000613

DESIGN BY:	AJB
DRAWN BY:	CMT
CHECKED BY:	TJH
APPROVED BY:	CET
DATE:	JANUARY 3, 2014
JOB No:	120420100
IL PROJ. NO.	DNV-4229
SBG PROJ. NO.	3-17-SBGP-XX
SHEET	21 OF 27 SHEETS

K:\Drawings\12042010\Draw\Sheets