


- NOTES:**
- CONTRACTOR WILL BE RESPONSIBLE FOR CONTACTING PUBLIC UTILITY COMPANY TO ADJUST THEIR STRUCTURES IN THE PUBLIC ROW.
 - CONTRACTOR WILL BE RESPONSIBLE FOR CONFIRMING ANY LIVE SEWER LINES AND LET ENGINEER KNOW BEFORE ABANDONING OR REMOVING STRUCTURES.
 - ALL ABANDONED SEWERS SHALL BE PLUGGED AT BOTH ENDS WITH A MINIMUM OF TWO (2) FEET LONG NON-SHRINK CONCRETE OR MORTAR PLUGS.
 - RESILIENT CONNECTORS (ASTM C-923) SHALL BE PROVIDED BETWEEN STRUCTURES AND PIPES FOR ALL PROPOSED PIPES CONNECTING TO EXISTING AND PROPOSED STRUCTURES AND ALL PROPOSED STRUCTURES CONNECTING TO EXISTING AND PROPOSED PIPES.

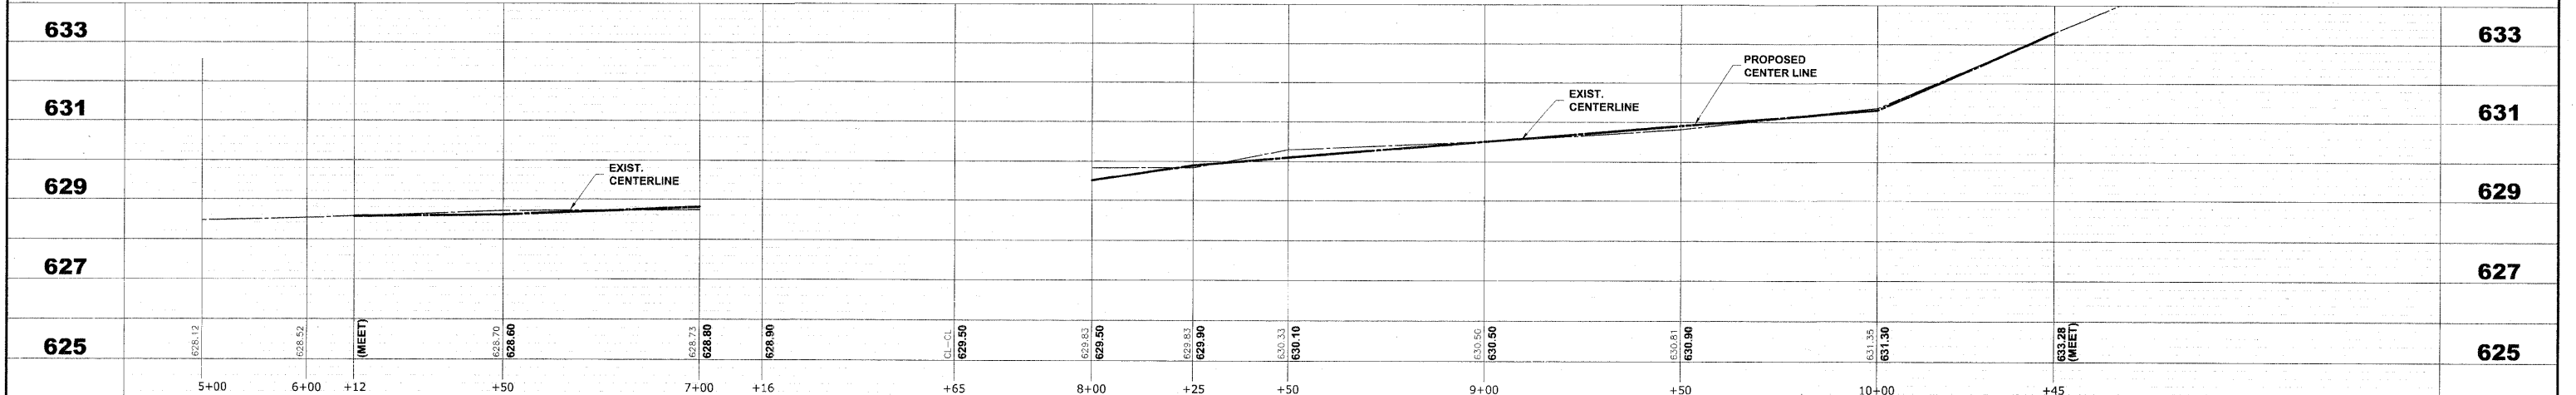

HANCOCK ENGINEERING Civil Engineers Municipal Consultants Established 1911	USER NAME - PLOT SCALE - PLOT DATE -	DESIGNED - MK/SBC DRAWN - MK/LEV CHECKED - SBC/JG/MV DATE - 11-30-09	REVISED - REVISED - REVISED - REVISED -	STATE OF ILLINOIS DEPARTMENT OF TRANSPORTATION		9TH AVENUE UTILITIES PLAN AND PROFILE		F.A.U. RTE. 1397 SECTION 09-00129-00-PV COUNTY COOK TOTAL SHEETS 103 SHEET NO. 48 CONTRACT NO. 63428 FED. ROAD DIST. NO. 1 ILLINOIS FED. AID PROJECT M-9003 (267) (BOOK NOS. 1579, 1583, 1589) E.H.E PROJECT NO. 565-08-29001
	SCALE: 1"=20'H./2V. SHEET NO. 1 OF 1 SHEETS STA. 6+12 TO STA. 10+45							

Drawing file: W:\Projects\565082900 - St. Charles Rd\St. Charles Rd\St. Charles Rd.dwg Dec 08, 2009 - 9:20am