


Contract # 64C03

**NOTES**

Bar splicer assemblies shall be of an approved type and shall develop in tension at least 125 percent of the yield strength of the lapped reinforcement bars.  
 Splicer rods shall be of minimum 60 ksi yield strength, threaded or coiled full length.  
 All reinforcement bars shall be lapped and tied to the splicer rods or dowel bars.  
 Bar splicer assemblies shall be epoxy coated according to the requirements for reinforcement bars.  
 Other systems of similar design may be submitted to the Engineer for approval. Approval shall be based on certified test results from an approved testing laboratory that the proposed bar splicer assembly satisfies the following requirements:

- ① Minimum Capacity =  $1.25 \times f_y \times A_t$   
(Tension in kips)
  - ② Minimum \*Pull-out Strength =  $0.66 \times f_y \times A_t$   
(Tension in kips)
- Where  $f_y$  = Yield strength of lapped reinforcement bars in ksi.  
 $A_t$  = Tensile stress area of lapped reinforcement bars.  
 \* = 28 day concrete

| BAR SPLICER ASSEMBLIES |                                 |                              |                                       |
|------------------------|---------------------------------|------------------------------|---------------------------------------|
| Bar Size to be Spliced | Splicer Rod or Dowel Bar Length | Strength Requirements        |                                       |
|                        |                                 | Min. Capacity kips - tension | Min. Pull-Out Strength kips - tension |
| #4                     | 1'-8"                           | 14.7                         | 7.9                                   |
| #5                     | 2'-0"                           | 23.0                         | 12.3                                  |
| #6                     | 2'-7"                           | 33.1                         | 17.4                                  |
| #7                     | 3'-5"                           | 45.1                         | 23.8                                  |
| #8                     | 4'-6"                           | 58.9                         | 31.3                                  |
| #9                     | 5'-9"                           | 75.0                         | 39.6                                  |
| #10                    | 7'-3"                           | 95.0                         | 50.3                                  |
| #11                    | 9'-0"                           | 117.4                        | 61.8                                  |

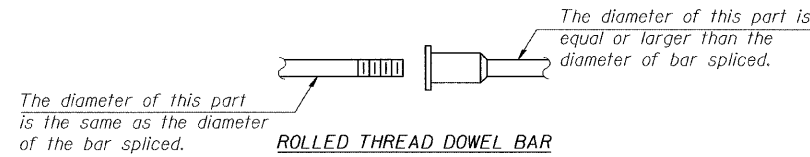

ROLLED THREAD DOWEL BAR



\*\* ONE PIECE


Wire Connector



WELDED SECTIONS


**BAR SPLICER ASSEMBLY ALTERNATIVES**

\*\*Heavy Hex Nuts conforming to ASTM A 563, Grade C, D or DH may be used.

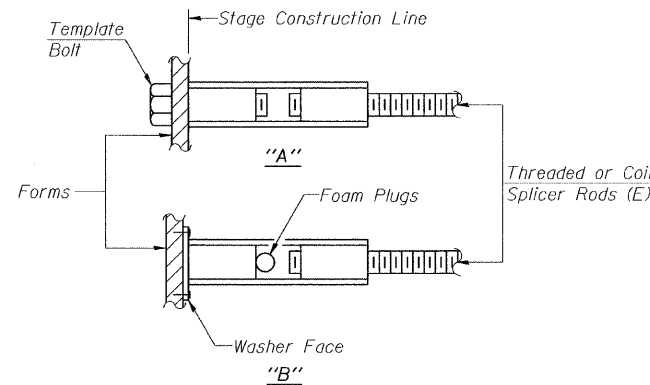


**INSTALLATION AND SETTING METHODS**


"A" :Set bar splicer assembly by means of a template bolt.  
 "B" :Set bar splicer assembly by nailing to wood forms or cementing to steel forms.  
 (E) : Indicates epoxy coating.

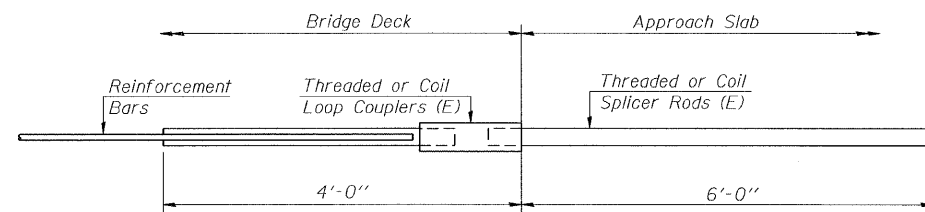

FOR INTEGRAL OR SEMI-INTEGRAL ABUTMENTS

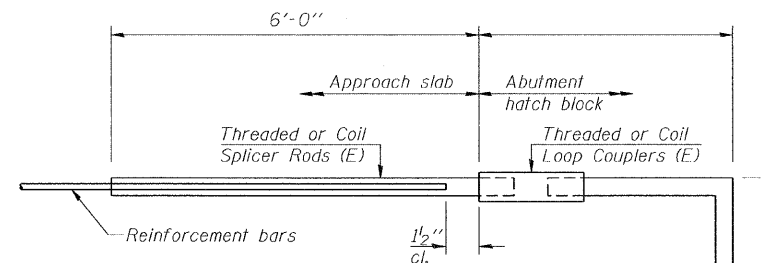

FOR STUB ABUTMENTS

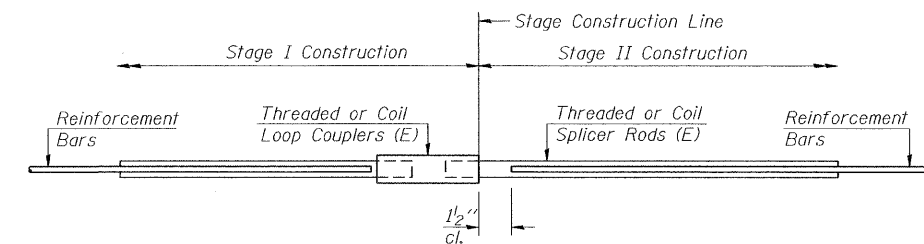

STANDARD

|  |  |
|--|--|
| Bar Splicer for #5 bar                       |  |
| Min. Capacity = 23.0 kips - tension          |  |
| Min. Pull-out Strength = 12.3 kips - tension |  |
| No. Required = 64                            |  |

|  |  |
|--|--|
| Bar Splicer for #5 bar                       |  |
| Min. Capacity = 23.0 kips - tension          |  |
| Min. Pull-out Strength = 12.3 kips - tension |  |
| No. Required = 0                             |  |

| Bar Size | No. Assemblies Required | Location        |
|----------|-------------------------|-----------------|
| #5       | 608                     | BRIDGE DECK     |
| #6       | 12                      | S. ABUT. DIAPH. |
| #6       | 12                      | N. ABUT. DIAPH. |
| #4       | 4                       | S. PIER DIAPH.  |
| #8       | 1                       | S. PIER DIAPH.  |
| #4       | 4                       | N. PIER DIAPH.  |
| #8       | 1                       | N. PIER DIAPH.  |
| #5       | 6                       | N. PIER CAP     |
| #7       | 2                       | S. ABUT.        |
| #7       | 4                       | N. ABUT.        |

|          |        |
|----------|--------|
| DESIGNED | J.Z.   |
| CHECKED  | E.E.J. |
| DRAWN    | M.S.M. |
| CHECKED  | J.Z.   |

BSD-1 5-16-08

BAR SPLICER ASSEMBLY DETAILS  
 IL Route 84 over Irish Hollow Creek  
 F.A.P. RTE 308, SECTION (103C-1BR)D  
 JO DAVIESS COUNTY  
 STATION 449+62.06  
 DATE: 12-11-08 S.N. 043-0037  
 GRAEF, ANHALT, SCHLOEMER & ASSOCIATES INC  
 CHICAGO ILLINOIS