




DETAIL "A" VARIABLE 12" WIDTH WELDED WIRE FABRIC 2" MIN. PROPOSED STORM SEWER WIDTH OF CONCRETE SLAB SHALL BE THE SAME AS THE TRENCH WIDTH IN ACCORDANCE WITH SECTION 611 OF THE STANDARD SPECIFICATIONS.

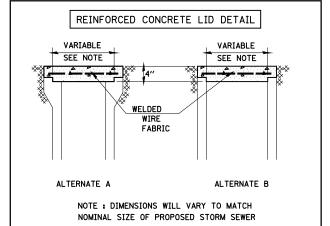

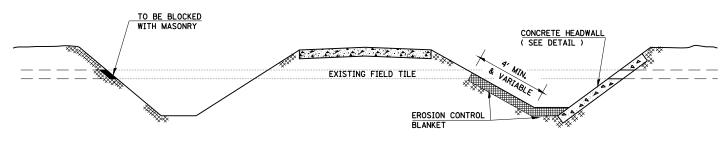

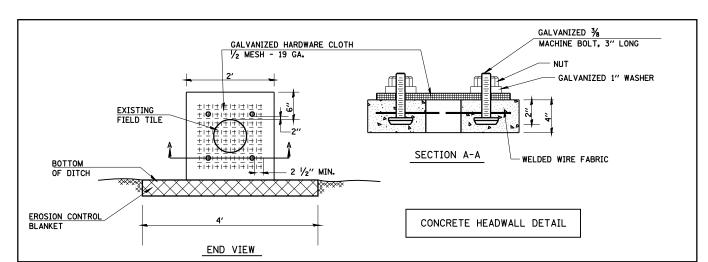

STATE OF ILLINOIS DEPARTMENT OF TRANSPORTATION

GENERAL NOTES

- 1. FIELD TILE SHALL BE REPLACED IN ACCORDANCE WITH SECTION 611 OF
 THE STANDARD SPECIFICATIONS. THE COST PER CONTRACT UNIT PRICE
 OF ITEMS INCLUDED IN THIS CONTRACT SHALL BE PAID FOR AS STATED
 IN SECTION 611 OF THE STANDARD SPECIFICATIONS. IF THE CONTRACT
 UNIT PRICE IS NOT INCLUDED IN THIS CONTRACT, PAYMENT FOR THIS
 WORK WILL BE IN ACCORDANCE WITH ARTICLE 109.04 OF THE STANDARD
 SPECIFICATIONS.
- 2. THE DIAMETER OF THE PROPOSED STORM SEWER SHALL BE EQUAL TO OR GREATER THAN THE EXISTING FIELD TILE.
- 3. THE REINFORCED CONCRETE LID SHALL BE CLASS SI MISCELLANEOUS CONCRETE OR PRECAST REINFORCED CONCRETE.
- 4. FIELD TILES LESS THAN 7" DIAMETER INTERCEPTED BY THE BACKSLOPE SHALL BE CRUSHED AND REMAIN IN PLACE UNDER THE ROADBED. INTERCEPTED FIELD TILES 7" OR LARGER IN DIAMETER SHALL BE REMOVED AND BACKFILLED IN ACCORDANCE WITH ARTICLE 611.03.