


- NOTES:
1. ALL TAPED SPLICES SHALL USE 2 LAYERS OF ELECTRICAL TAPE OVER 3 LAYERS OF RUBBER TAPE AS REQUIRED BY THE STANDARD SPECIFICATION. COAT THE FINISH TAPED SPLICE WITH BONDING COMPOUND.
 2. ALL CABLE SPLICES SHALL BE TAPED UNLESS ANOTHER METHOD HAS BEEN SPECIFICALLY APPROVED BY THE ENGINEER.
 3. THE NUMBER OF CABLES IN SPLICE MAY VARY

TYPICAL SPLICE DETAIL

N.T.S.

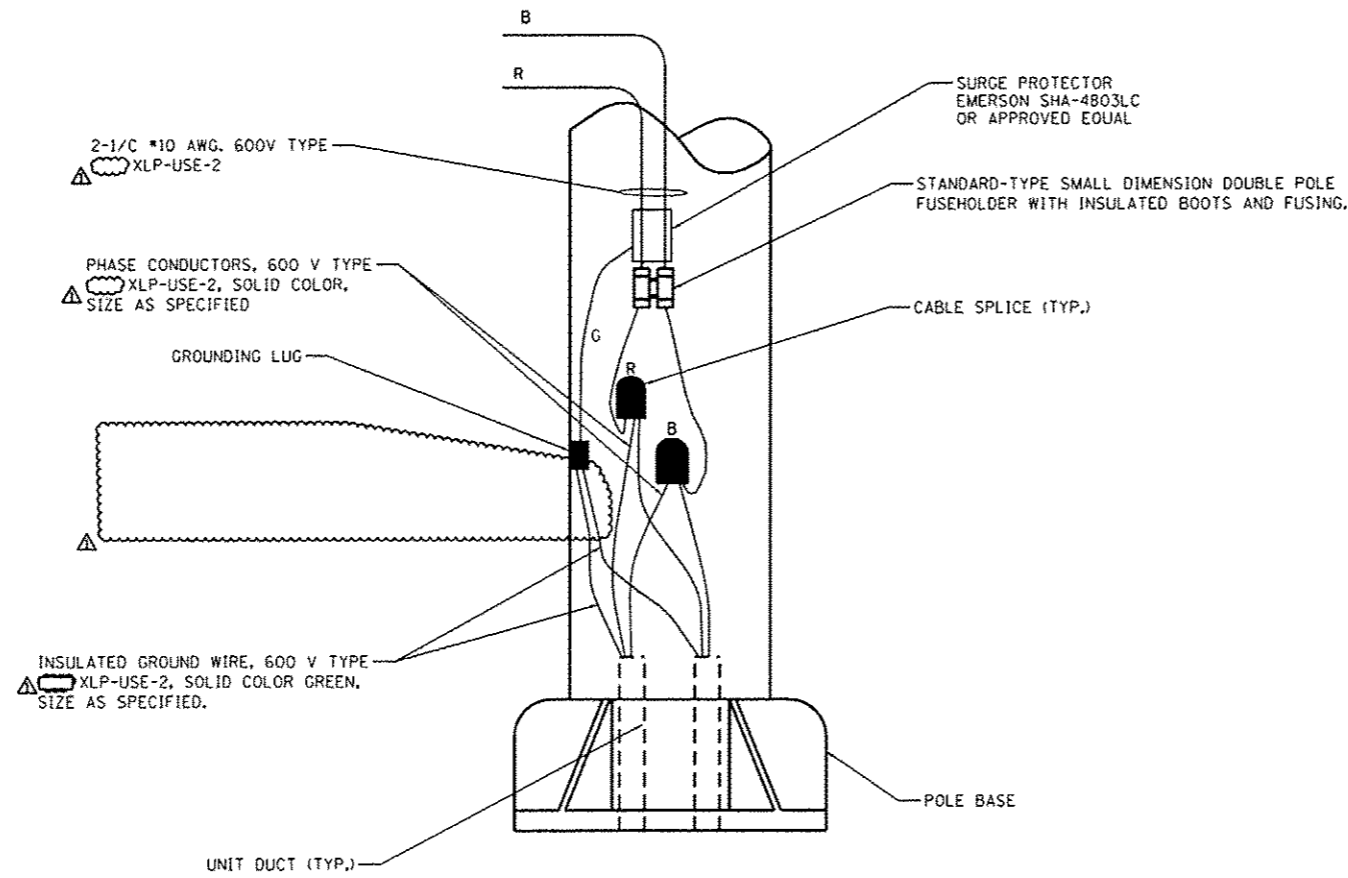

POLE WIRING DETAIL

N.T.S.

DIRECTOR: C:\WORK\2013\20130524\20130524.dwg
 USER: JWD
 DATE: 2/22/2013 3:46:20 PM

CMT
 CRAWFORD, MURPHY & TILLY, INC.
 CONSULTING ENGINEERS
 License No. 184-002613

MODEL NAME = 2013.dwg	DESIGNED - JWD	REVISED - 2/22/2013
FILE NAME = 036401-EM.dwg	DRAWN - JWD	REVISED -
PLOT SCALE = 1/8" = 1'-0"	CHECKED - AB	REVISED -
PLOT DATE = 2/22/2013 3:46:20 PM	DATE - 11/02/2012	REVISED -

STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION

ROADWAY LIGHTING DETAIL
TYPICAL SPLICE - POLE WIRING DETAIL (BE-702)

SCALE: N/A SHEET 25 OF 32 SHEETS STA. TO STA.

F.A.P. RTE. 742	SECTION (32, 33) R-1	COUNTY WINNEBAGO	TOTAL SHEETS 705	SHEET NO. 511
CONTRACT NO. 64821			ILLINOIS FED. AID PROJECT	