



TYPICAL RAMP DETAIL WITH 15' RADI & 3' PATH OFFSET

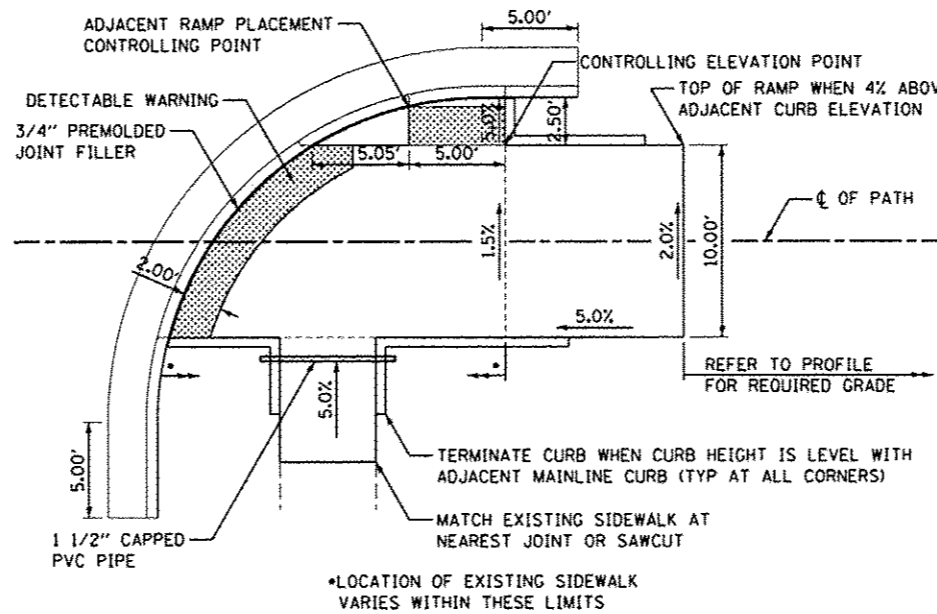

TYPICAL RAMP DETAIL WITH 17.5' RADI & 2.5' PATH OFFSET

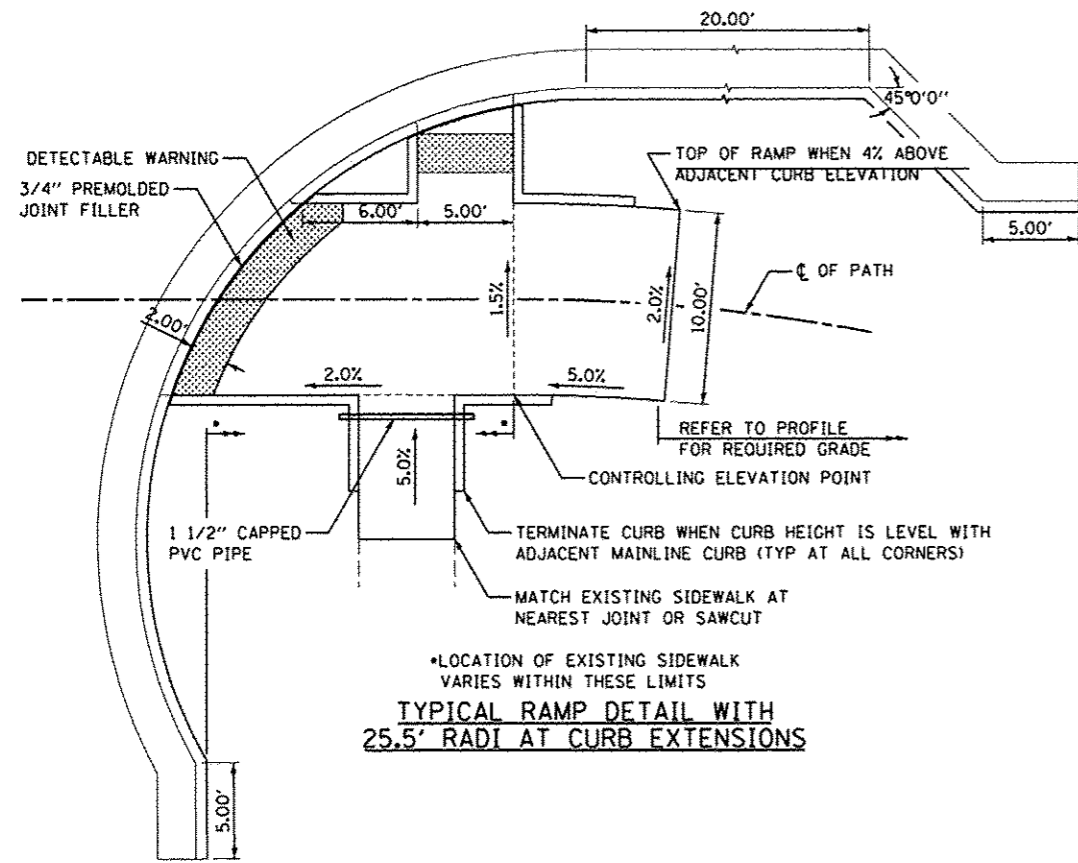

TYPICAL RAMP DETAIL WITH 25.5' RADI AT CURB EXTENSIONS

NOTES:

1. MATCH EXISTING CURB AND GUTTER WITH MINIMUM 6" HIGH BARRIER CURB. TRANSITION CURB HEIGHT OVER 2" TO MATCH EXISTING CURB HEIGHT. IF NO EXISTING GUTTER FLAG, PROVIDE A B6-24 COMBINATION CONCRETE CURB AND GUTTER.
2. 3/4" PREMOLDED JOINT FILLER SHALL BE PLACED AT BACK OF CURB WHEN CURB ABUTS SIDEWALKS.
3. MAXIMUM SIDEWALK CROSS SLOPE SHALL BE 2%.
4. MINIMUM SIDEWALK THICKNESS SHALL BE 5".
5. DETECTABLE WARNING SHALL BE BRICK RED.
6. MAXIMUM LONGITUDINAL SIDEWALK SLOPE SHALL BE 5%.
7. 1 1/2" CAPPED PVC PIPE SHALL EXTEND 1' BEYOND AND AT A DEPTH OF 1' BELOW PCC SIDEWALK.

PREPARED DATE: 10/31/2012
 DRAWN BY: ADG
 CHECKED BY: ADG
 APPROVED BY: ADG
 CITY OF DANVILLE, ILLINOIS

NO.	DATE	DESCRIPTION OF REVISIONS	NO.	DATE	DESCRIPTION OF REVISIONS

SECTION NO. 06-00224-00-BT	ENGR: ADG
ESI PROJECT NO: 07-163-074-01	DRAWN BY: ADG
DATE: 10-31-2012	QCQA: DLCPAT