


F.A.I. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
90/94	2003-0311	COOK	976	901
STA.		TO STA.		
FED. ROAD DIST. NO. 1		ILLINOIS FED. AID PROJECT		


62583

**NOTES:**


1. SEE DMS-01 THROUGH DMS-08, DYNAMIC MESSAGE SIGN SITE LAYOUT, FOR CONDUIT AND CABLE SIZES.
2. 120/240V, 1 PHASE, 3 WIRE, 100 AMP GROUNDED UTILITY SERVICE TO UTILITY SERVICE POLE.
3. SEE DRAWING DT-07 FOR WIRING DIAGRAMS.
4. METER REQUIRED ON ALL DMS-UPS CABINETS EXCEPT DMS-UPS-08.
5. SEE DRAWING DT-05 FOR CONNECTION TO DMS CONTROLLER CABINETS. SEE DRAWING DT-41 FOR DMS/SYSTEM DETECTOR SURVEILLANCE CABINETS.

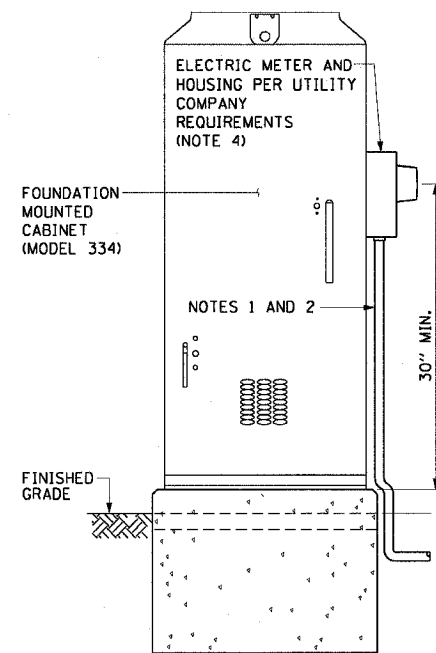


UPS CABINET FRONT VIEW (MODEL 334)

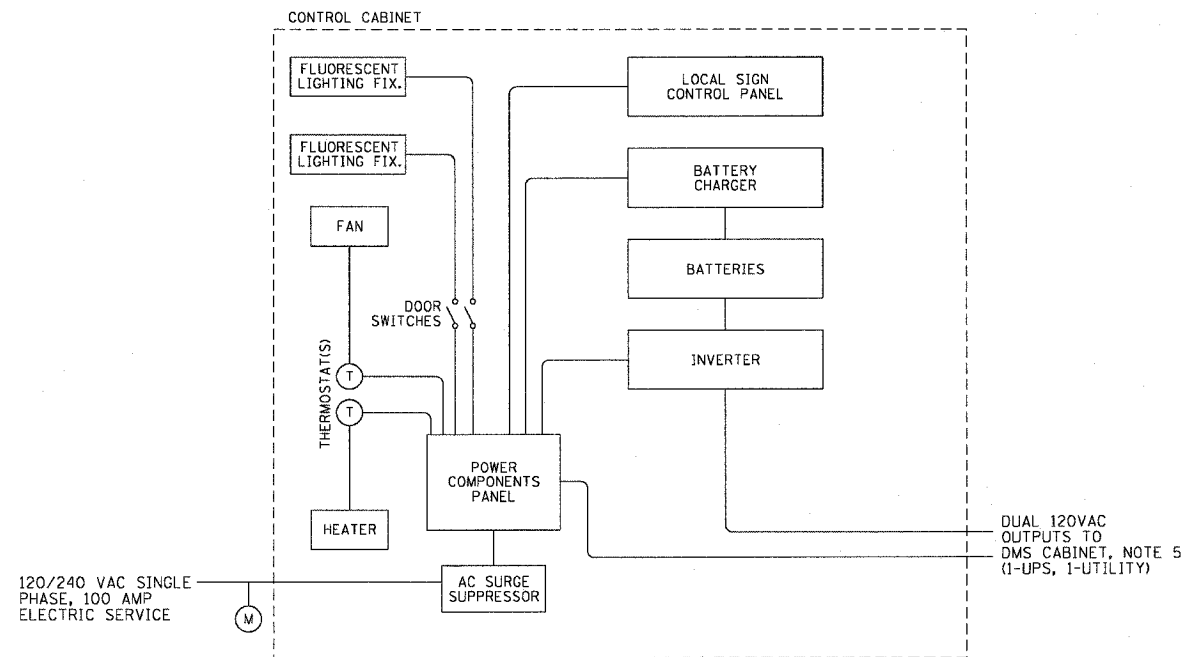

DMS UPS CABINET SINGLE LINE DIAGRAM (TYPICAL) (MODEL 334)

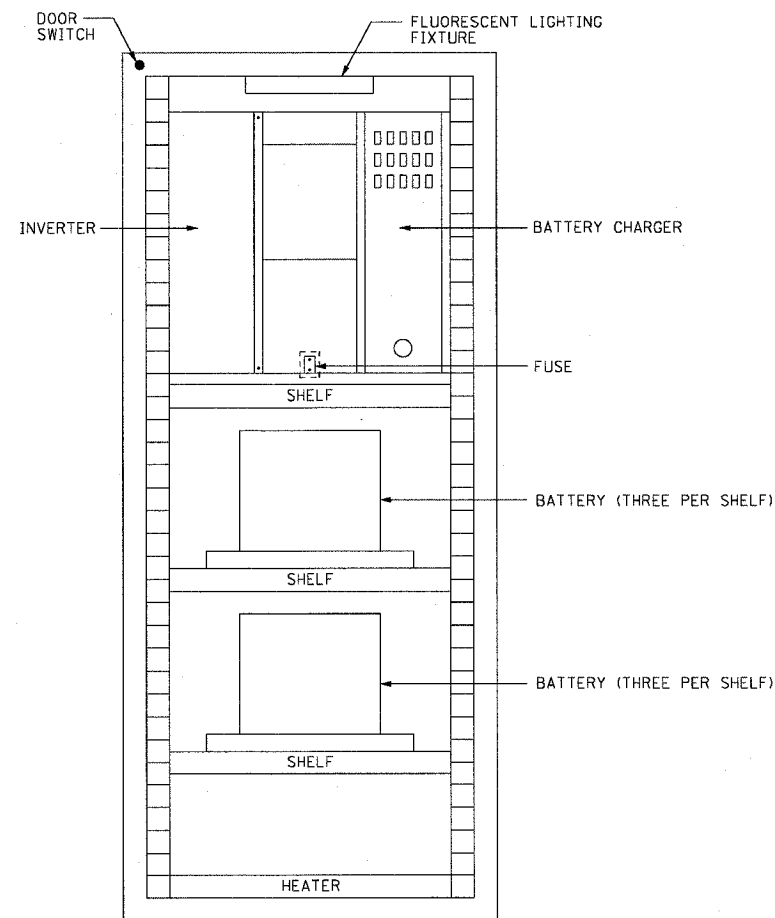

UPS CABINET LAYOUT FRONT VIEW (TYPICAL) (MODEL 334)

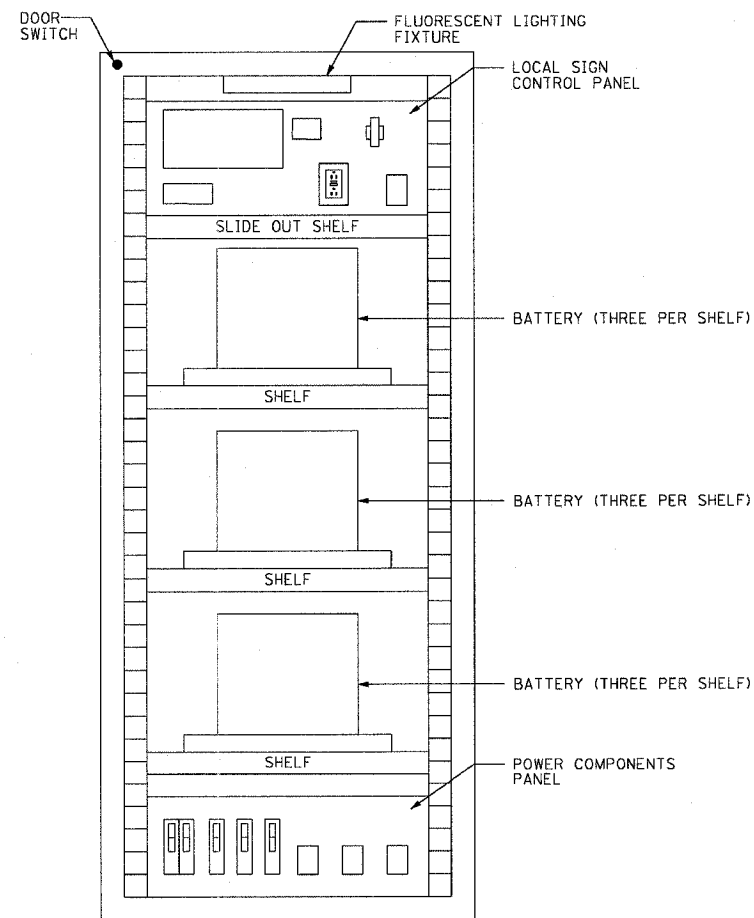

UPS CABINET LAYOUT BACK VIEW (TYPICAL) (MODEL 334)

REVISIONS	
NAME	DATE
REVISED	1/21/05