


## TYPICAL SPLICE DETAIL

N.T.S.

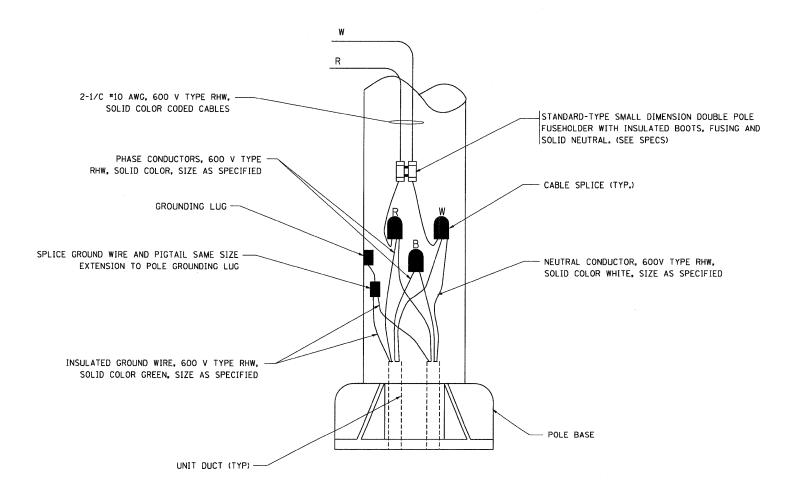

TYPICAL WIRING IN TRENCH DETAIL N.T.S.

30" (762) MINIMUM COVER 12" (305) MAXIMUM WIDTH EXCEPT AS APPROVED BY THE ENGINEER

12" (305)

WARNING TAPE AS SPECIFIED

WITH INTERNAL INSULATED EQUIPMENT GROUND WIRE.

UNIT DUCT OR OTHER RACEWAY
AND WIRING AS PER PLANS. COMPLETE

POLE WIRING DETAIL

N.T.S.

FILE NAME =	USER NAME = gaglianobt	DESIGNED -	REVISED - 08-08-03	
W:\diststd\22x34\be702.dgn		DRAWN -	REVISED -	
	PLOT SCALE = 50.000 '/ IN.	CHECKED -	REVISED -	
1	PLOT DATE = 1/4/2008	DATE -	REVISED -	

STATE	OF	ILLINOIS
DEPARTMENT (	OF 7	<b>TRANSPORTATION</b>

MISC. ELECTRICAL DETAILS SHEET A					F.A RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.	
								781	577	
					BE-702		CONTRACT NO.		- 1	
CALE: NONE	SHEET NO. 1	OF 1	SHEETS	STA.	TO STA.	FED. ROAD DIST. NO. 1 ILLINOIS FED. AID PROJECT				