


CABLE TRENCH

CONDUIT TRENCH

NOTE
 EXCESS SOIL FROM TRENCH TO BE COMPLETELY REMOVED FROM SITE AS SOON AS PRACTICABLE.
 BLACK DIRT TO BE TAMPED & THOROUGHLY COMPACTED AS SHOWN.

STANDARD METHOD FOR BACKFILLING CABLE & CONDUIT TRENCHES IN SODDED PARKWAY & LAWNS			
CITY OF CHICAGO			
DEPT. OF STREETS & SANITATION			
DIVISION OF ELECTRICAL ENGINEERING			
REVISION	DRAWN	CHECKED	ENGINEER
A	W. E. HARR	J. J. CONNOR	J. J. CONNOR
B			
C	ENGINEER IN CHARGE		
D			
E	SUPT. OF CONET.		
F			
G			
H	SIZE 8 1/2 X 14"	SCALE: N	DATE: 7-14-01

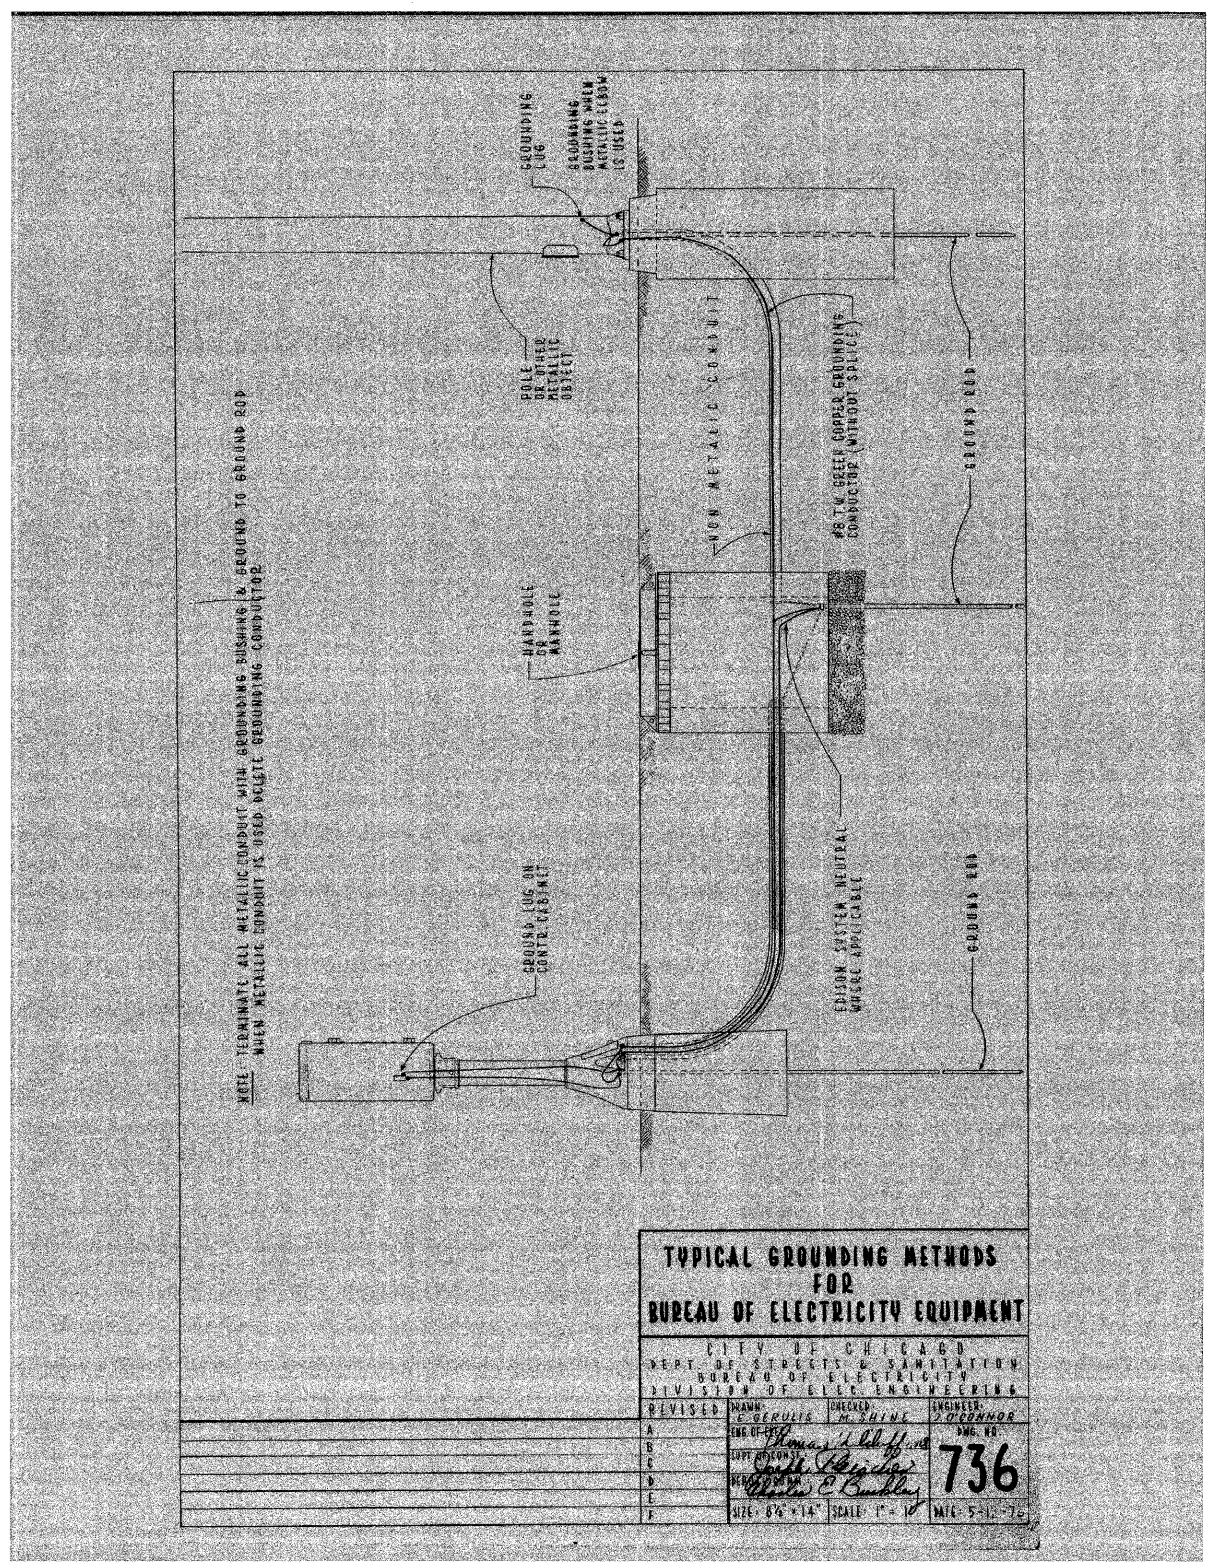

TYPICAL GROUNDING METHODS FOR BUREAU OF ELECTRICITY EQUIPMENT

CITY OF CHICAGO			
DEPT. OF STREETS & SANITATION			
BUREAU OF ELECTRICITY			
DIVISION OF ELEC. ENGINEERING			
REVISED	DRAWN	CHECKED	ENGINEER
A	W. E. HARR	J. J. CONNOR	J. J. CONNOR
B			
C			
D			
E			
F			
SIZE: 8 1/2 X 14"		SCALE: 1" = 10'	DATE: 5-1-76

REVISIONS	
NAME	DATE

ILLINOIS DEPARTMENT OF TRANSPORTATION
 112TH PLACE OVER
 F.A.I. ROUTE 57 (INTERSTATE 57)

ELECTRICAL STANDARD DETAILS

SCALE: NONE
 DATE: 01/16/09
 DRAWN BY: N/A
 CHECKED BY: N/A

TENG
 TENG & ASSOCIATES, INC.
 ENGINEERS, ARCHITECTS, PLANNERS
 225 N. MICHIGAN AVE., CHICAGO, IL 60601
 TELEPHONE: 312.7616-0000