


F.A.P. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
337	20R-6	LAKE	149	91
STA.		TO STA.		
FED. ROAD DIST. NO.		ILLINOIS	FED. AID PROJECT	

NOTES

Bar splicer assemblies shall be of an approved type and shall develop in tension at least 125 percent of the yield strength of the lapped reinforcement bars.
 Splicer rods shall be of minimum 60 ksi (413.7 MPa) yield strength, threaded or coiled full length.
 All reinforcement bars shall be lapped and tied to the splicer rods or dowel bars.
 Bar splicer assemblies shall be epoxy coated according to the requirements for reinforcement bars.
 Other systems of similar design may be submitted to the Engineer for approval. Approval shall be based on certified test results from an approved testing laboratory that the proposed bar splicer assembly satisfies the following requirements:


- ① Minimum Capacity = $1.25 \times f_y \times A_s$
(Tension in kips (kN))
 - ② Minimum *Pull-out Strength = $0.66 \times f_y \times A_s$
(Tension in kips (kN))
- Where f_y = Yield strength of lapped reinforcement bars in ksi (MPa).
 A_s = Tensile stress area of lapped reinforcement bars.
 * = 28 day concrete

BAR SPLICER ASSEMBLIES			
Bar Size to be Spliced	Splicer Rod or Dowel Bar Length	Strength Requirements	
		Min. Capacity kips - tension	Min. Pull-Out Strength kips - tension
#5 (#15)	2'-2" (660)	23.0 (102.3KN)	12.3 (54.7KN)

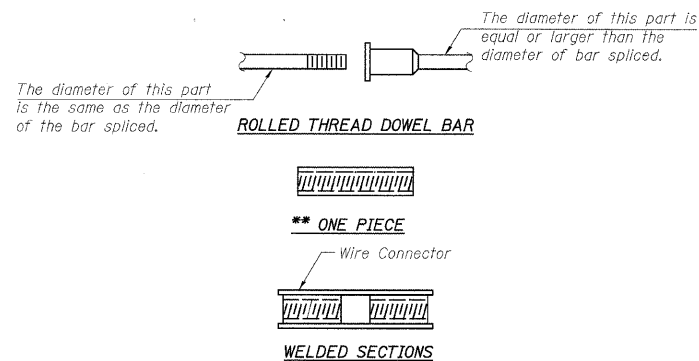


BAR SPLICER ASSEMBLY ALTERNATIVES

**Heavy Hex Nuts conforming to ASTM A 563, Grade C, D or DH may be used.

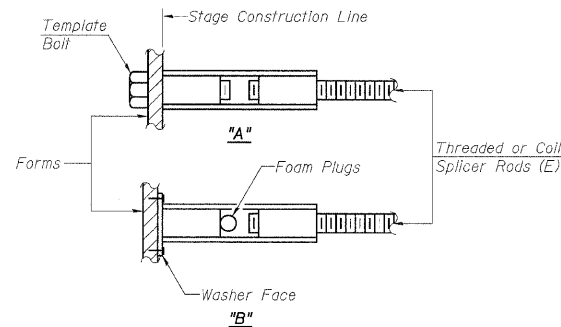


INSTALLATION AND SETTING METHODS

"A" : Set bar splicer assembly by means of a template bolt.
 "B" : Set bar splicer assembly by nailing to wood forms or cementing to steel forms.
 (E) : Indicates epoxy coating.

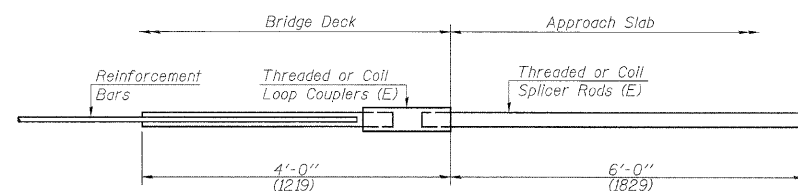


FOR INTEGRAL OR SEMI-INTEGRAL ABUTMENTS

Bar Splicer for #5 (#15) bar		
Min. Capacity =	23.0 kips (102.3 kN) - tension	
Min. Pull-out Strength =	12.3 kips (54.7 kN) - tension	
No. Required =		

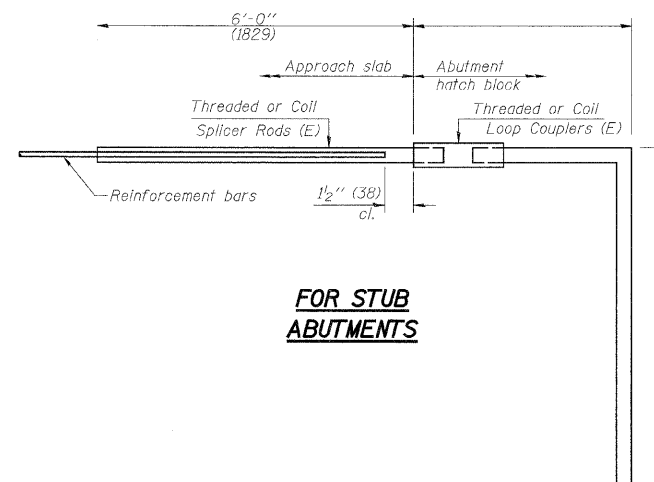

FOR STUB ABUTMENTS

Bar Splicer for #5 (#15) bar		
Min. Capacity =	23.0 (102.3 kN) kips - tension	
Min. Pull-out Strength =	12.3 kips (54.7 kN) - tension	
No. Required =		

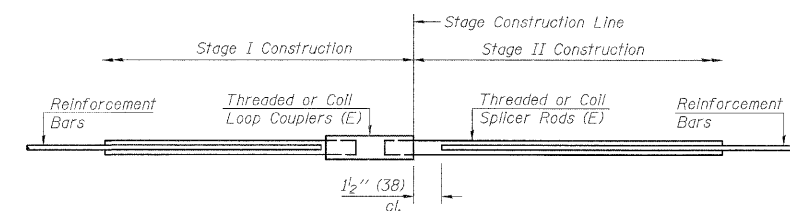

STANDARD

Bar Size	No. Assemblies Required	Location
#5 (#15)	18	Top Slab
#5 (#15)	22	Bottom Slab
#5 (#15)	15	Walls

REVISIONS		ILLINOIS DEPARTMENT OF TRANSPORTATION
NAME	DATE	
		BAR SPLICER ASSEMBLY DETAILS IL ROUTE 22 OVER INDIAN CREEK TRIBUTARY FAP 337 SECTION 20R-6 STRUCTURE NUMBER 049-0233 LAKE COUNTY STATION 104+951.34 SCALE: NONE DRAWN BY: E. MROTCZEK DATE: 1/28/2009 CHECKED BY: G. HATLESTAD

All dimensions shown in Parathesis () are in mm, except as noted.

P:\Lisle\1001\9171\AO\Drawings\STRUCT\Indian_Creek_Tributary\05_barsplacers.dgn
 2/5/2009 5:17:28 PM
 Hkoeppe@rdwy.lisle

