


McHENRY COUNTY
DIVISION OF TRANSPORTATION

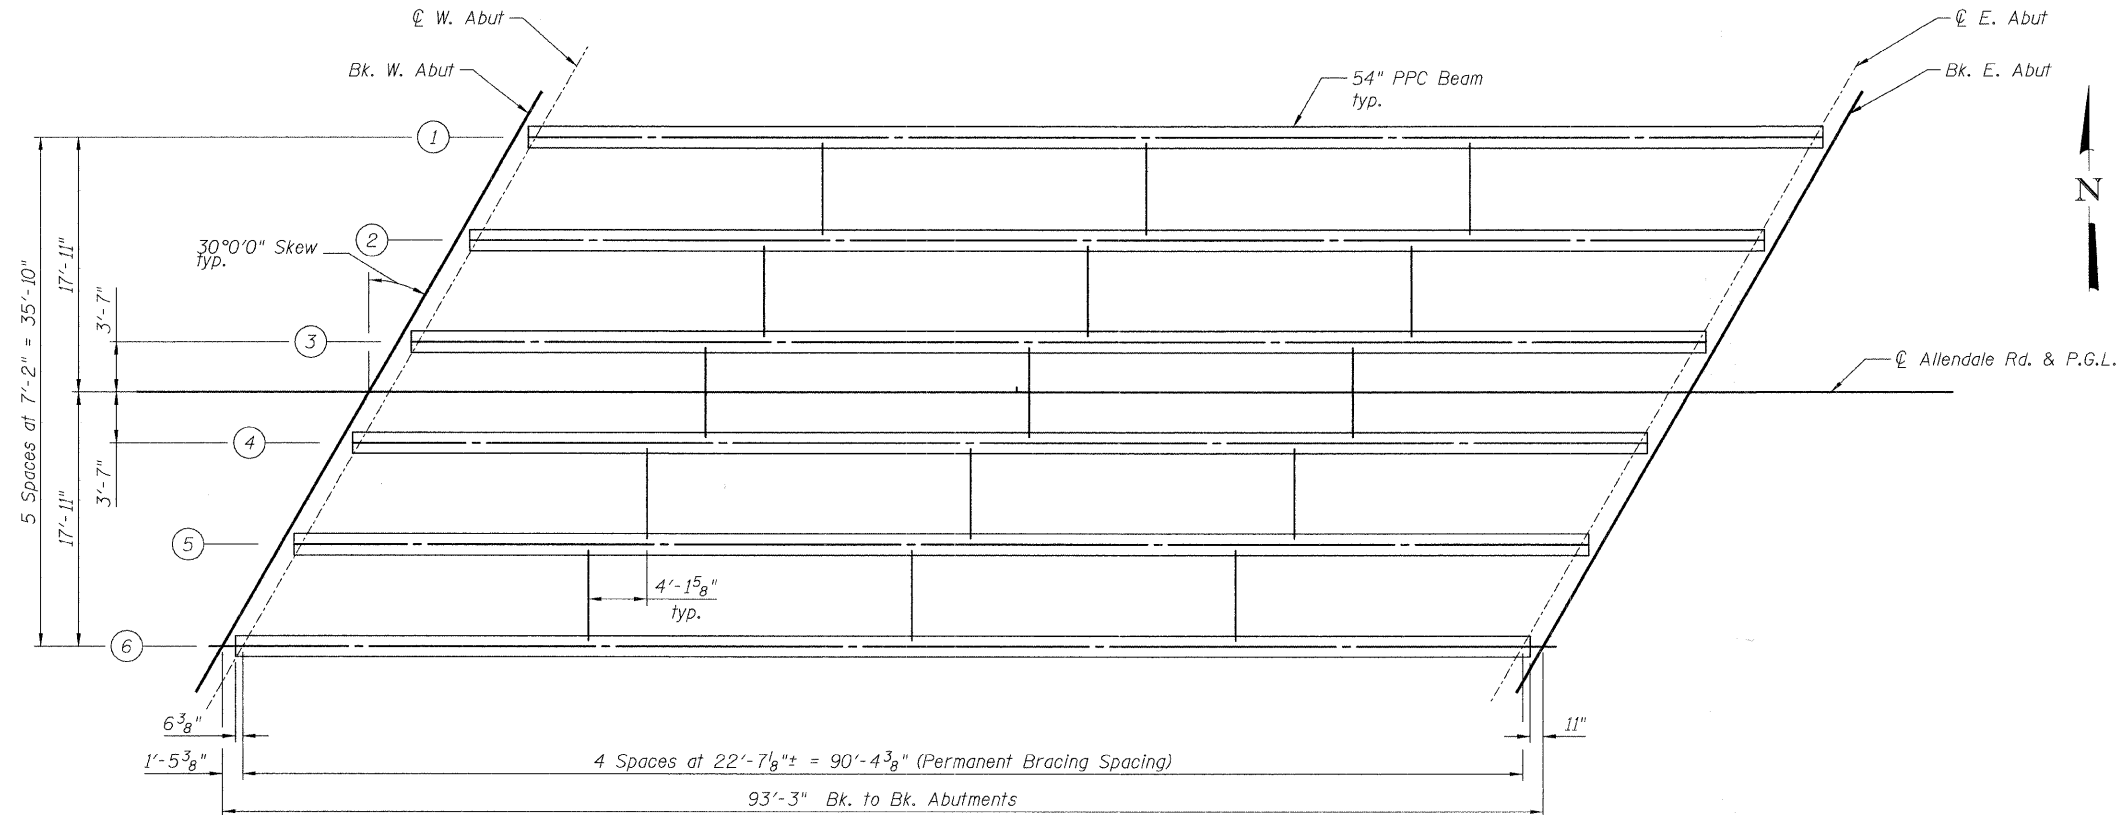


FRAMING PLAN

INTERIOR BEAM MOMENT TABLE		
0.5 Span		
I	(in ⁴)	213,715
I'	(in ⁴)	509,191
S_b	(in ³)	8,559
S_b'	(in ³)	12,802
S_t	(in ³)	7,362
S_t'	(in ³)	35,791
$DC1$	(k/ft)	1,372
M_{DC1}	(k)	1,400
$DC2$	(k/ft)	0.125
M_{DC2}	(k)	128
DW	(k/ft)	0.333
M_{DW}	(k)	340
$M_{\frac{1}{2} + IM}$	(k)	1,554

INTERIOR BEAM REACTION TABLE		
Abut.		
R_{DC1}	(k)	62.0
R_{DC2}	(k)	5.6
R_{DW}	(k)	15.1
$R_{\frac{1}{2} + IM}$	(k)	96.7
R_{Total}	(k)	179.4

- I : Non-composite moment of inertia of beam section (in⁴).
- I' : Composite moment of inertia of beam section (in⁴).
- S_b : Non-composite section modulus for the bottom fiber of the prestressed beam (in³).
- S_b' : Composite section modulus for the bottom fiber of the prestressed beam (in³).
- S_t : Non-composite section modulus for the top fiber of the prestressed beam (in³).
- S_t' : Composite section modulus for the top fiber of the prestressed beam (in³).
- $DC1$: Un-factored non-composite dead load (kips/ft.).
- M_{DC1} : Un-factored moment due to non-composite dead load (kip-ft.).
- $DC2$: Un-factored long-term composite (superimposed excluding future wearing surface) dead load (kips/ft.).
- M_{DC2} : Un-factored moment due to long-term composite (superimposed excluding future wearing surface) dead load (kip-ft.).
- DW : Un-factored long-term composite (superimposed future wearing surface only) dead load (kips/ft.).
- M_{DW} : Un-factored moment due to long-term composite (superimposed future wearing surface only) dead load (kip-ft.).
- $M_{\frac{1}{2} + IM}$: Un-factored live load moment plus dynamic load allowance (impact) (kip-ft.).

* Fabricator shall locate to miss strands within permissible tolerances.
 3/4" φ A307 Bolts with lock nuts. (Typ.)
 Bolts through the concrete web shall be tightened to snug tight only.

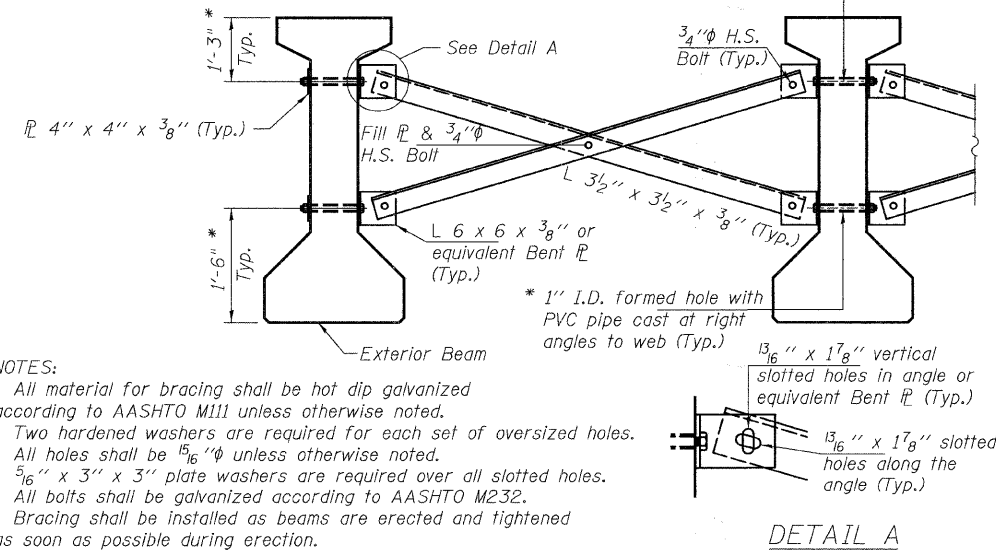

- NOTES:
- All material for bracing shall be hot dip galvanized according to AASHTO M111 unless otherwise noted.
 - Two hardened washers are required for each set of oversized holes.
 - All holes shall be 15/16" φ unless otherwise noted.
 - 5/16" x 3" x 3" plate washers are required over all slotted holes.
 - All bolts shall be galvanized according to AASHTO M232.
 - Bracing shall be installed as beams are erected and tightened as soon as possible during erection.
 - Permanent bracing will not be measured separately for payment, but shall be included in the cost of Furnishing and Erecting Precast Prestressed Beams of the type and size specified.

PERMANENT BRACING DETAILS FOR
48" AND 54" PPC I-BEAMS

DESIGNED	AMK
CHECKED	EKM
DRAWN	RD
CHECKED	EKM



Ciorba Group, Inc.
CONSULTING ENGINEERS
5507 North Cumberland Avenue, Suite 402 Chicago, Illinois 60656
Tel. 773.775.4009 Fax 773.775.4014 Email chicago@ciorba.com

FRAMING PLAN
STRUCTURE NO. 056-3173

SHEET NO. S-11 OF S-20 SHEETS	F.A. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
		05-00310-00-BR	McHENRY	44	27
	CONTRACT NO. 63114				
FED. ROAD DIST. NO.		ILLINOIS FED. AID PROJECT			

6.400000 / IN. 2/6/2009 rdmlsley NA:\PROJ\3335\Design\Structural\CAD\3335 11 Framing Plan.dgn