


SLOPE STEPS DETAIL
TYPICAL CROSS-SECTION EMBANKMENT
CONSTRUCTION ON SIDEHILL

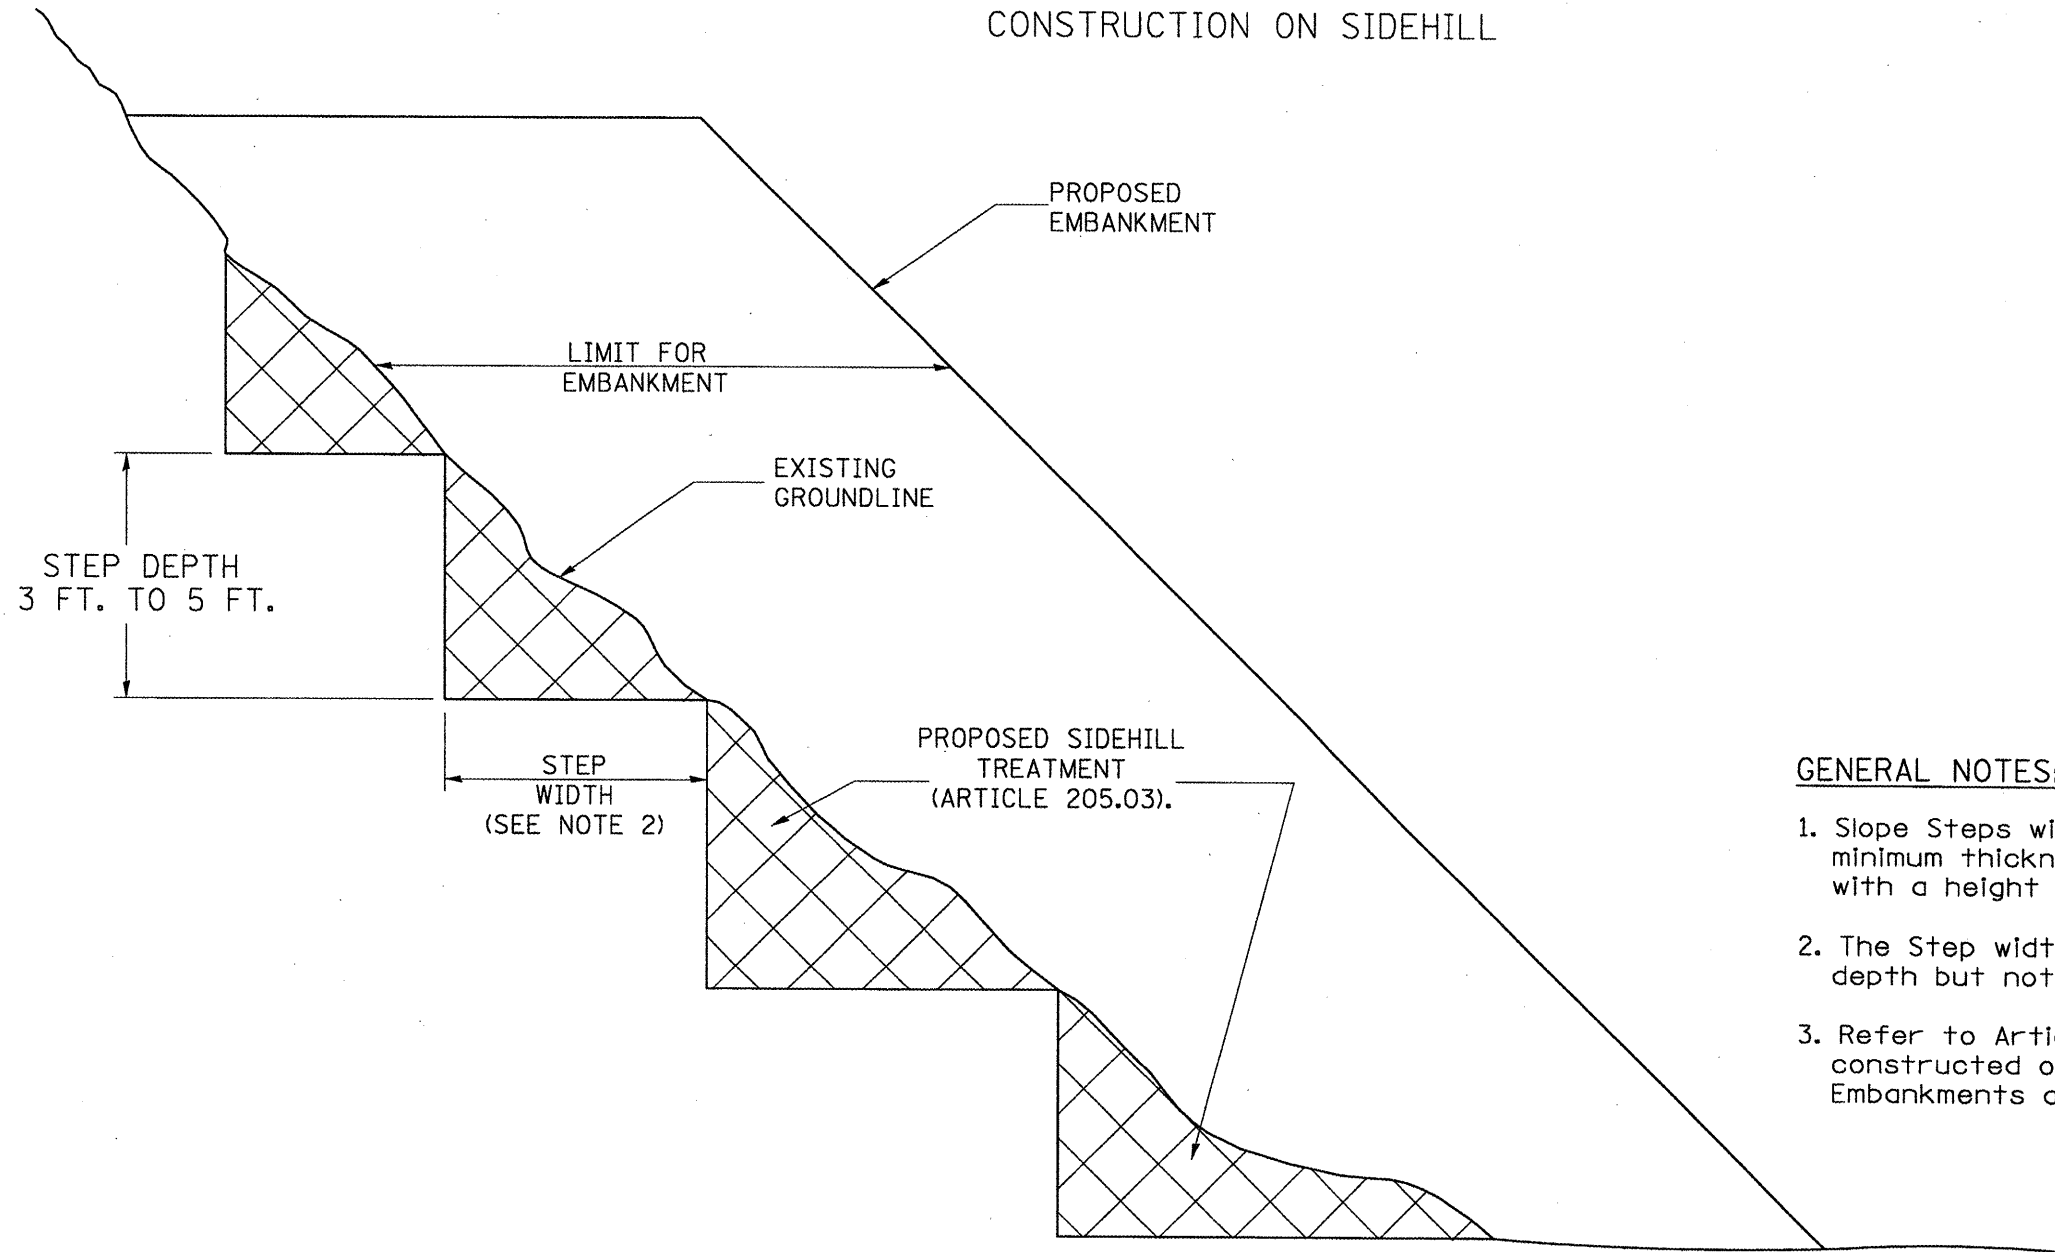

GENERAL NOTES:

1. Slope Steps will be required for all 12(300) minimum thickness "silver fills" and on a fills with a height of 10'(3.0m).
2. The Step width shall be twice the Step depth but not less than 6 feet.
3. Refer to Article 205.03 for Embankment to be constructed on Hillside or Slopes, or if existing Embankments are to be widened.

REPLACEMENT MATERIAL:



STANDARD EMBANKMENT
(IN ACCORDANCE WITH
205 OF THE STANDARD SPECIFICATION).

DESIGNER NOTE:

1. EACH PROJECT SHOULD BE REVIEWED INDEPENDENTLY FOR TREATMENT REQUIRED.
2. REFER TO THIS DETAIL WITH NOTE ON APPLICABLE TYPICAL SECTIONS.

All dimensions are in inches (millimeters) unless otherwise noted.

FILE NAME = ...D488773-ah-285801.dgn	USER NAME = _USER_	DATA 1-1-97	REVISED RENUM. L-5.03, NEW REVISION BOX, REVISED TITLE BOX,	BY T.P.
	PLOT SCALE = #SCALE#		REVISED GENERAL NOTES.	
	PLOT DATE = 2/19/2009 2:07:41 PM	10-16-06	REVISED TO 2007 SPEC.	M.A.

STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION

SLOPE STEPS DETAIL
COUNTY ROAD 8 (1900 E) OVER BRANCH OF HONEY CREEK

SCALE: NTS SHEET NO. OF SHEETS STA. TO STA.

F.A.P. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
665	1136,137W&RS-3;136R;109BR-2	Henderson	490	480
CADD STD 205001-04				CONTRACT NO. 88773
FED. ROAD DIST. NO. 4 ILLINOIS FED. AID PROJECT				