



RUNWAY 9-27

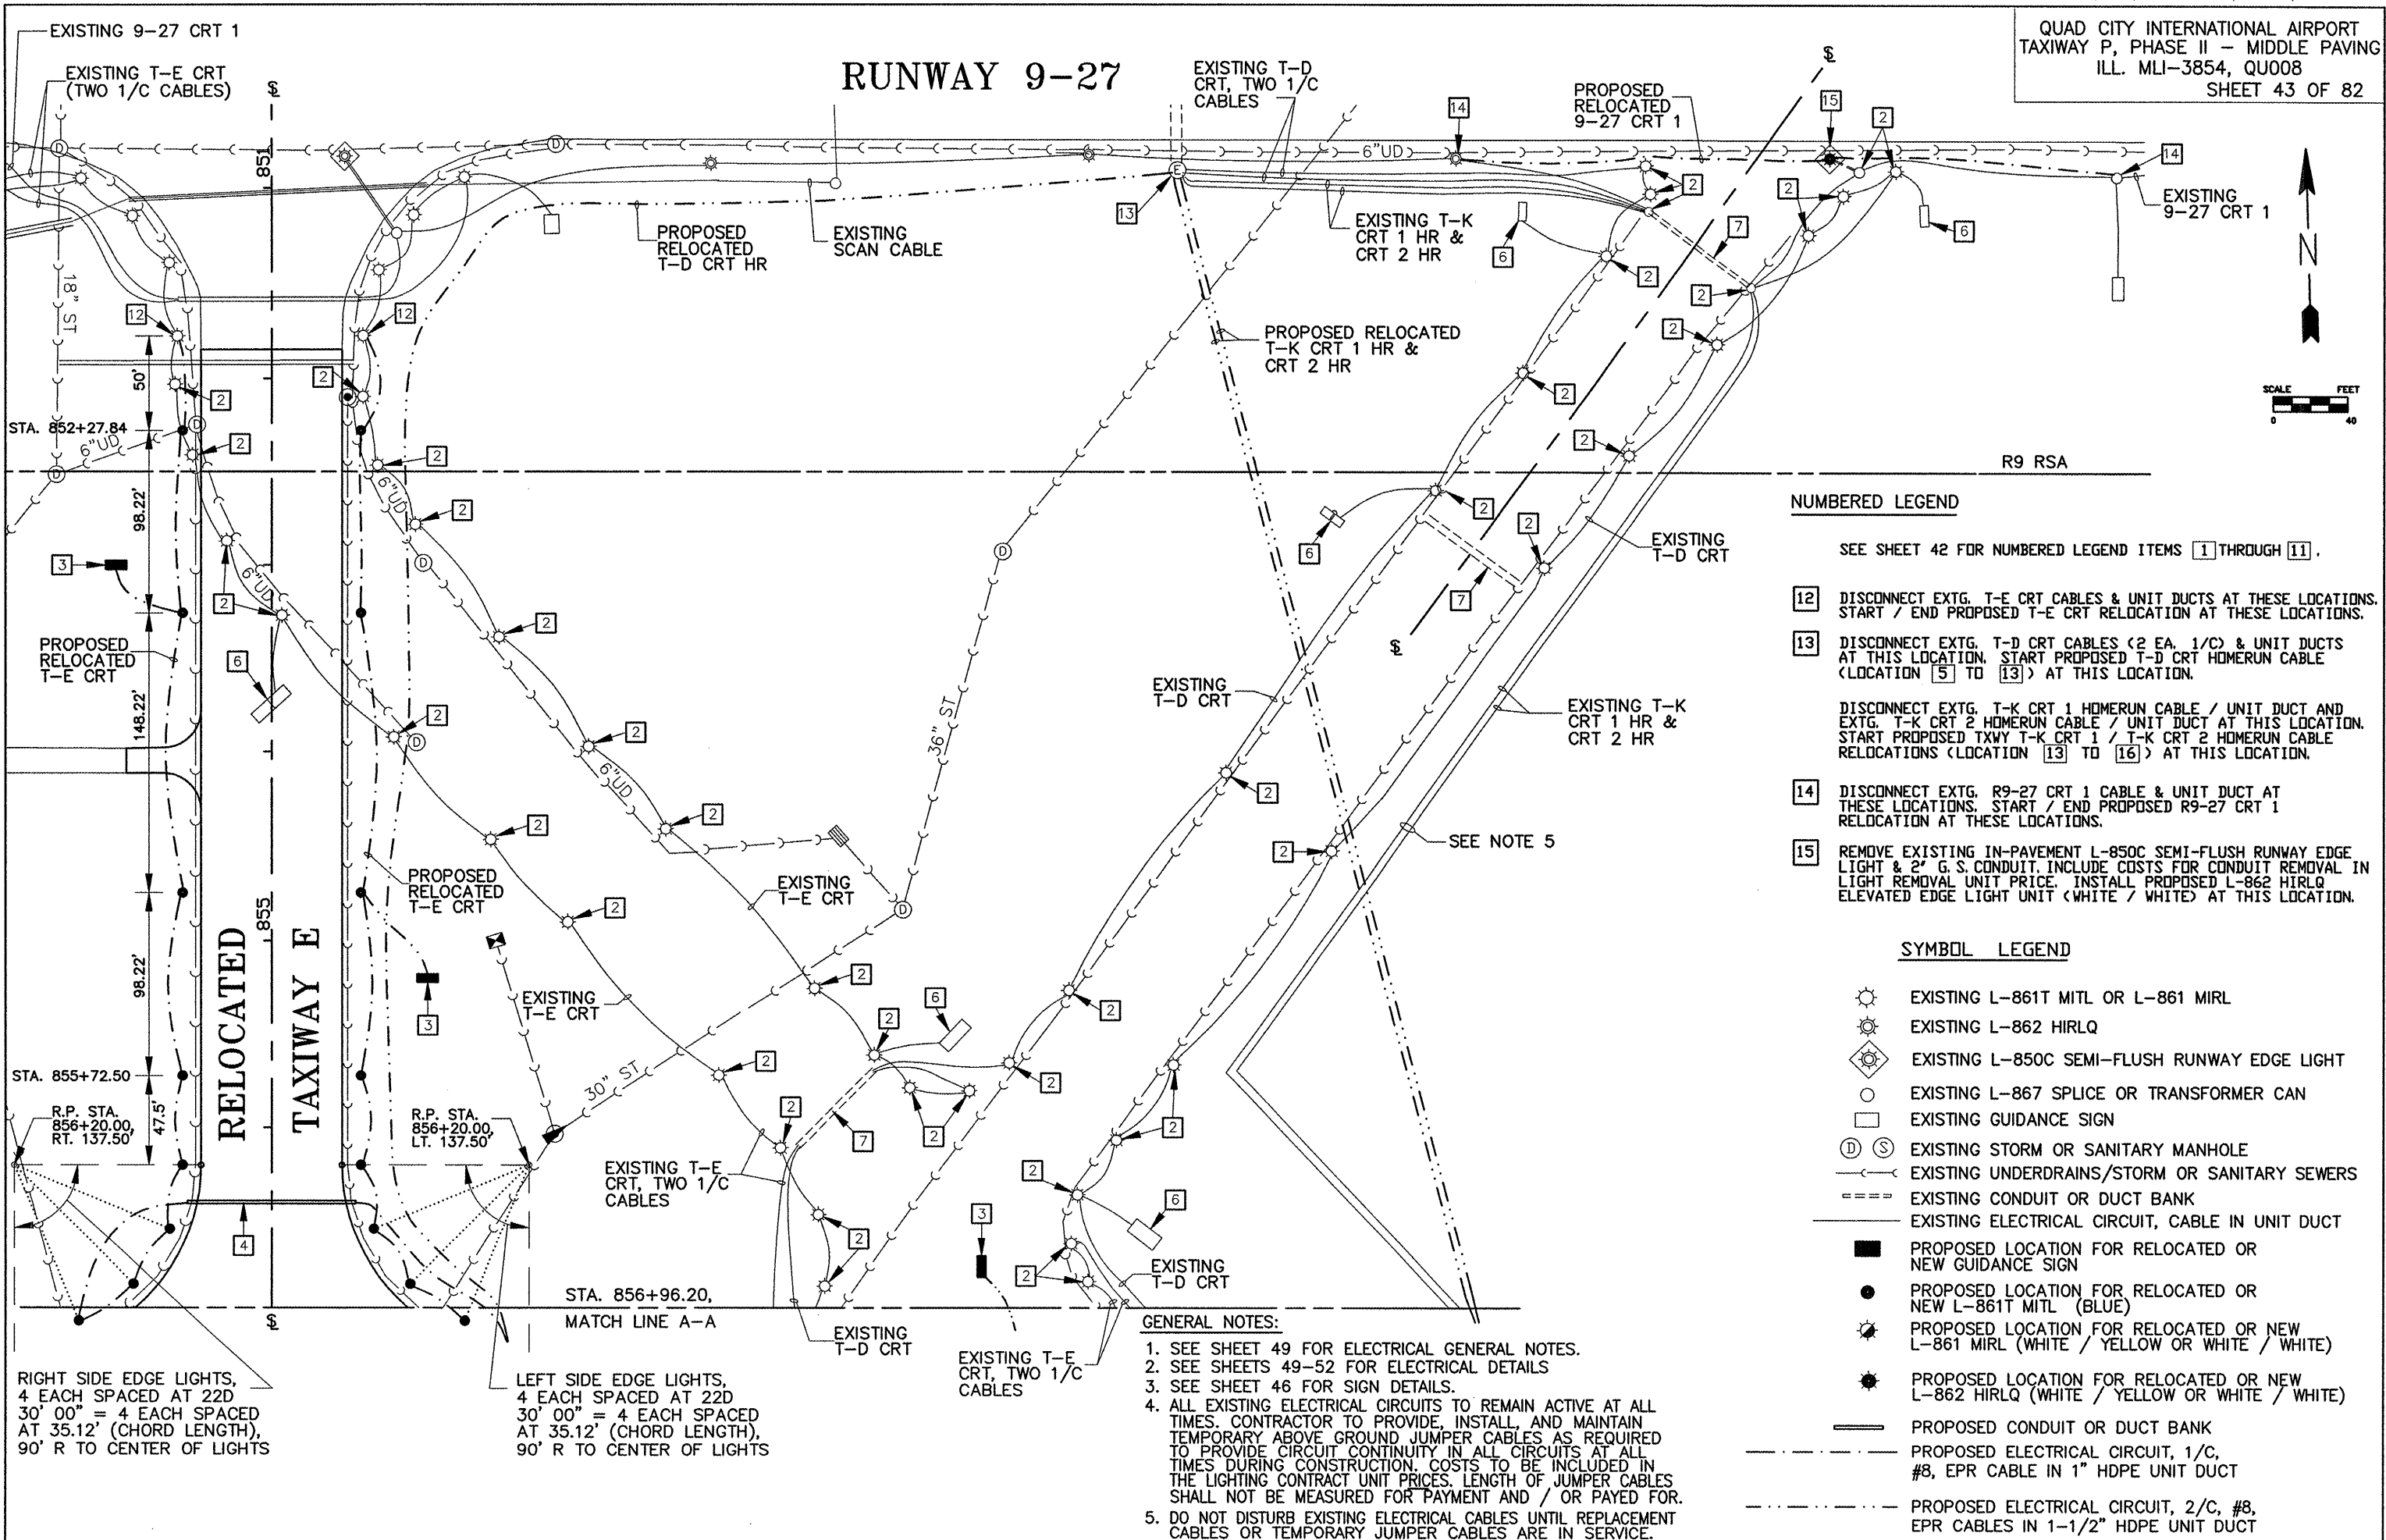

NUMBERED LEGEND

- SEE SHEET 42 FOR NUMBERED LEGEND ITEMS [1] THROUGH [11].
- [12] DISCONNECT EXTG. T-E CRT CABLES & UNIT DUCTS AT THESE LOCATIONS. START / END PROPOSED T-E CRT RELOCATION AT THESE LOCATIONS.
 - [13] DISCONNECT EXTG. T-D CRT CABLES (2 EA. 1/C) & UNIT DUCTS AT THIS LOCATION. START PROPOSED T-D CRT HOMERUN CABLE (LOCATION [5] TO [13]) AT THIS LOCATION.
 - DISCONNECT EXTG. T-K CRT 1 HOMERUN CABLE / UNIT DUCT AND EXTG. T-K CRT 2 HOMERUN CABLE / UNIT DUCT AT THIS LOCATION. START PROPOSED TXWY T-K CRT 1 / T-K CRT 2 HOMERUN CABLE RELOCATIONS (LOCATION [13] TO [16]) AT THIS LOCATION.
 - [14] DISCONNECT EXTG. R9-27 CRT 1 CABLE & UNIT DUCT AT THESE LOCATIONS. START / END PROPOSED R9-27 CRT 1 RELOCATION AT THESE LOCATIONS.
 - [15] REMOVE EXISTING IN-PAVEMENT L-850C SEMI-FLUSH RUNWAY EDGE LIGHT & 2" G. S. CONDUIT. INCLUDE COSTS FOR CONDUIT REMOVAL IN LIGHT REMOVAL UNIT PRICE. INSTALL PROPOSED L-862 HIRLQ ELEVATED EDGE LIGHT UNIT (WHITE / WHITE) AT THIS LOCATION.

SYMBOL LEGEND

- EXISTING L-861T MITL OR L-861 MIRL
- EXISTING L-862 HIRLQ
- EXISTING L-850C SEMI-FLUSH RUNWAY EDGE LIGHT
- EXISTING L-867 SPLICE OR TRANSFORMER CAN
- EXISTING GUIDANCE SIGN
- EXISTING STORM OR SANITARY MANHOLE
- EXISTING UNDERDRAINS/STORM OR SANITARY SEWERS
- EXISTING CONDUIT OR DUCT BANK
- EXISTING ELECTRICAL CIRCUIT, CABLE IN UNIT DUCT
- PROPOSED LOCATION FOR RELOCATED OR NEW GUIDANCE SIGN
- PROPOSED LOCATION FOR RELOCATED OR NEW L-861T MITL (BLUE)
- PROPOSED LOCATION FOR RELOCATED OR NEW L-861 MIRL (WHITE / YELLOW OR WHITE / WHITE)
- PROPOSED LOCATION FOR RELOCATED OR NEW L-862 HIRLQ (WHITE / YELLOW OR WHITE / WHITE)
- PROPOSED CONDUIT OR DUCT BANK
- PROPOSED ELECTRICAL CIRCUIT, 1/C, #8, EPR CABLE IN 1" HDPE UNIT DUCT
- PROPOSED ELECTRICAL CIRCUIT, 2/C, #8, EPR CABLES IN 1-1/2" HDPE UNIT DUCT

GENERAL NOTES:

1. SEE SHEET 49 FOR ELECTRICAL GENERAL NOTES.
2. SEE SHEETS 49-52 FOR ELECTRICAL DETAILS
3. SEE SHEET 46 FOR SIGN DETAILS.
4. ALL EXISTING ELECTRICAL CIRCUITS TO REMAIN ACTIVE AT ALL TIMES. CONTRACTOR TO PROVIDE, INSTALL, AND MAINTAIN TEMPORARY ABOVE GROUND JUMPER CABLES AS REQUIRED TO PROVIDE CIRCUIT CONTINUITY IN ALL CIRCUITS AT ALL TIMES DURING CONSTRUCTION. COSTS TO BE INCLUDED IN THE LIGHTING CONTRACT UNIT PRICES. LENGTH OF JUMPER CABLES SHALL NOT BE MEASURED FOR PAYMENT AND / OR PAYED FOR.
5. DO NOT DISTURB EXISTING ELECTRICAL CABLES UNTIL REPLACEMENT CABLES OR TEMPORARY JUMPER CABLES ARE IN SERVICE.

RIGHT SIDE EDGE LIGHTS,
4 EACH SPACED AT 22D
30' 00" = 4 EACH SPACED
AT 35.12' (CHORD LENGTH),
90' R TO CENTER OF LIGHTS

LEFT SIDE EDGE LIGHTS,
4 EACH SPACED AT 22D
30' 00" = 4 EACH SPACED
AT 35.12' (CHORD LENGTH),
90' R TO CENTER OF LIGHTS