




s:\projects\3009 1-90_cumberland-patrick-work\disciplines\electrical\sheet\DI60J14-sht-light.06.dgn


2/18/2013 2:43:23 PM

2/18/2013

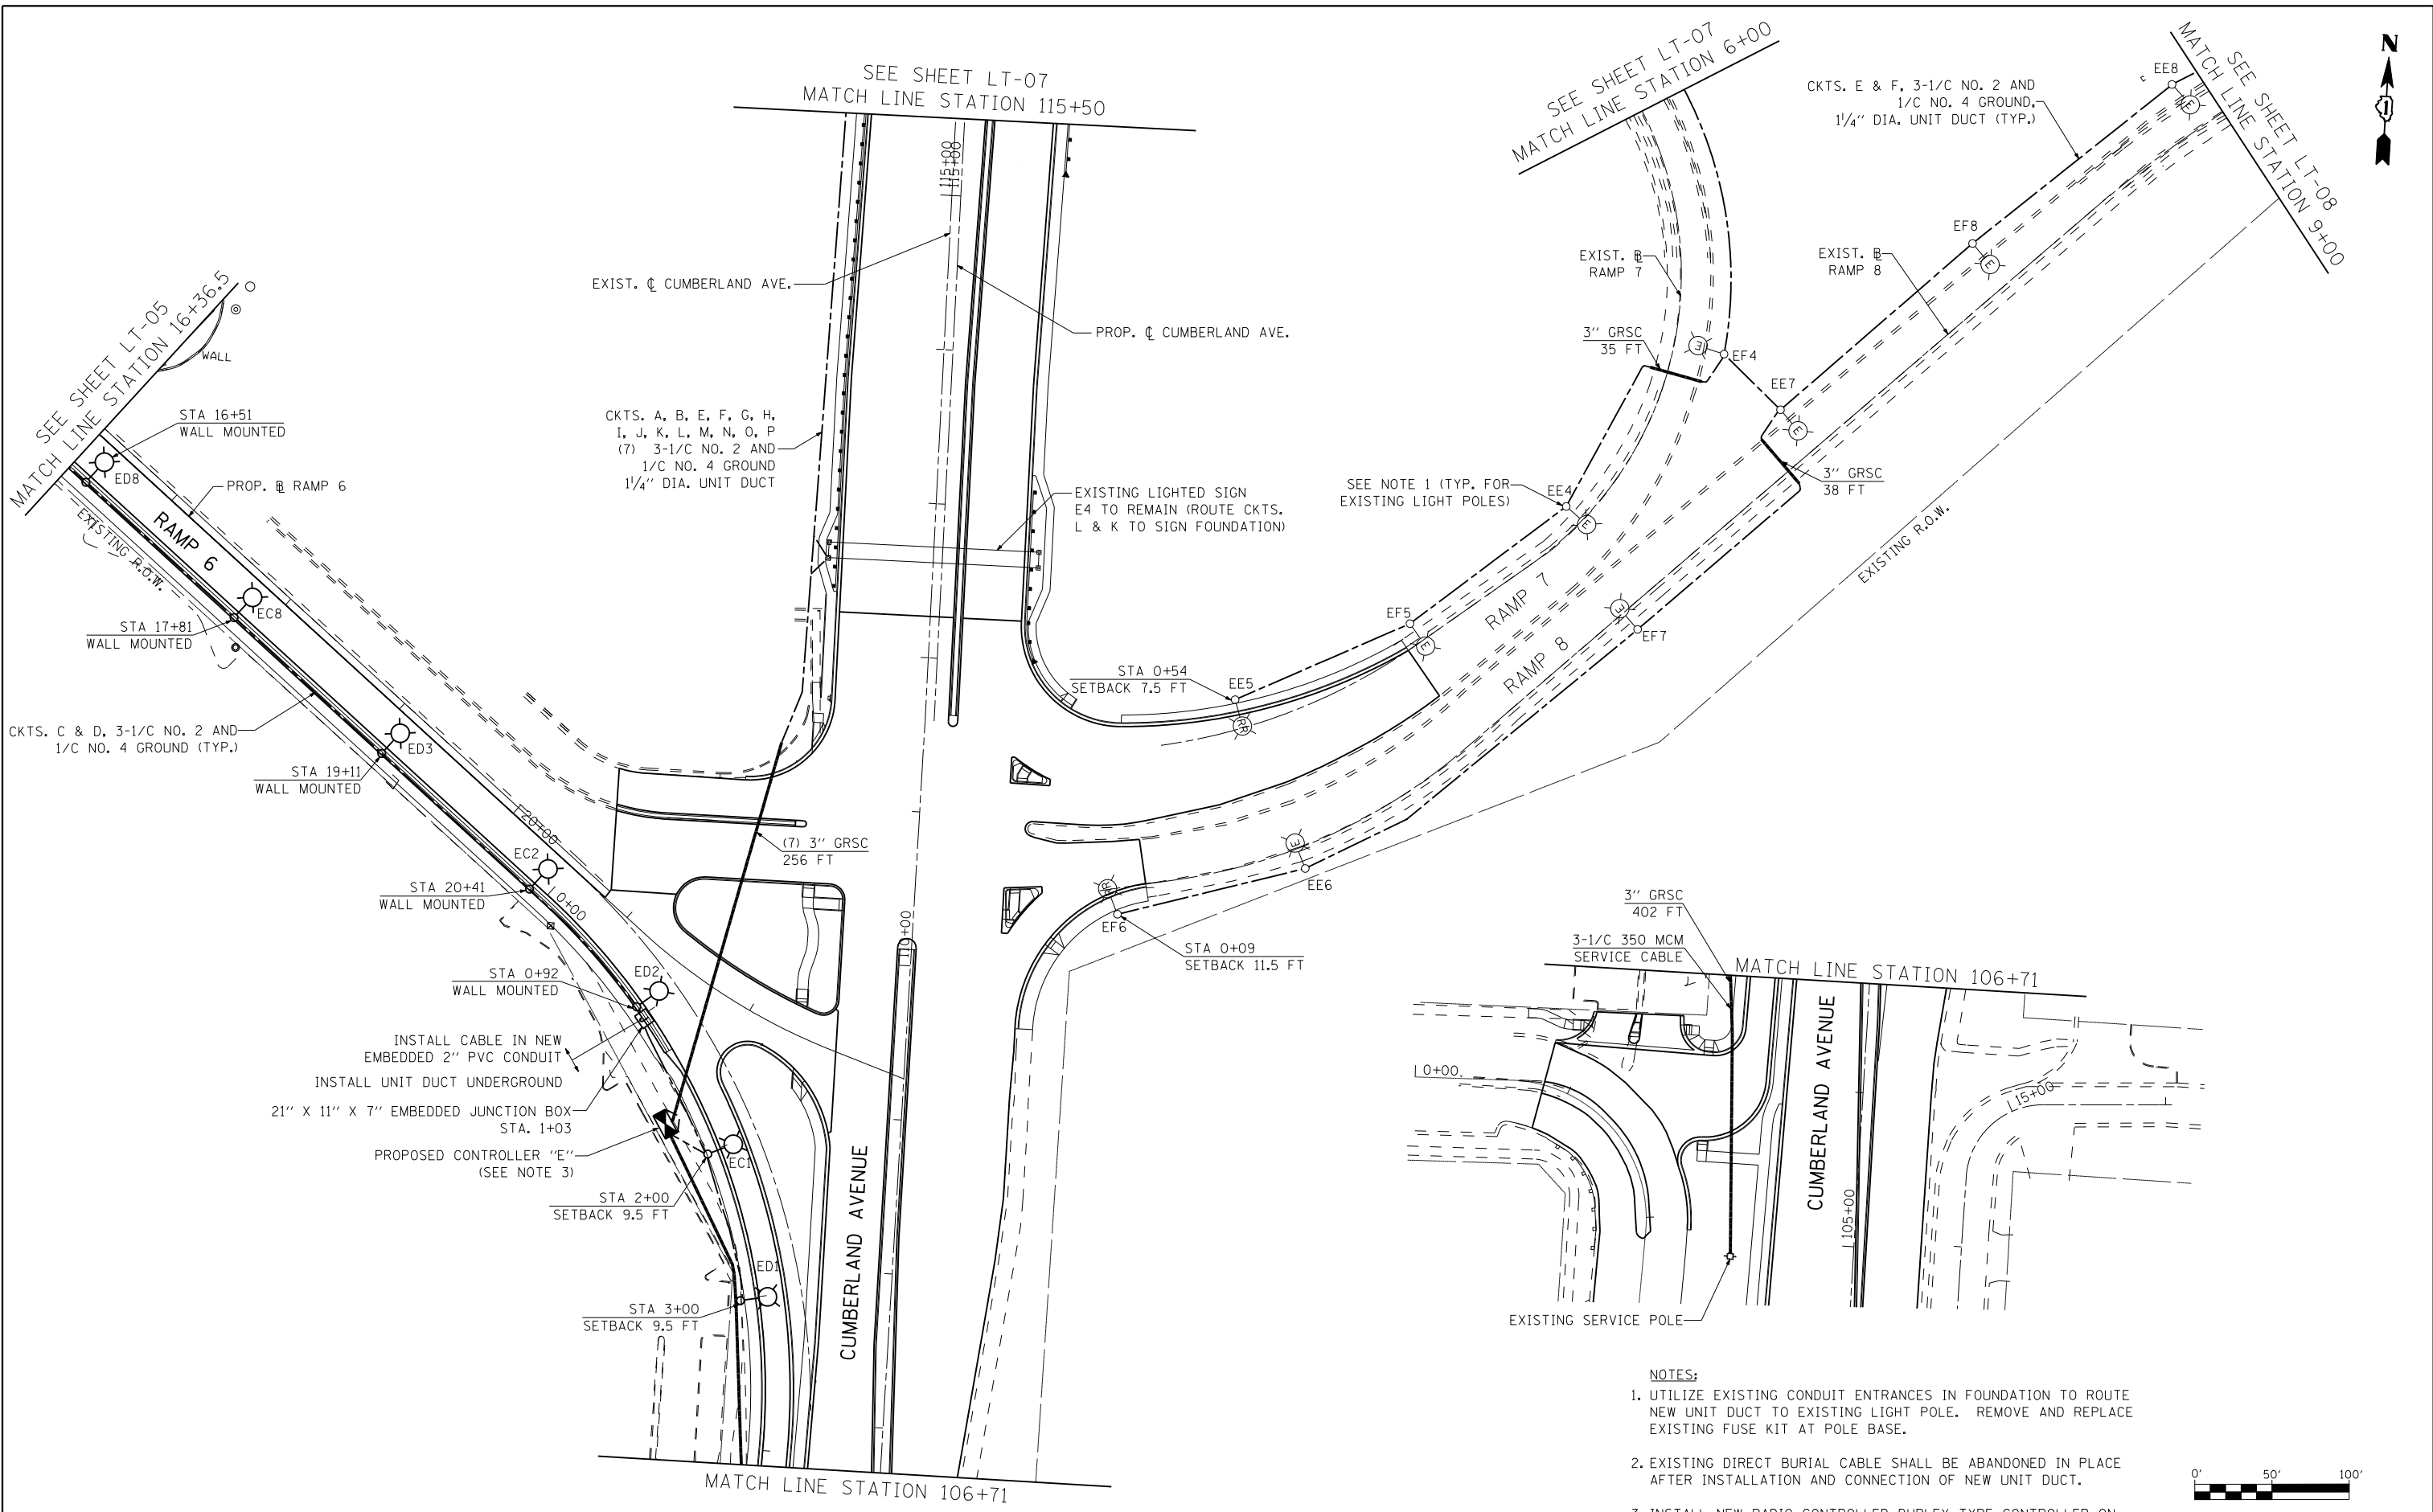

INSTALL CABLE IN NEW EMBEDDED 2" PVC CONDUIT
 INSTALL UNIT DUCT UNDERGROUND
 21" X 11" X 7" EMBEDDED JUNCTION BOX STA. 1+03
 PROPOSED CONTROLLER "E" (SEE NOTE 3)

- NOTES:**
- UTILIZE EXISTING CONDUIT ENTRANCES IN FOUNDATION TO ROUTE NEW UNIT DUCT TO EXISTING LIGHT POLE. REMOVE AND REPLACE EXISTING FUSE KIT AT POLE BASE.
 - EXISTING DIRECT BURIAL CABLE SHALL BE ABANDONED IN PLACE AFTER INSTALLATION AND CONNECTION OF NEW UNIT DUCT.
 - INSTALL NEW RADIO CONTROLLED DUPLEX TYPE CONTROLLER ON EXISTING FOUNDATION.



USER NAME =	DESIGNED - RAS	REVISED -
	DRAWN - RAS	REVISED -
PLOT SCALE =	CHECKED - MKR	REVISED -
PLOT DATE =	DATE - 2/18/2013	REVISED -



**STATE OF ILLINOIS
 DEPARTMENT OF TRANSPORTATION**

**PROPOSED IDOT LIGHTING PLAN
 I-90 AT CUMBERLAND AVENUE**

SCALE: 1" = 50' SHEET NO. 2 OF 6 SHEETS STA. 106+71 TO STA. 115+50

F.A.U. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
2746	1616B	COOK	404	238
CONTRACT NO. 60J14				
ILLINOIS FED. AID PROJECT				

LT-06