






**NOTES:**

1. ALL CONDUIT TO BE PVC SCHEDULE 40, UNLESS NOTED OTHERWISE. SIZE AS NOTED.
2. ALL LIGHT POLE FOUNDATIONS SHALL BE INSTALLED MINIMUM 3 FT FROM THE FACE OF CURB.
3. REFER TO DOEO STANDARD DRAWING 826 FOR SYMBOLS.
4. THE CONTRACTOR SHALL MAKE HIS OWN INVESTIGATION TO DETERMINE THE EXACT LOCATION OF ALL UTILITY LINES AND APPURTENANCES WITHIN THE LIMITS OF THIS IMPROVEMENT. THE COST OF THIS WORK WILL BE CONSIDERED INCIDENTAL TO THE CONTRACT.

**KEY:**

- A - INSTALL 24"x7", 1 1/4" A.R., FOUNDATION, 15" B.C. AS PER DOEO STANDARD DRAWING NO. 818 (RELOCATED LIGHT POLE FOUNDATION)

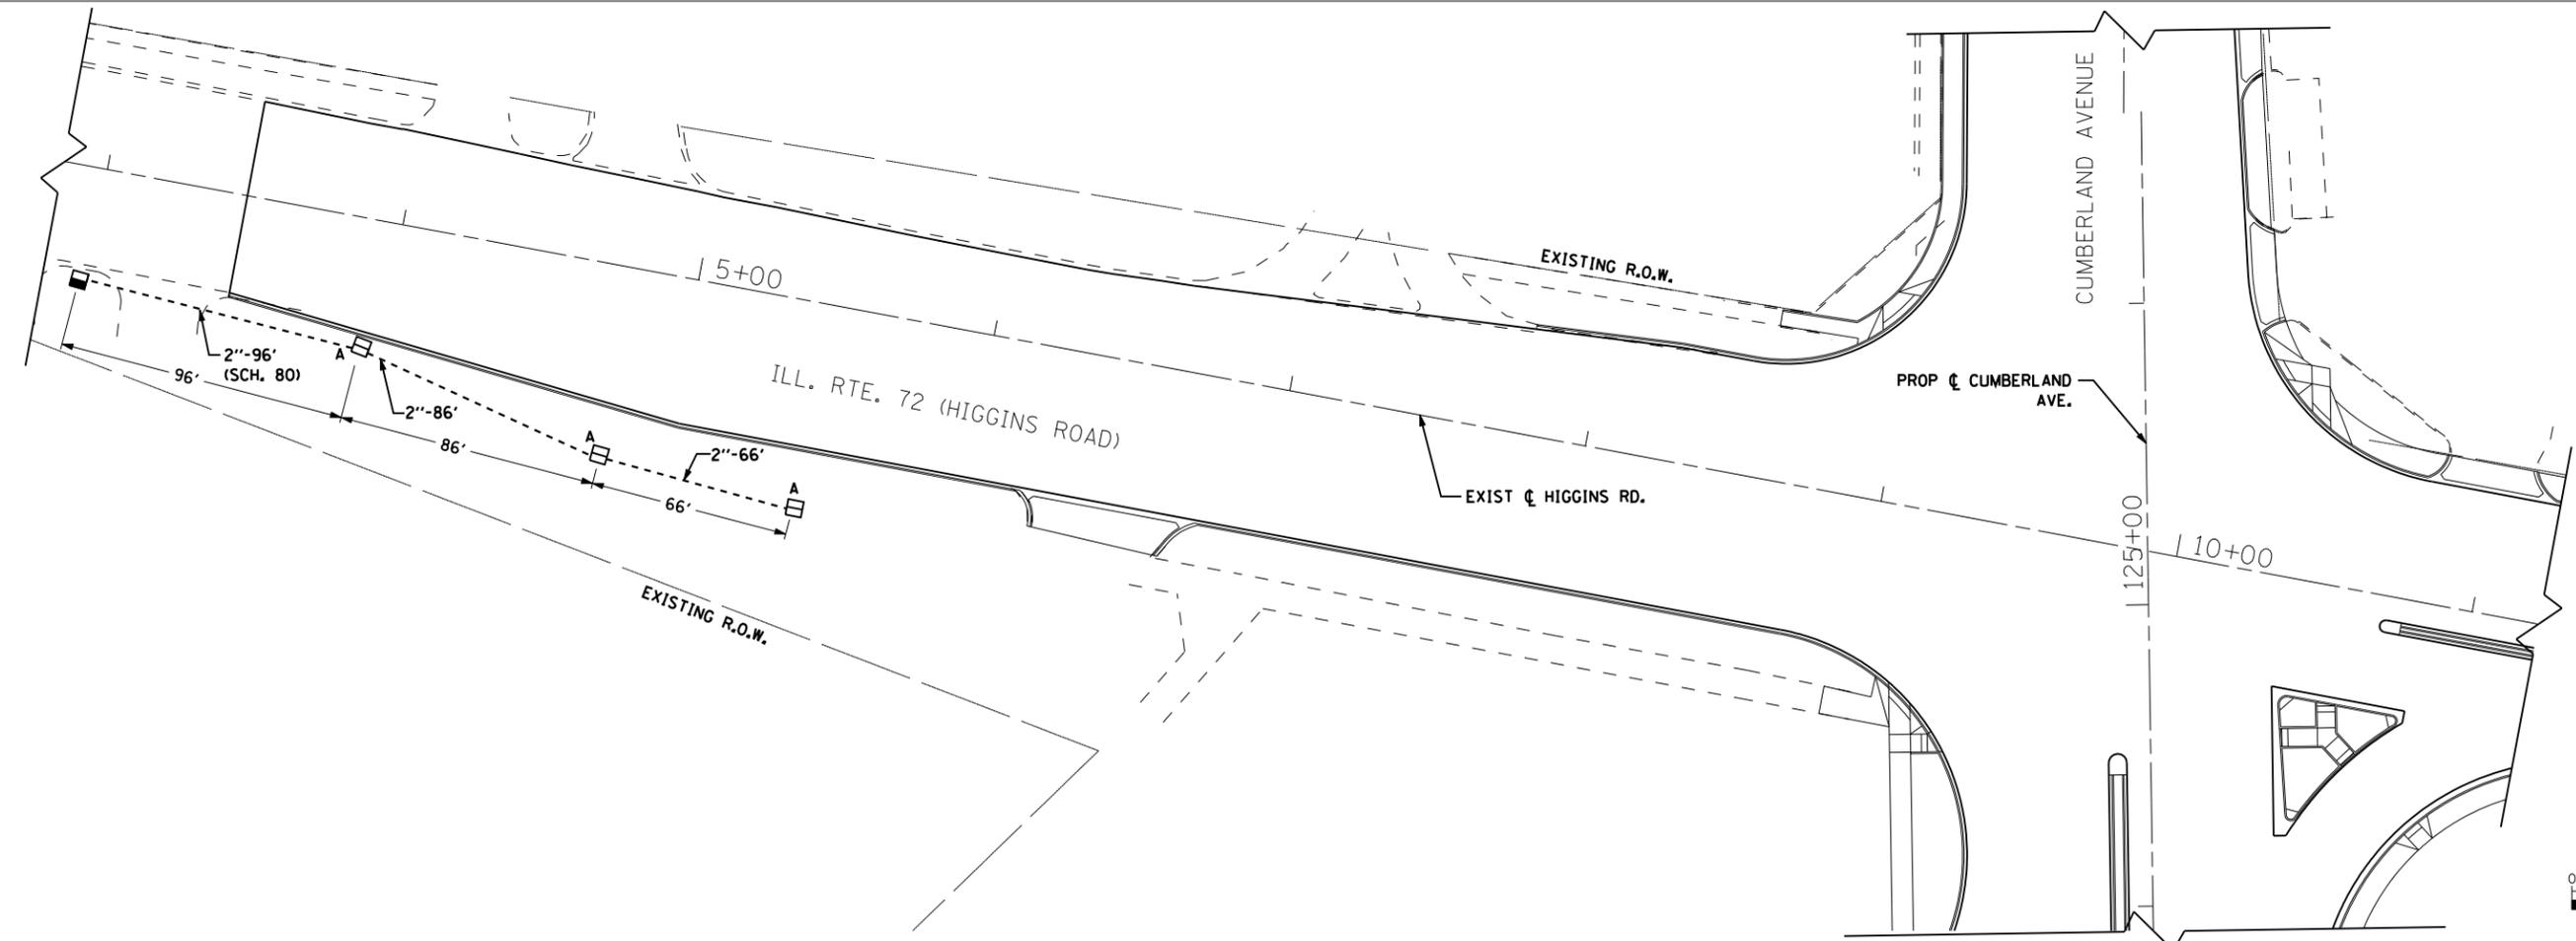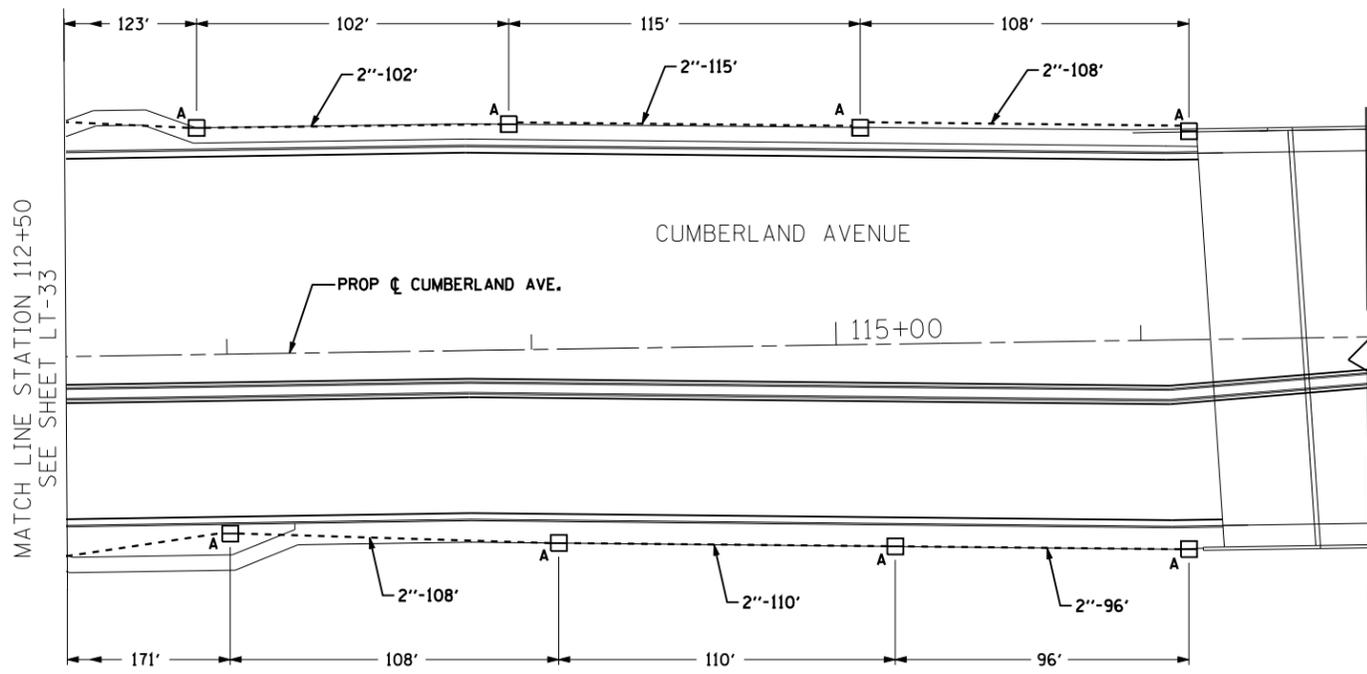

s:\projects\3009 1-90\_cumberland-patrick\project work\disciplines\electrical\sheet\DI60J14-sht-light-34.dgn  
 2/18/2013 2:43:47 PM

USER NAME =	DESIGNED - RAS	REVISED -
	DRAWN - RAS	REVISED -
PLOT SCALE =	CHECKED - MKR	REVISED -
PLOT DATE =	DATE - 2/18/2013	REVISED -



**STATE OF ILLINOIS**  
**DEPARTMENT OF TRANSPORTATION**

<b>CDOT ROADWAY LIGHTING FOUNDATION AND UNDERGROUND FACILITIES PLAN</b>	
<b>CUMBERLAND AVENUE</b>	
SCALE: 1" = 30'	SHEET NO. 3 OF 3 SHEETS
STA.	TO STA.

F.A.U. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
2746	1616B	COOK	404	266
CONTRACT NO. 60J14				
ILLINOIS FED. AID PROJECT				

LT-34