



**NOTES:**

1. SEE DRAWING E-1 FOR ELECTRICAL SYMBOL LIST AND ABBREVIATIONS. SEE DRAWING E-2 FOR ELECTRICAL GENERAL NOTES.
2. AERIAL CABLE MUST HAVE A MINIMUM CLEARANCE OF 20'-0" TO GRADE AT ALL LOCATIONS.
3. CONTRACTOR HAS THE OPTION TO SUBSTITUTE THE UNIT DUCT WITH ELECTRIC CABLE IN CONDUIT. NO ADDITIONAL PAYMENT WILL BE ALLOWED FOR ANY ADDITIONAL MATERIALS AS A RESULT OF THIS SUBSTITUTION.

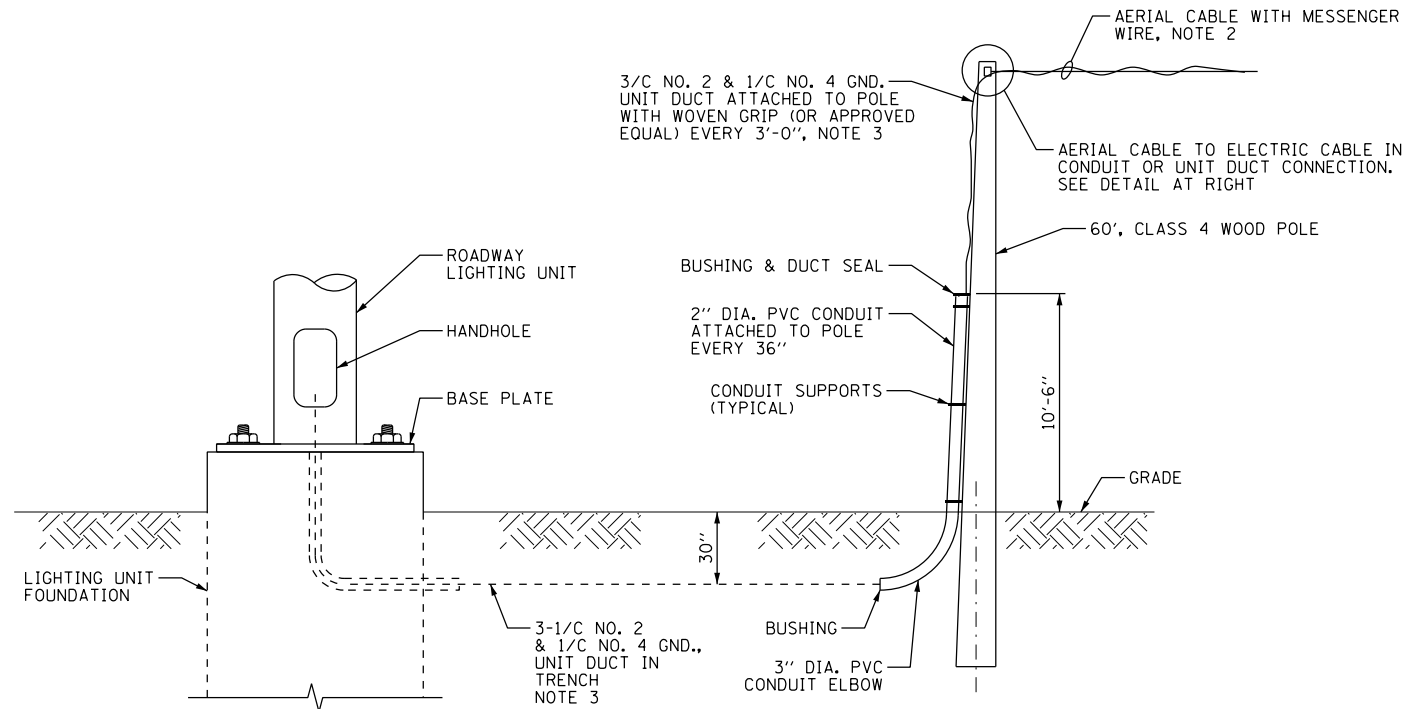

**WOOD POLE TO ROADWAY LIGHTING UNIT  
WIRING CONNECTION DETAIL**  
N.T.S.

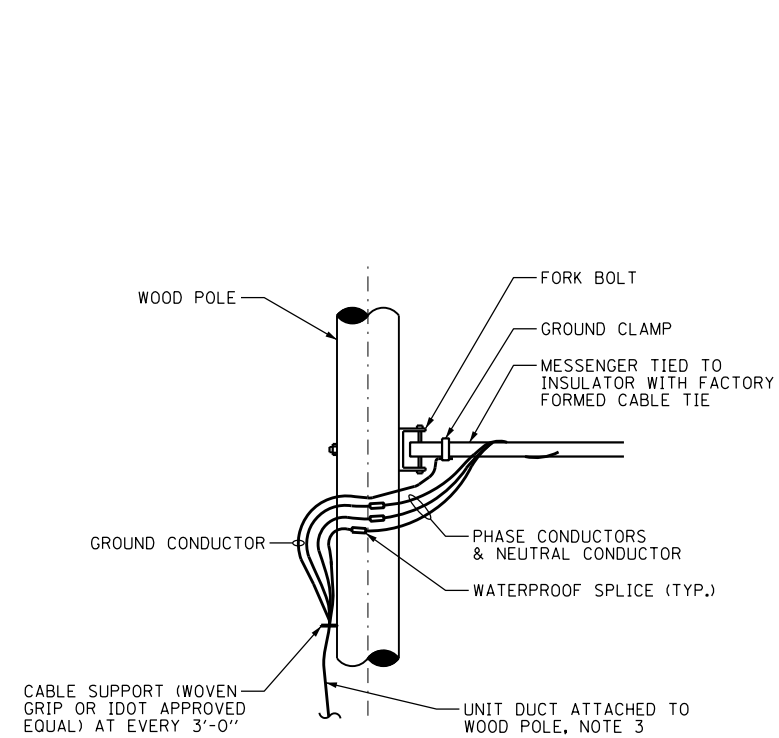

**AERIAL CABLE TO ELECTRIC  
CABLE ASSEMBLY CONNECTION DETAIL**  
N.T.S.

FILE NAME = D160M62-SHT-E45.dgn	USER NAME = Anthony.Plutz	DESIGNED - MAE	REVISED -
SHT.PLAN	PLOT SCALE = 2.0000' / in.	DRAWN - WM	REVISED -
	PLOT DATE = 3/13/2013	CHECKED - DAD	REVISED -
		DATE - 03/13/13	REVISED -

F.A.P. RTE. 330	SECTION 103R-5	COUNTY COOK	TOTAL SHEETS 778	SHEET NO. 369
<b>E-45</b>			CONTRACT NO. 60M62	
ILLINOIS FED. AID PROJECT				