

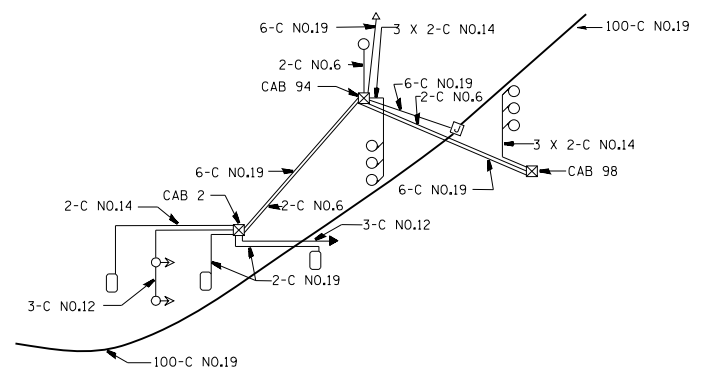


- INDUCTION LOOP
- ROUND INDUCTION LOOP
- ⊠ TSC CABINET
- △ TELEPHONE SERVICE
- SERVICE INSTALLATION
- ⊠ JUNCTION BOX
- HEAVY DUTY HAND HOLE
- P-DUCT
- - - GS-CONDUIT
- (E) EXISTING
- (P) PROPOSED
- ⊠ INSTALL
- ▶ FLASHER
- RAMP METERING

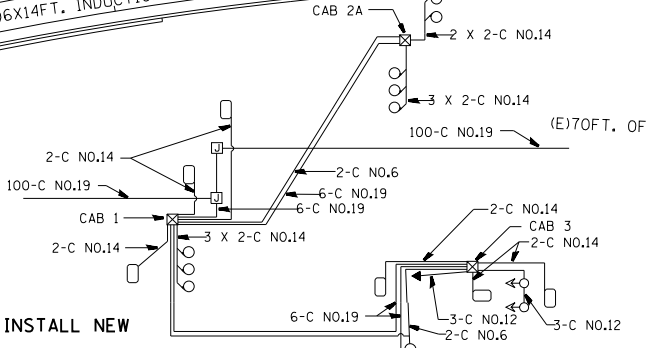

WIRING DIAGRAM

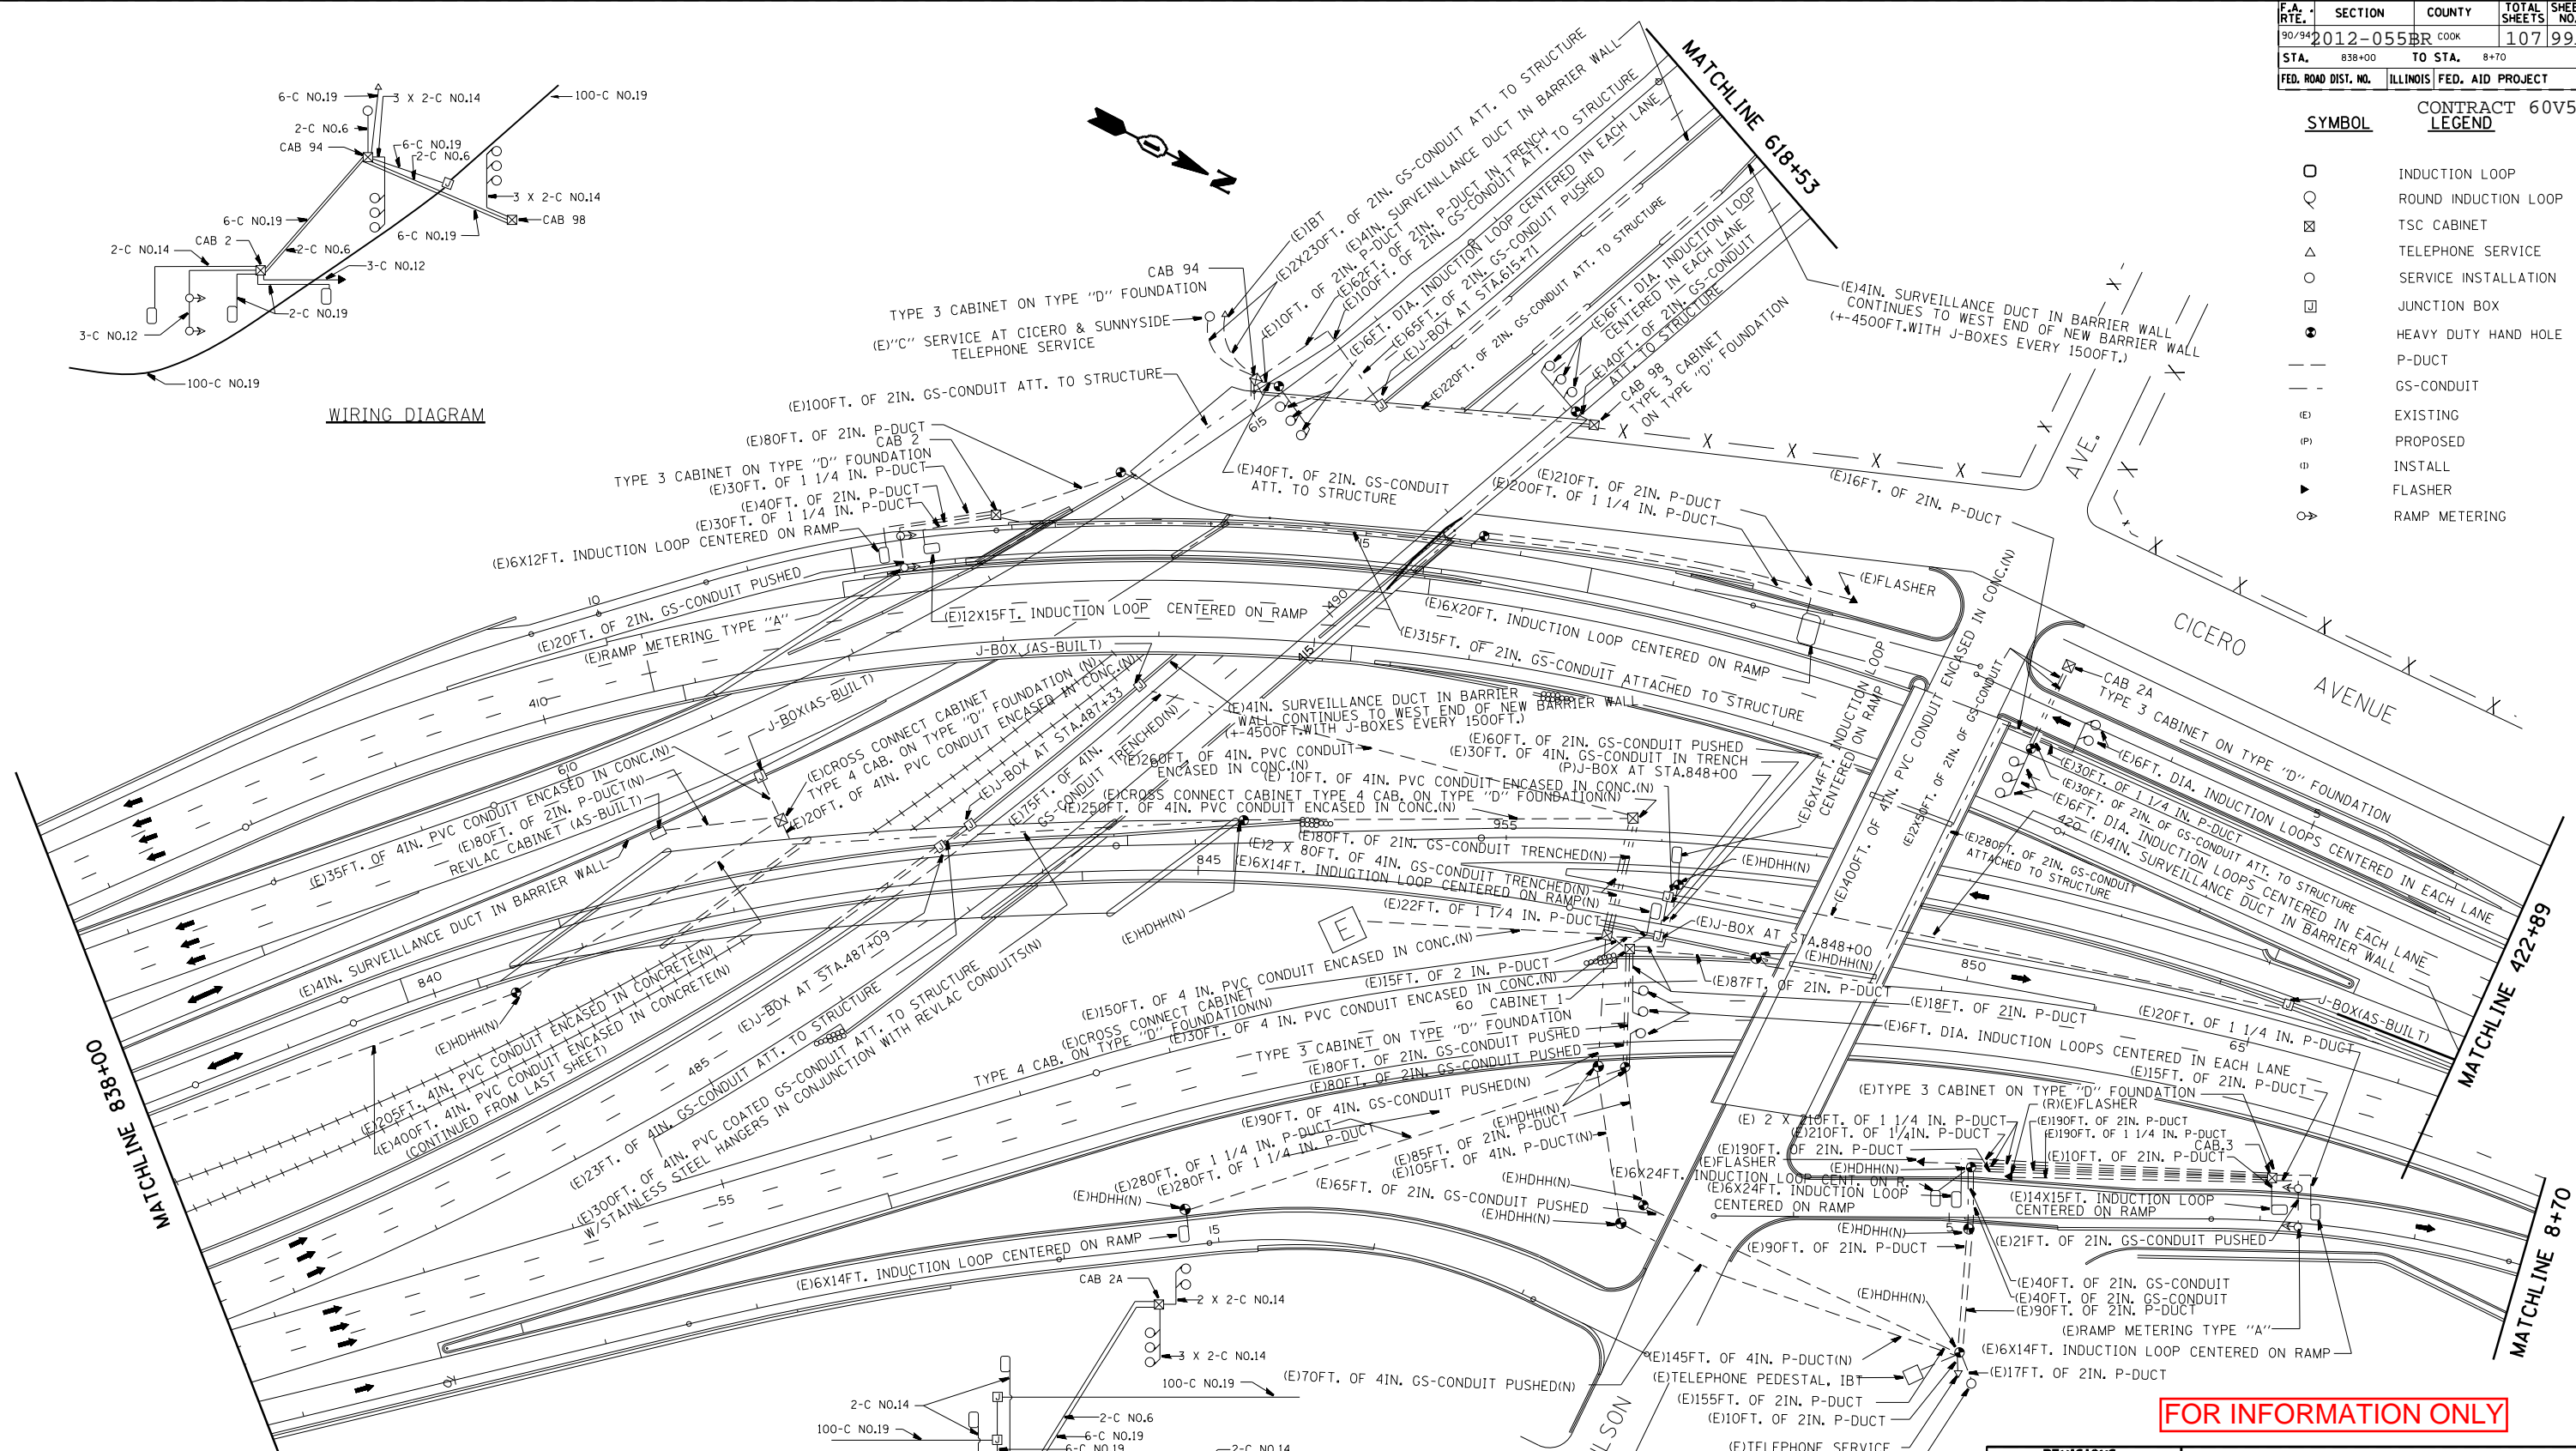

WIRING DIAGRAM

- NOTES:**
- 1.- REMOVE AND RELOCATE FLASHER AS SHOWN ON PLANS.
 - 2.- ABANDON LOOP 1 & INSTALL NEW LOOP 1 AS SHOWN, INTERCEPT EXISTING HANDHOLE & INSTALL NEW CONDUIT TO CABINET, SPLICE LOOP & LEAD IN IN HANDHOLE.
 - 3.- INTERCEPT HANDHOLE FOR FLASHER & RUN NEW CONDUIT 1/4 IN. TO CABINET.
 - 4.- PULL BACK TELEPHONE & POWER CABLES INTO HANDHOLE TO BE REINSTALLED IN NEW 2IN. AND EXISTING 2IN. P-DUCT TO CONTROL CABINET.
 - 5.- ABANDON EXISTING LOOP 1 DUCT RUN.

FOR INFORMATION ONLY

REVISIONS	
NAME	DATE
SURVEILLANCE	5-03-94
SURVEILLANCE	7-12-94
R.L.	10-3-95

ILLINOIS DEPARTMENT OF TRANSPORTATION
 TRAFFIC SYSTEMS CENTER
 KENNEDY
WILSON AVENUE
EDENS-KENNEDY JUNCTION
 SCALE: VERT. 50:1
 HORIZ. 50:1
 DATE 5-02-94
 DRAWN BY G.M.
 CHECKED BY T.C.