





ROUTE NO.	SECTION	COUNTY	SHEET	TOTAL SHEETS
F.A.U. 5148	*	WINNEBAGO	15	8
PROJ. NO. 06-00387-00-BR	S.D. NO. 101-3063		B.M. 5099(167)	

85405 Sheet 5 of 12

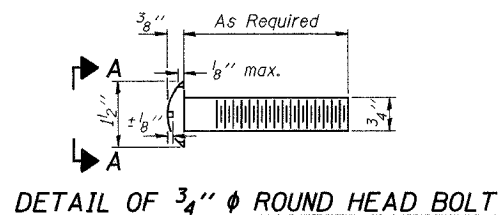


VIEW A-A


4- 3/4" ϕ x 6" Round Head Bolts (With slot or approved recess in head) with locknut & flat washer. 7/8" ϕ holes in hollow structural section may be drilled in the field.

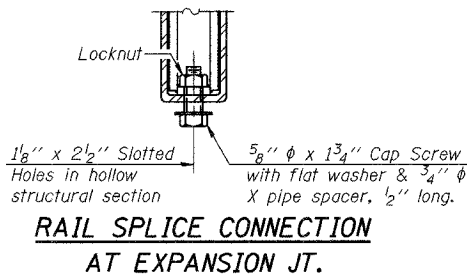


RAIL SPLICE CONNECTION AT EXPANSION JT.

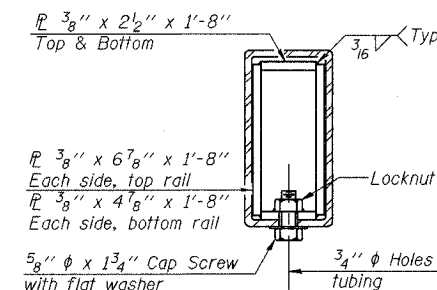


SECTION AT RAIL SPLICE

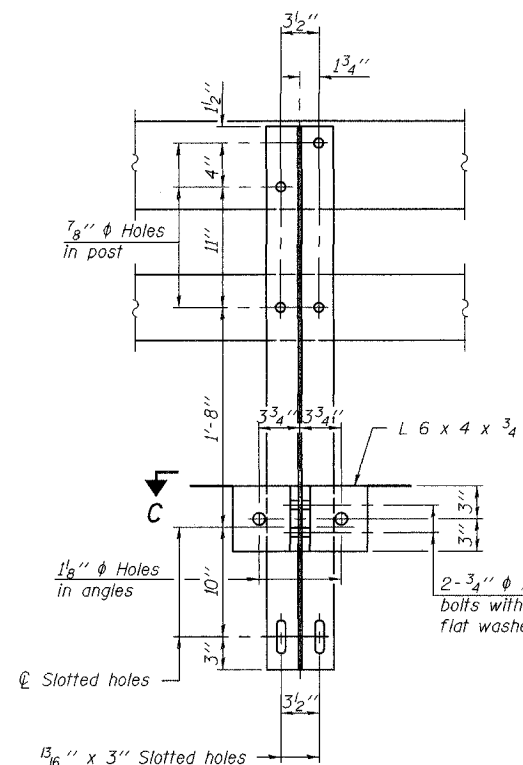


SECTION B-B

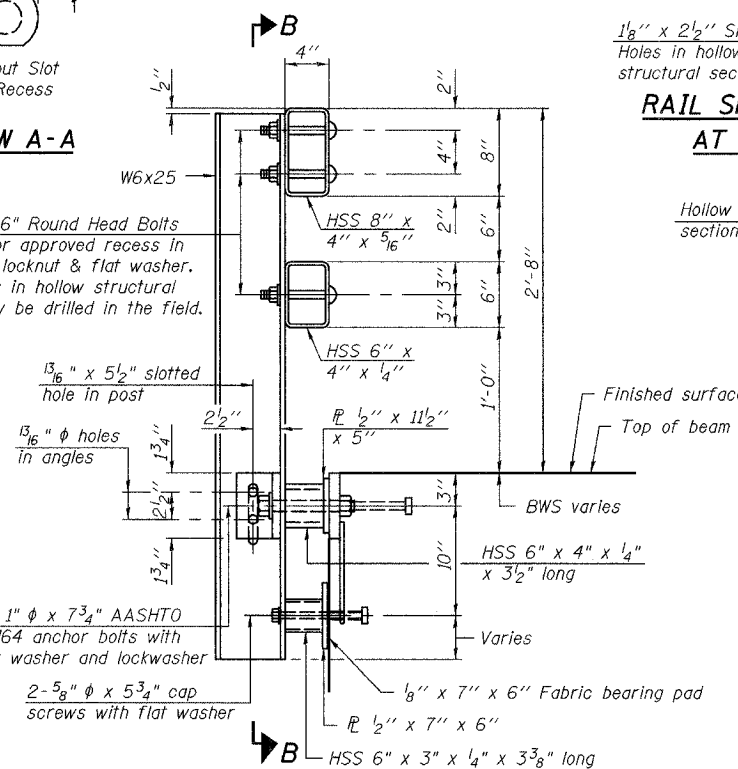


SECTION AT RAIL POST

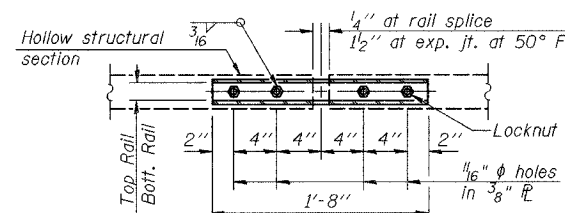

PLAN-BOTT. SPLICE R TYPICAL

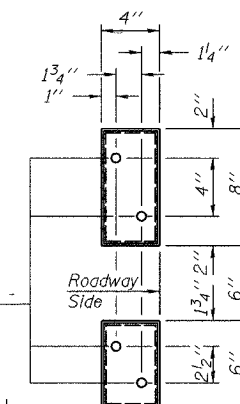


VIEW E-E



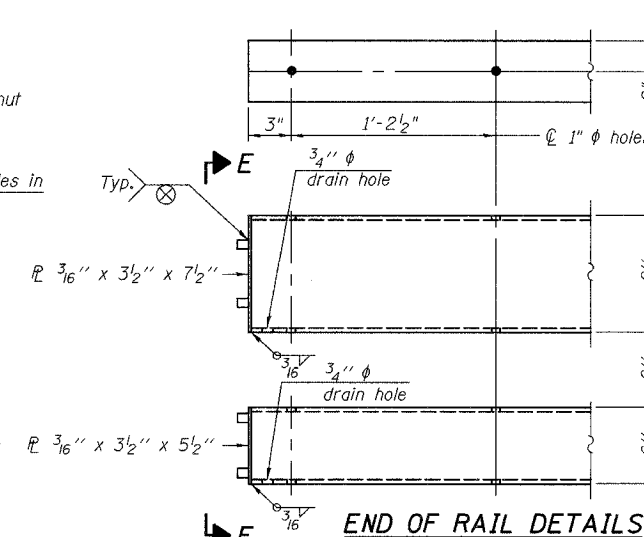


NOTES

Hollow structural sections shall conform to the requirements of ASTM designation A 500 Grade B Structural Steel Tubing and shall meet the longitudinal CVN requirements of 15 ft-lbs at 0° F. All other steel shapes and plates shall conform to the requirements of AASHTO M 270 Grade 36 except posts and angles shall conform to AASHTO M 270, Grade 50. Bolts, cap screws, and nuts shall conform to the requirements of ASTM designation A 307 except for high strength bolts, nuts and washers noted which shall conform to AASHTO M 164. All bolts, nuts, cap screws, washers and lock washers shall be galvanized according to AASHTO M 232. All posts, railing, rail splices, anchor devices and angles shall be galvanized after shop fabrication according to AASHTO M 111 and ASTM A 385. Galvanized rail shall not be painted. Railing shall be according to Section 509 of the Standard Specifications, except as noted, and will be paid for at the contract unit price per foot for Steel Bridge Rail, Type SM. All field drilled holes shall be coated with an approved zinc rich paint before erection. For multi-span bridges, sufficient 1/4" x 6" x 1'-2" galvanized steel shims shall be provided to align rail between adjacent spans. Cost included with Steel Bridge Rail, Type SM. The 3/4" ϕ high strength bolts used to connect the 6 x 4 x 3/4 angles to the post shall be tightened according to Article 505.04(f)(2) of the Standard Specifications. The 1" ϕ high strength bolts connecting the angles to the concrete shall be tightened to a snug fit and given an additional 1/8 turn. The 5/8" ϕ cap screws in bottom of posts shall be tightened to a snug fit only.

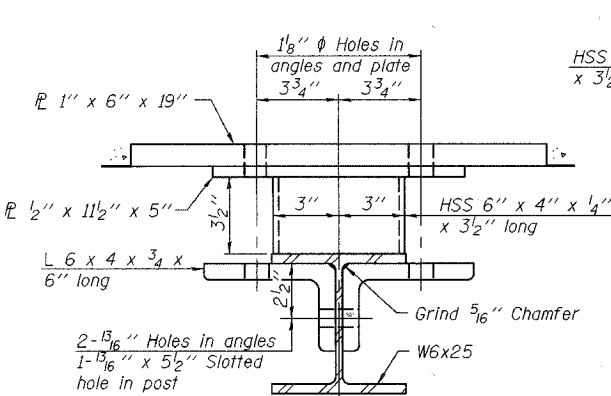

SECTION C-C

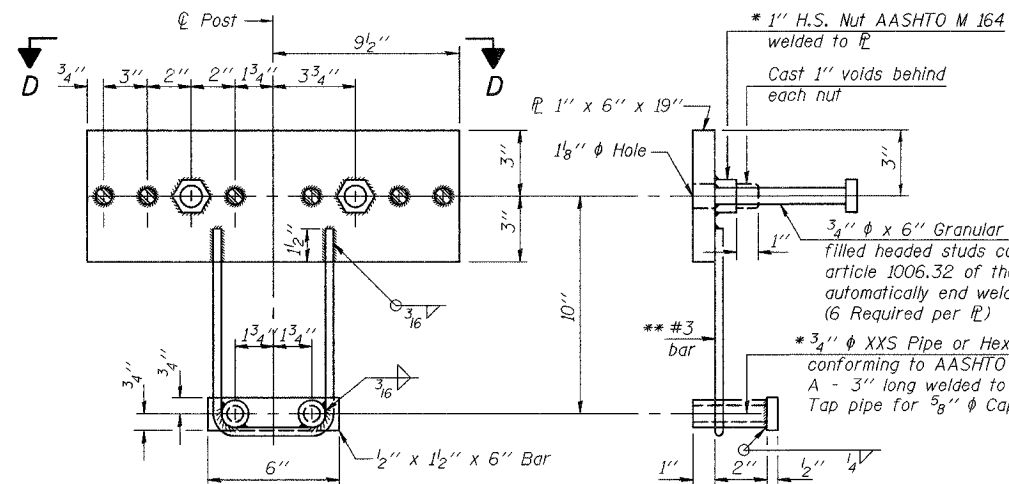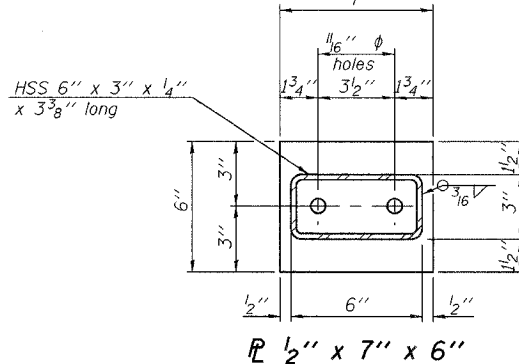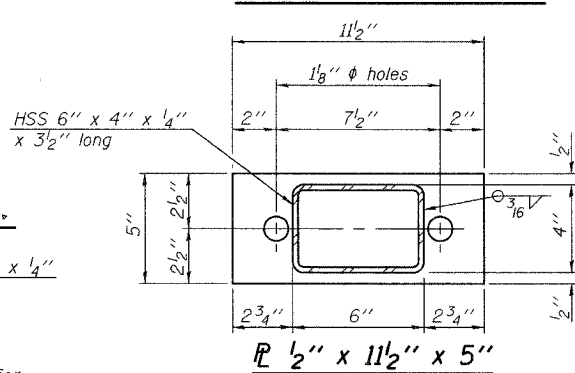

ANCHOR DEVICE

* Threaded areas shall be plugged or blocked off during casting of beam. Galvanized after fabrication.

** Whenever the lower insert assemblies interfere with strand locations, the #3 bars shall be cut and adjusted in order to allow raising or lowering of the lower inserts. Maximum adjustment not to exceed 1/2".

BILL OF MATERIAL

Item	Unit	Quantity
Steel Bridge Rail, Type SM	Foot	418

Corporate License Number 184-001-084

STEEL BRIDGE RAIL - TYPE SM
 PERRYVILLE ROAD BRIDGE
 OVER NORTH BRANCH KISHWAUKEE RIVER
 F.A.U. ROUTE 5148
 SECTION 06-00387-00-BR
 WINNEBAGO COUNTY
 STRUCTURE NUMBER 101-3063
 STATION 40+90

© Copyright Hanson Professional Services Inc. 2007



JOB NO. 06R1568
 DATE 2/1/07

3-4-623 PM 11/30/06
 01/31/2007 03:46 PM
 11/06/06 05:56 CAD/Structural/Sheet S-008-Steel Railing
 LAYOUT SWK 11/30/06
 DRAWN MOM 01/03/07
 REVIEWED SWK 01/10/07