



SECTION B-B

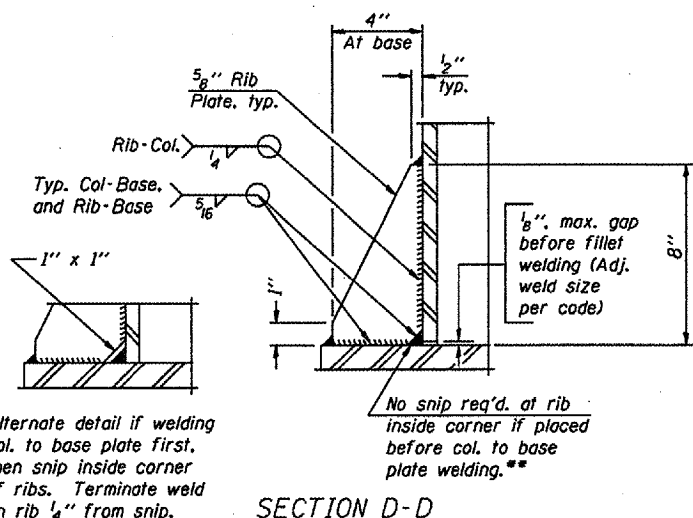


SECTION D-D

\*\* Alternate detail if welding col. to base plate first, then snip inside corner of ribs. Terminate weld on rib 1/4" from snip.

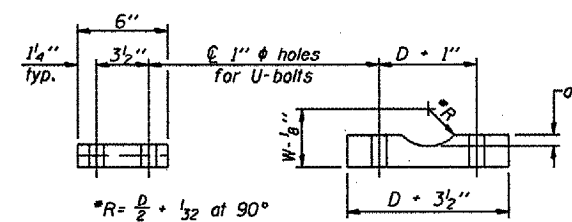


**SADDLE SHIM DETAIL**  
ASTM B26 Alloy 356-F  
or  
ASTM B209 Alloy 6061-T651  
(4 required per sign truss)


Truss Chord Nominal Dia.	a
5"	3/4"
5 1/2"	5/8"
6"	7/8"
6 1/2"	5/8"
7"	1"

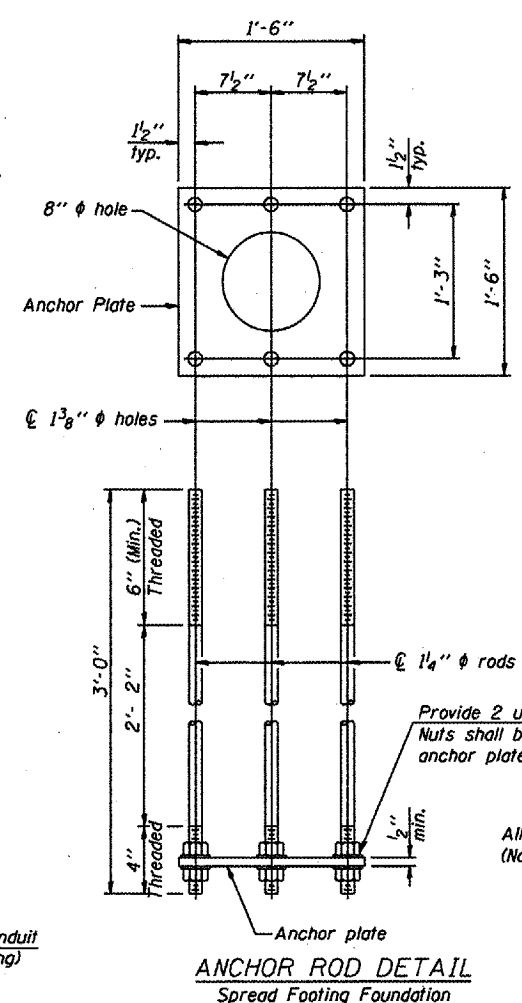

ANCHOR ROD DETAIL  
Spread Footing Foundation

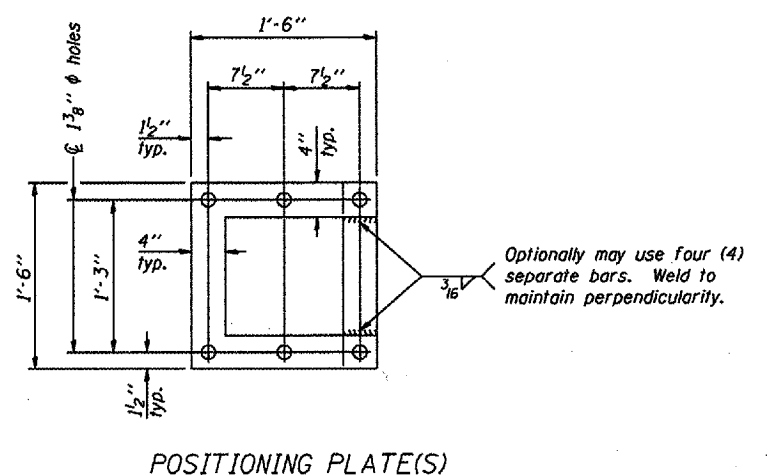

POSITIONING PLATE(S)

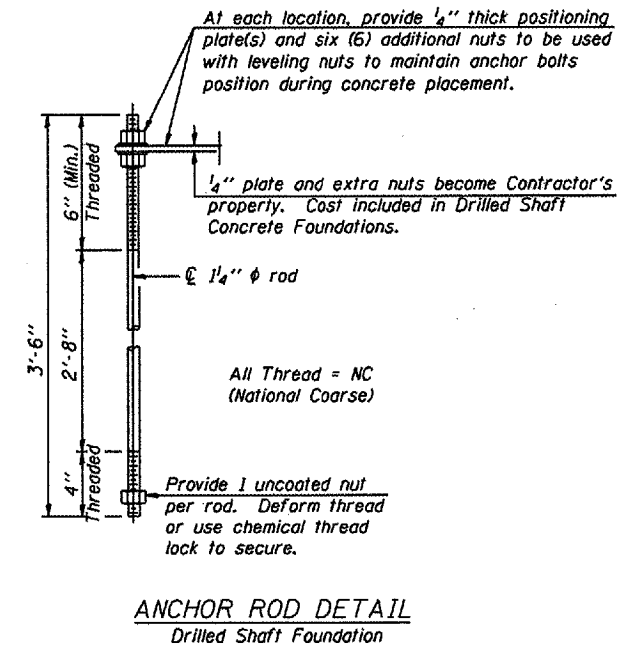


ANCHOR ROD DETAIL  
Drilled Shaft Foundation

Anchor rods shall conform to AASHTO M314 Grade 36 or 50 and meet Charpy V-Notch (CVN) energy of 15 lb.-ft. at 40° F. Galvanize upper 12" per AASHTO M232. No welding shall be permitted on rods.

10" PIPE SUPPORT FRAME DETAILS

OVERHEAD SIGN STRUCTURES  
SUPPORT FRAME DETAILS ALUMINUM TRUSS

District 2  
Overhead Sign  
Structure Replacement

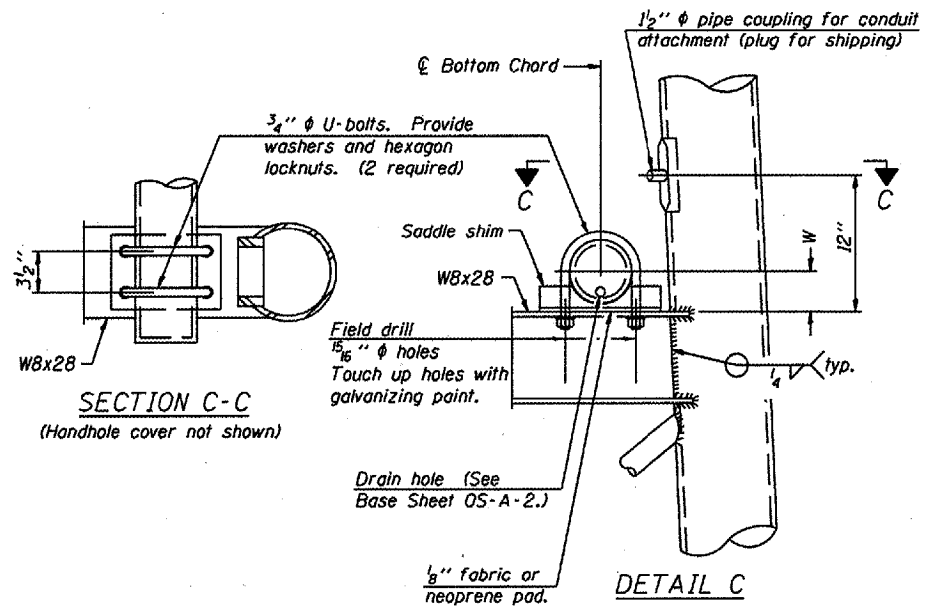

SECTION C-C  
(Handhole cover not shown)

DETAIL C

NUMBER	REVISION	DATE

DESIGNED		20
CHECKED	EXAMINED	
DRAWN	PASSED	ENGINEER OF BRIDGE DESIGN
CHECKED		ENGINEER OF BRIDGES AND STRUCTURES