
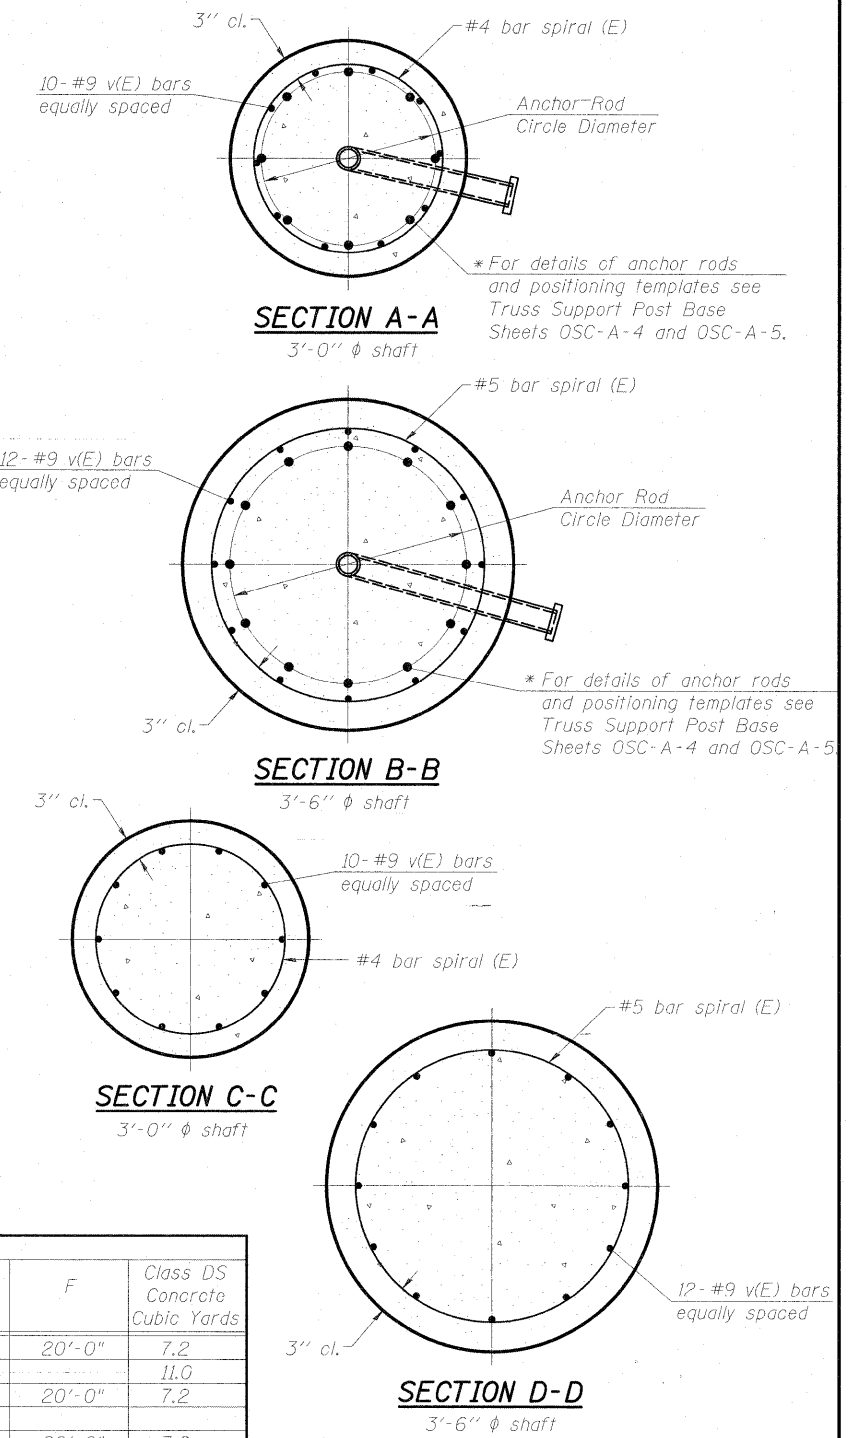


* Grind anchor rod to bright finish at ground clamp location before installing clamp.

STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION

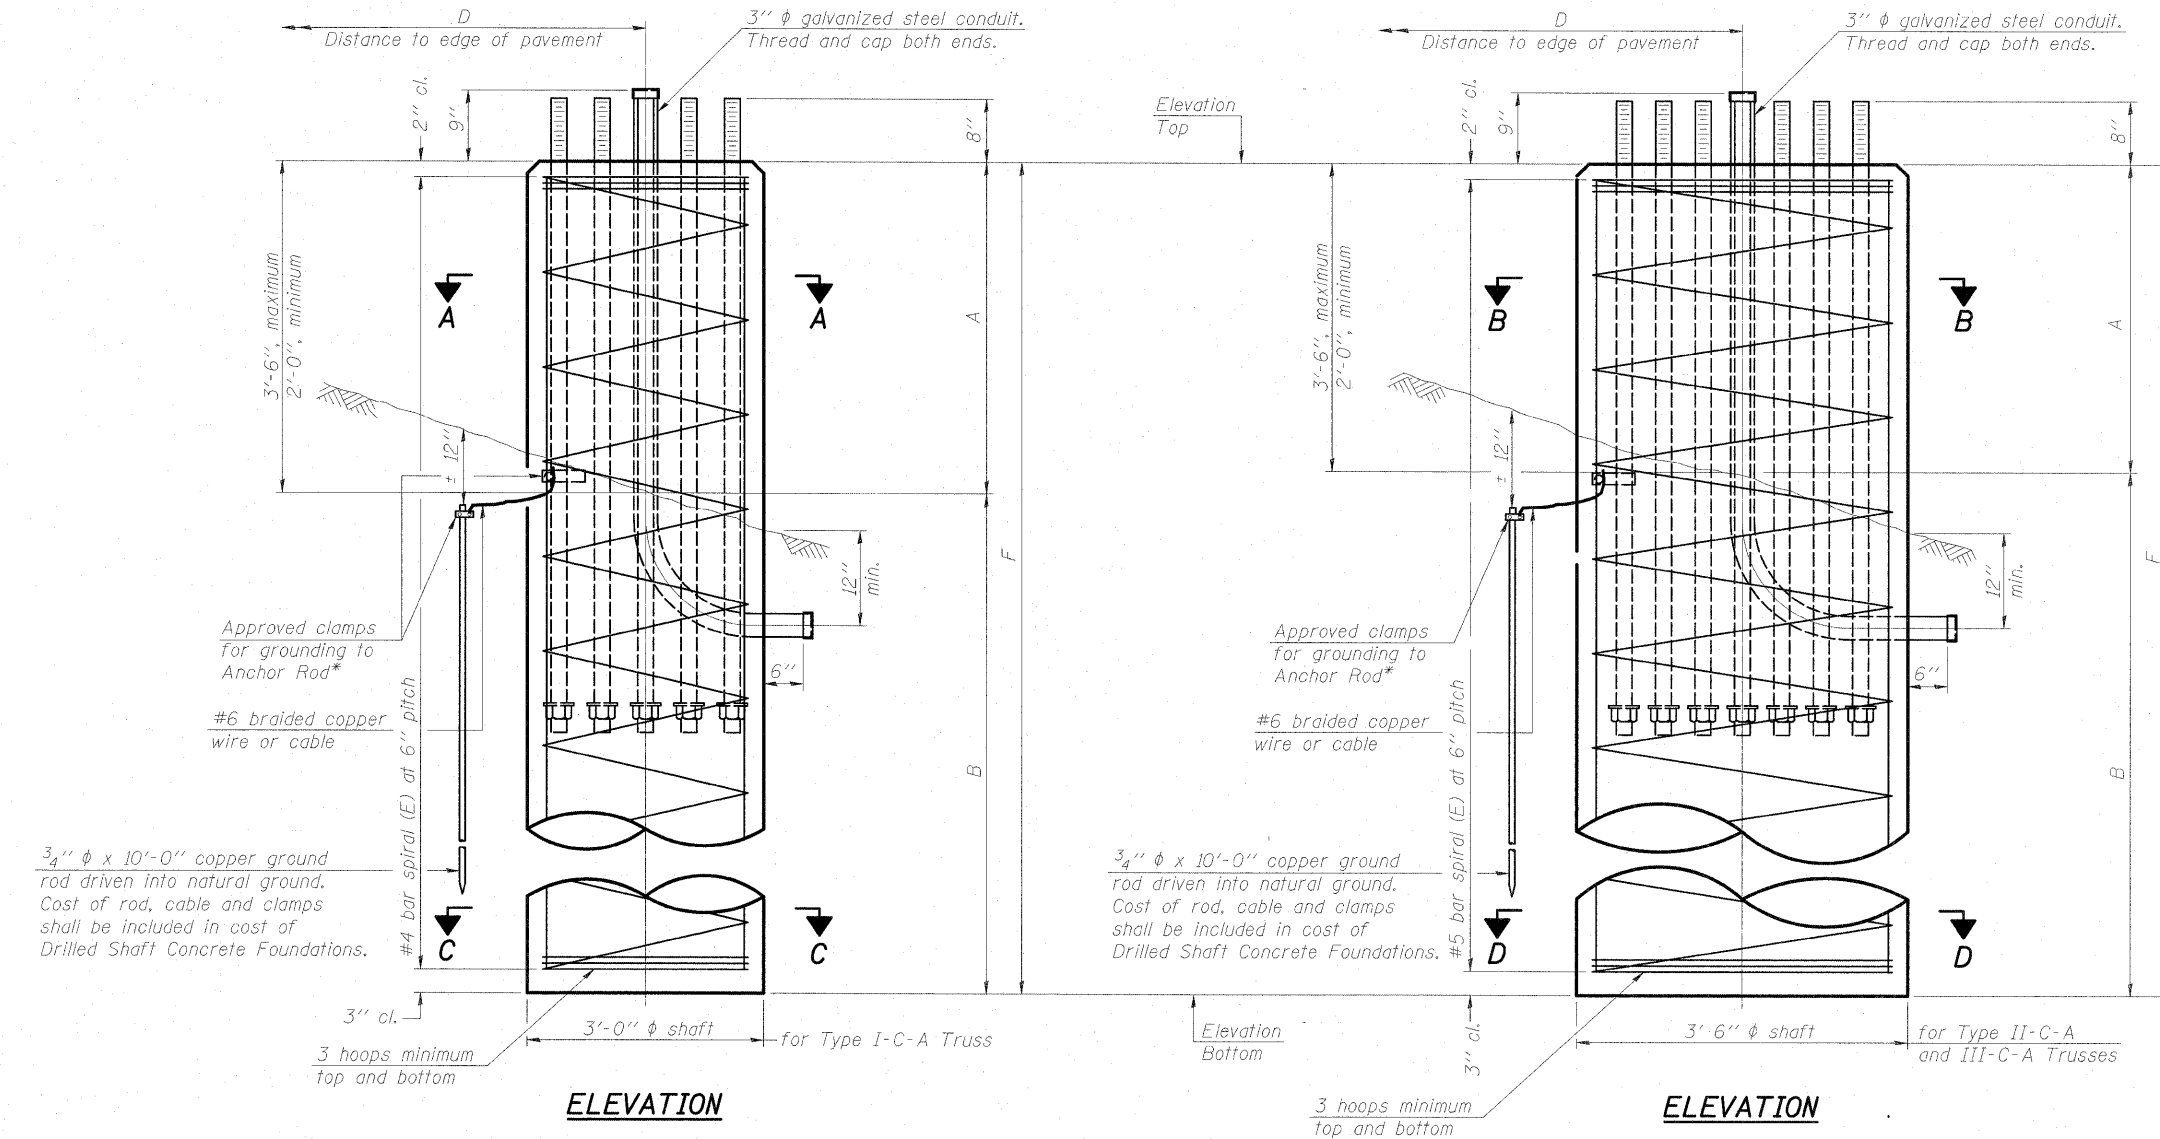

NOTES:
The foundation dimensions shown in the Foundation Design Table are based on the presence of mostly cohesive soils with an average Unconfined Compressive Strength (Q_u) of at least 1.25 tsf, which must be determined by previous soil investigations at the jobsite. When other conditions are indicated, the boring data will be included in the plans and the foundation dimensions shown in the Foundation Data Table will be the result of site specific designs.
If the conditions encountered are different than those indicated, the Contractor shall notify the Engineer to determine if the foundation dimensions need to be modified. If dimensions "B" or "F" are revised by more than 12" by the Contractor, "as-built" plans shall be prepared and submitted to the District Bureau of Operations for future reference.
No sonotubes or decomposable forms shall be used below the lower conduit entrance. Permanent metal forms or other shielding may not be left in place below that elevation without the Engineer's written permission.
Concrete shall be placed monolithically, without construction joints.
Backfill shall be placed per Article 502 of Standard Specification and prior to erection of support column.
A normal surface finish followed by a Bridge Seat Sealer application will be required on concrete surfaces above the lowest elevation 6" below finished ground line. Cost included in "Drilled Shaft Concrete Foundation".

Structure Number	Station	Truss Type	Shaft Diameter	Elevation Top	Elevation Bottom	Q_u	A	B	F	Class DS Concrete Cubic Yards
IC0991055R243.6	7002+81.40 RT	II-C-A	3'-6"	525.20	505.20	ROCK	3'-0"	17'-0"	20'-0"	7.2
IC0991017R244.5 (SEE NOTE "B")	907+05.00 LT	I-C-A	3'-0"	541.73	516.79	ROCK	-	-	-	11.0
IC0991055R244.5	2002+00.00 RT	III-C-A	3'-6"	536.59	516.59	ROCK	3'-0"	17'-0"	20'-0"	7.2
IC0991055R245.0	1086+26.00 LT	II-C-A	3'-6"	546.18	526.18	ROCK	3'-0"	17'-0"	20'-0"	7.2

Truss Type	Post Base Sheet	Maximum Cantilever Length (ft)	Maximum Total Sign Area (sq ft)	Shaft Diameter (in)	"B" Depth (ft)	Anchor Rods		Anchor Rod Circle Diameter (in)
						No.	Diameter (in)	
I-C-A	OSC-A-4	25	170	3.0	16.0	8	2	22
II-C-A	OSC-A-5	30	170	3.5	17.0	12	2	30
II-C-A	OSC-A-5	30	340	3.5	21.5	12	2	30
III-C-A	OSC-A-5	35	170	3.5	19.0	12	2	30
III-C-A	OSC-A-5	35	250	3.5	22.5	12	2	30
III-C-A	OSC-A-5	35	400	3.5	26.5	12	2	30
III-C-A	OSC-A-5	40	400	3.5	32.0	12	2	30

Note "A"
For Top of Rock Elevations and Rock excavation quantities, See Sht SD-26.

Note "B"
For Shaft Elevations, Sections and Rock excavation quantities, See Sht SD-26.

**CANTILEVER SIGN STRUCTURES
DRILLED SHAFT
ALUMINUM TRUSS & STEEL POST
F.A.I. RT. 55 - SEC. (99-1&2)R-6
WILL COUNTY**

DESIGNED
CHECKED
DRAWN
CHECKED

NUMBER	REVISION	DATE

McDonough Associates Inc.
Engineers / Architects
130 East Randolph Street
Chicago, Illinois 60601
(312) 946-8600

SHEET NO. SD-24 SHEETS	F.A.I. RTE. 55	SECTION (99-1&2) R-6	COUNTY WILL	TOTAL SHEETS 756	SHEET NO. 328
CONTRACT NO. 60F12					
FED. ROAD DIST. NO. ILLINOIS FED. AID PROJECT					