


2'4" 3" 3" 2'4" Side Retainer (Typ.) 1'-8" 2'4" x 2'4" x 5'16" P washer under nut. SECTION A-A


ELEVATION AT ABUTMENT

TYPE I ELASTOMERIC EXP. BRG.

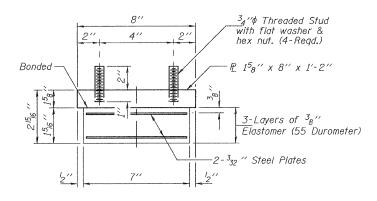

BEARING ASSEMBLY

Note: Shim plates shall not be placed under Bearing Assembly.

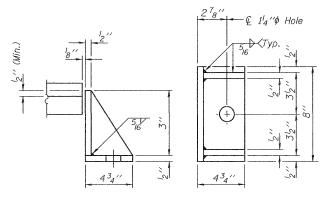

SIDE RETAINER

Equivalent rolled angle with stiffeners will be allowed in lieu of welded plates.

BEAM REACTIONS

R₽	(K)	17.5
R4	(K)	31.3
Imp.	(K)	9.3
R (Total)	(K)	58.1

Notes:

Diaphragm removal and reinstallation may be required to facilitate drilling holes. Cost included with Furnishing and Erecting Structural Steel.


New steel extensions, shim plates and connection bolts are included with Furnishing and Erecting Structural Steel. Prior to ordering any material, the Contractor shall verify in the field all bearing height and shim thickness dimensions. Min. jack capacity = 30 Tons.

Anchor bolts shall be ASTM F1554 all-thread (or an Engineer-approved alternate material) of the grade(s) and diameter(s) specified. ASTM A307 Grade C anchor bolts may be used in lieu of ASTM F1554 Grade 36 (Fy=36ksi). The corresponding specified grade of AASHTO M314 anchor bolts may be used in lieu of ASTM F1554.


In lieu of ASTM F1554.


Drilled and set anchor bolts shall be installed according to Article 521.06 of the Standard Specifications.

Side retainers shall be included in the cost of Elastomeric Bearing Assembly, Type I.

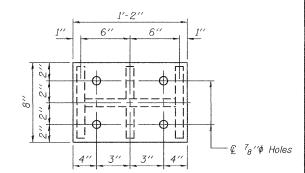


PLAN TOP AND BOTTOM PLATE





SECTION B-B

STEEL EXTENSION DETAIL



Existing R to be removed using the air-arc method and grind smooth all weld material remaining on the bottom flange.

Burn existing anchor bolts flush with existing concrete surface. Grind existing anchor bolt smooth and seal with epoxy.

EXISTING BEARING REMOVAL DETAIL

Cost included with Jack and Remove Existing Bearings.

BILL OF MATERIAL

Managed CA-Specific States with industrial production of contractions in according by the activation of contraction of contractions in according to the contraction of contractions of contractions in according to the contraction of contractions of contractions in according to the contraction of contractions of contrac				
Item	Unit	Total		
Elastomeric Bearing Assembly, Type I	Each	6		
Jack and Remove Existing Bearings	Each	6		
Furnishing and Erecting Structural Steel	Pound	850		
Anchor Bolts 1''Þ	Each	12		

TYI/REPS

1 TITTLE S	1	
DESIGNED - ADY	EXAMINED Joyne + All DATE - MARCH 14, 2011	
CHECKED - DAB	ACTING ENGINEER OF STRUCTURAL SERVICES	
DRAWN - Kyle M. Steffen	PASSED d. Carl Kurus	
CHECKED - ADY DAB	ACTING ENGINEER OF BRIDGES AND STRUCTURES	

STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION

BEARING REPLACEMENT DETAILS AT EAST ABUTMENT
SN 080-0004

SHEET NO. 1 OF 2 SHEETS

F.A.	SECTION	COUNTY	TOTAL	SHEE	NO.
99	(5-2VB-1, 5-2HB,	RICHLAND	53	29	
5-2VB-2)BR-2	CONTRACT	NO.	74482		