



**PLAN OF OUTSIDE SHOULDER PIER PROTECTION**

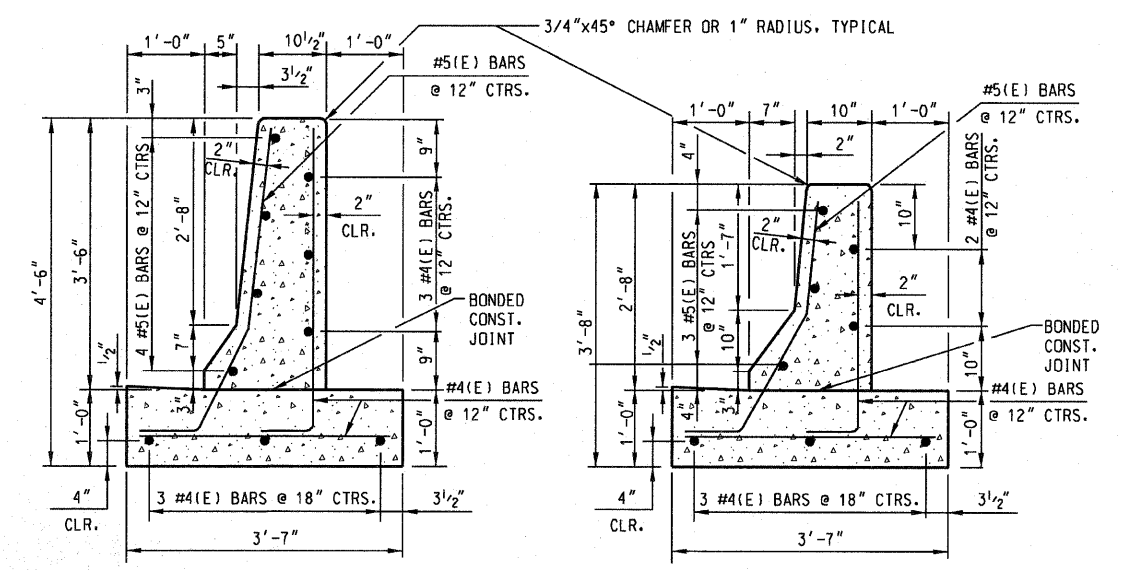


**TYPE F BARRIER**

**TYPE II BARRIER**

**SECTION A-A**

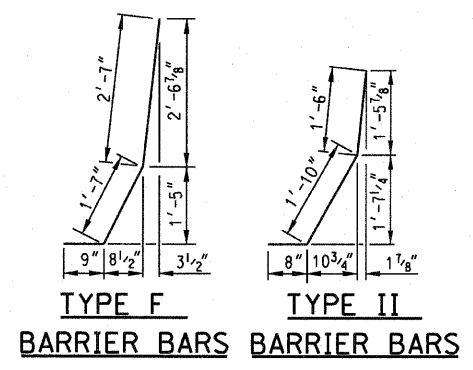

**TYPE F BARRIER BARS**      **TYPE II BARRIER BARS**



**TYPES F & II BARRIER BARS**

**DOWEL BAR BENDING DIAGRAMS**

**NOTES:**

1. TOP SHOULDER EDGE OF BARRIER BASE GUTTER SHALL MATCH THE TOP OF SHOULDER ELEVATION.
2. 1" DEEP CONTRACTION JOINTS SHALL BE CONSTRUCTED IN BOTH THE REINFORCED CONCRETE BARRIER WALL AND BASE. CONTRACTION JOINTS SHALL ALSO BE CONSTRUCTED AT BOTH SIDES OF ALL DRAINAGE STRUCTURES. MAXIMUM JOINT SPACING SHALL BE 30 FEET.
3. THE FORMING OF CONTRACTION JOINTS SHALL BE DONE WITH AN APPROVED FINISHING TOOL AT THE DISCRETION OF THE ENGINEER SUBJECT TO THE SATISFACTORY CONTROL OF CRACKING. THE SAWING OF CONTRACTION JOINTS IN THE BARRIER WALL SHALL NOT BE PERMITTED.
4. REINFORCING BARS SHALL MEET THE REQUIREMENTS OF AASHTO M31 (ASTM A615), GRADE 60, AND SHALL CONFORM TO SECTION 508 OF THE STANDARD SPECIFICATIONS.
5. REINFORCING BARS DESIGNATED "E" SHALL BE EPOXY COATED.
6. REINFORCEMENT BENDING DETAILS SHALL BE IN ACCORDANCE WITH THE "MANUAL OF STANDARD PRACTICE FOR DETAILING REINFORCED CONCRETE STRUCTURES", ACI 315, LATEST EDITION.
7. REINFORCEMENT BAR BENDING DIMENSIONS ARE OUT TO OUT.
8. TYPE F BARRIER SHALL BE USED WITH ALL NEW CONSTRUCTION, OR RECONSTRUCTION OF EXISTING BARRIERS.



DATE	REVISIONS
7-1-2009	REVISED NOTES

SINGLE FACE REINFORCED CONCRETE BARRIER  
STANDARD C3-01

APPROVED *Paul Kovacs* CHIEF ENGINEER DATE 7-1-2009