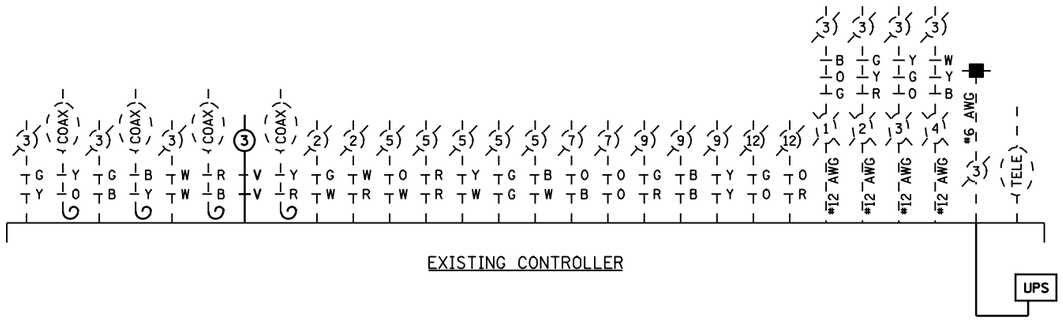

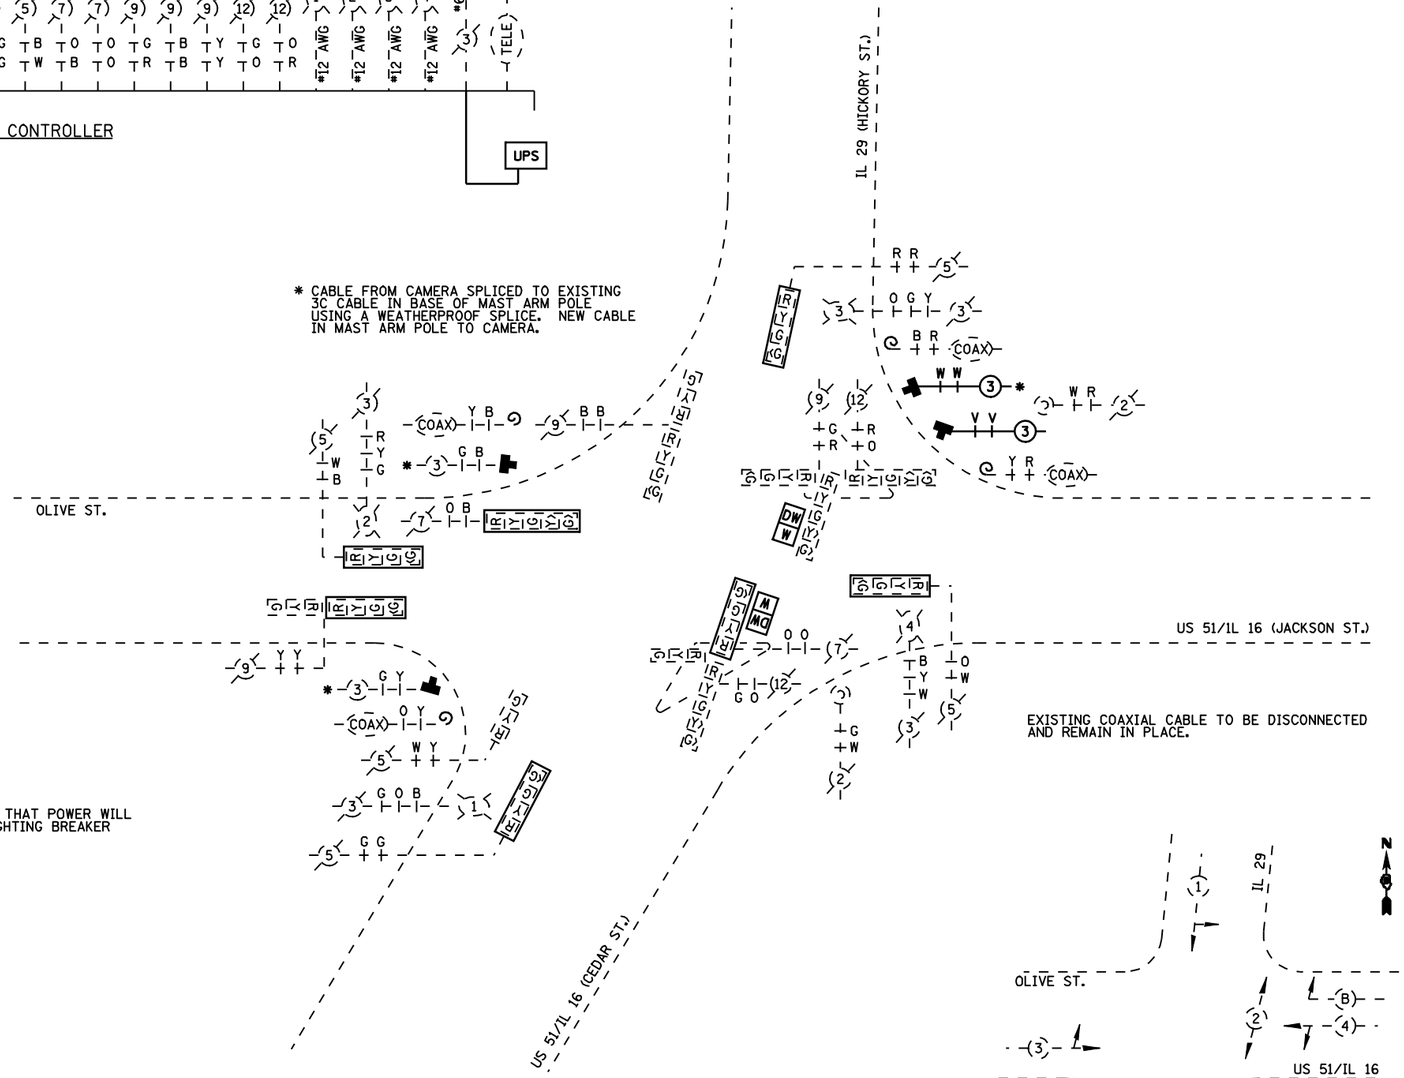



LIGHTING BREAKER

UPS SHALL BE WIRED SO THAT POWER WILL NOT BE PROVIDED TO LIGHTING BREAKER DURING POWER OUTAGE.

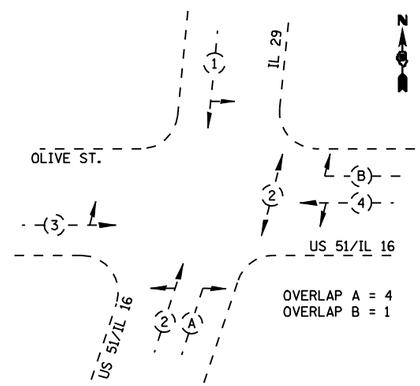

PHASE DESIGNATION DIAGRAM

NOT TO SCALE

FILE NAME = c:\pw_work\PWIDOT\LAUGHLINRL\d0196421\D672D60_sht_cable.dgn	USER NAME = laughlinrl	DESIGNED -	REVISED -
		DRAWN -	REVISED -
	PLOT SCALE = 40.0000 ' / IN.	CHECKED -	REVISED -
	PLOT DATE = Apr-02-2010 10:12:54AM	DATE -	REVISED -

STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION

PROPOSED CABLE PLAN
US 51 & IL 16/IL 29

SCALE: | SHEET NO. OF SHEETS | STA. | TO STA.

F.A.P. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
*	2TS-6, 3TS-8, 15TS-1	SANGAMON/ CHRISTIAN	7	5
* FAP 662, 322 (IL 4, US 51)		CONTRACT NO. 72D60		
ILLINOIS FED. AID PROJECT				