SECTION

FALL CREEK 09-08111-00-BR


METAL SHELL PILE DETAILS BRIDGE SHEET 6 OF 7 SHT. NO.

13 OF 14




METAL SHELL PILE TABLE


Designation and outside diameter	Wall thickness t	Weight per foot (Lbs./ft.)	Inside volume (yd.3/ft.
PP12	0.179"	22.60	0.0274
PP12	0.250"	31.37	0.0267
PP14	0.250"	36.71	0.0368
PP14	0.312"	45.61	0.0361

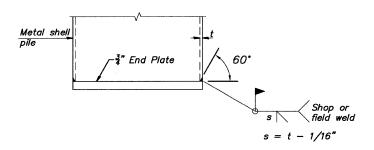

END PLATE ATTACHMENT

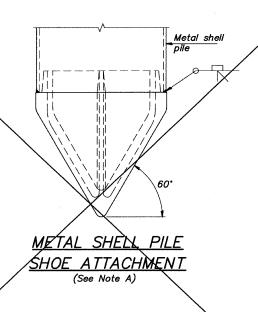


Note A:
When called for on the plans, the Contractor shall furnish metal shell pile shoes consisting of a single piece conical pile point as shown. The pile shoes shall be cast in one piece steel according to either ASTM A 148 Grade 90—60 or AASHTO M 103 Grade 65—35 and shall provide full bearing over the full circumference of the metal shell pile. The pile shoe shall have tapered leads to assure proper alignment and fitting and shall be secured to the pile with a circumferential weld.

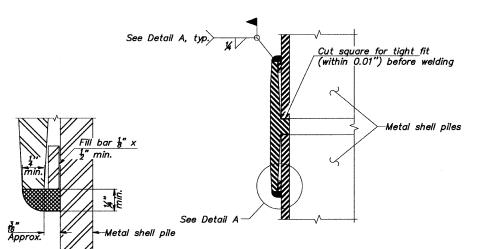

WELDED COMMERCIAL **SPLICE**

The $\frac{1}{8}$ " x $\frac{1}{2}$ " min. fill bar may be constructed of 2 bars with a 1 max. gap between them. Pile segments shall be driven to solid contact with splicer before welding.

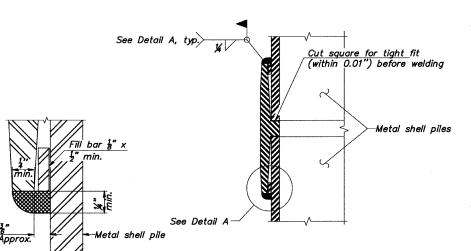


Welded wire fabric 6 x 6-Bottom of pier wall or pile bent abut. W4.0 x W4.0 weighing 58#/100 sq. ft. Bend as required to fit into the pier wall SECTION A-A Note: Forms for encasement may be **ELEVATION** omitted when soil conditions permit.

COUNTY RD. DIST.

ADAMS

CONCRETE ENCASEMENT AT PIERS & ABUTMENTS

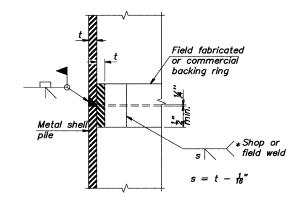


COMPLETE PENETRATION WELD SPLICE

* Field fabricated backing ring may be made from pile shell by removing segment to allow reducing circumference and vertically rejoin with partial joint penetration weld.

DETAIL A

The metal shell piles shall be according to ASTM A 252 Grade 3.

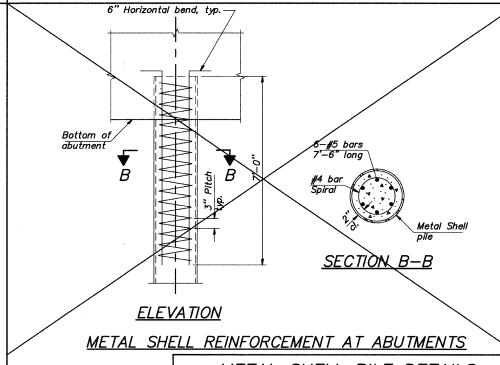

METAL SHELL PILE DETAILS

STRUCTURE NO. 001-3430 HARKNESS CREEK ADAMS COUNTY FALL CREEK SEC. 09-08111-00-BR STATION 2+61.20