




GENERAL NOTES

1. MATERIALS AND METHODS OF CONSTRUCTION SHALL BE IN ACCORDANCE WITH CURRENT STANDARDS AND SUPPLEMENTAL SPECIFICATIONS.
2. REFER TO APPROPRIATE STANDARD ROAD PLANS AND PROJECT PLANS FOR ADDITIONAL DETAILS.
3. MOUNTING HEIGHTS SHALL BE AS INDICATED OR AT MINIMUM REQUIREMENT ALLOWED UNDER CURRENT APPLICABLE ELECTRICAL CODES, WHICHEVER IS GREATER. NOTIFY ENGINEER IF MOUNTING HEIGHT IS GREATER THAN SHOWN.
4. CONDUIT SIZES FOR ALL DETAILS SHALL MATCH THOSE INDICATED ON THE PLANS.




TYPICAL BREAKER INSTALLATION IN SIGNAL/CONTROLLER CABINET

NOT TO SCALE

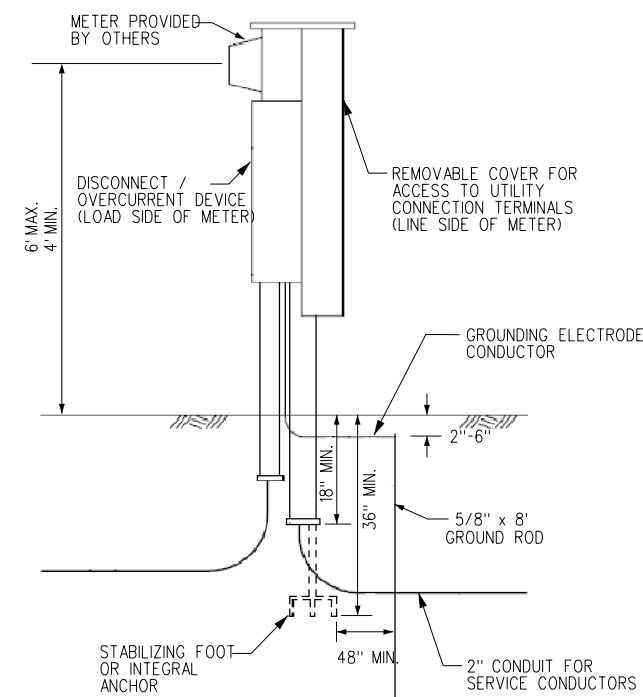

METER PEDESTAL INSTALLATION

NOT TO SCALE

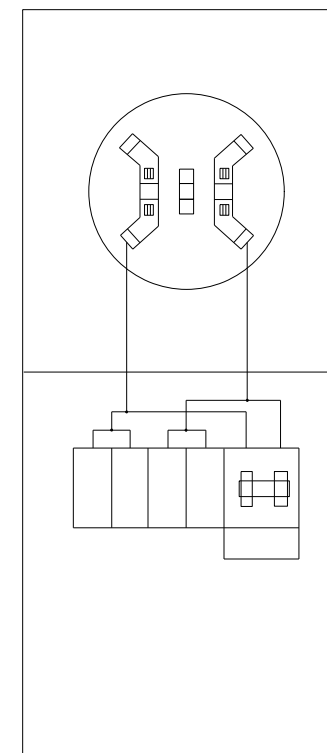

OPTION B

- Features:
- 6 circuit interior to accept standard plug-in type circuit breakers
  - 100 amp, 120/240 volt circuit breaker

LAYOUT	
DRAWN	
REVIEWED	

FILE NAME =	USER NAME = dmcointock	DESIGNED - DJM	REVISED -
ci:\pwise_work\do_not_delete\dms01359\027\ACKE-IT-sht-ITS500.sht		DRAWN - DJM	REVISED -
	PLOT SCALE = NA	CHECKED - SPG	REVISED -
	PLOT DATE = 3/6/2014	DATE - 3/6/2013	REVISED -

STATE OF ILLINOIS  
DEPARTMENT OF TRANSPORTATION

ITS DETAILS  
TYPICAL POWER SERVICE

SCALE: NA SHEET NO. 9 OF 11 SHEETS STA. TO STA.

F.A.U. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
5756	(81-1)M	ROCK ISLAND	217	135
CONTRACT NO. 64J68			ITS-09	
ILLINOIS FED. AID PROJECT				