




TEMPORARY LIGHT POLE DETAIL
NOT TO SCALE

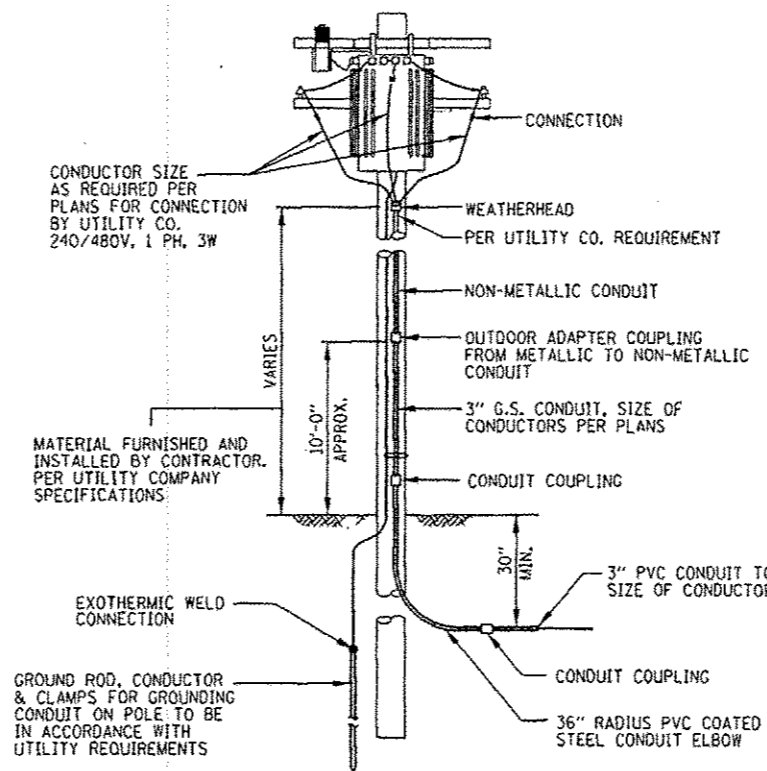


UTILITY SERVICE POLE
SUBJECT TO UTILITY COMPANY APPROVAL
NO SCALE

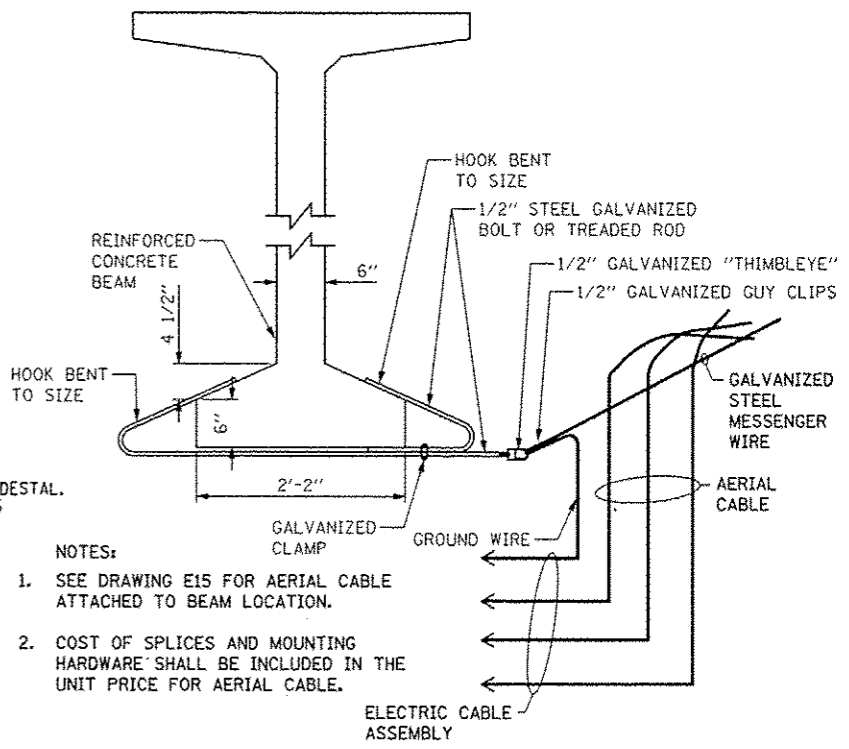

AERIAL CABLE ATTACHED TO STRUCTURE DETAIL
NOT TO SCALE

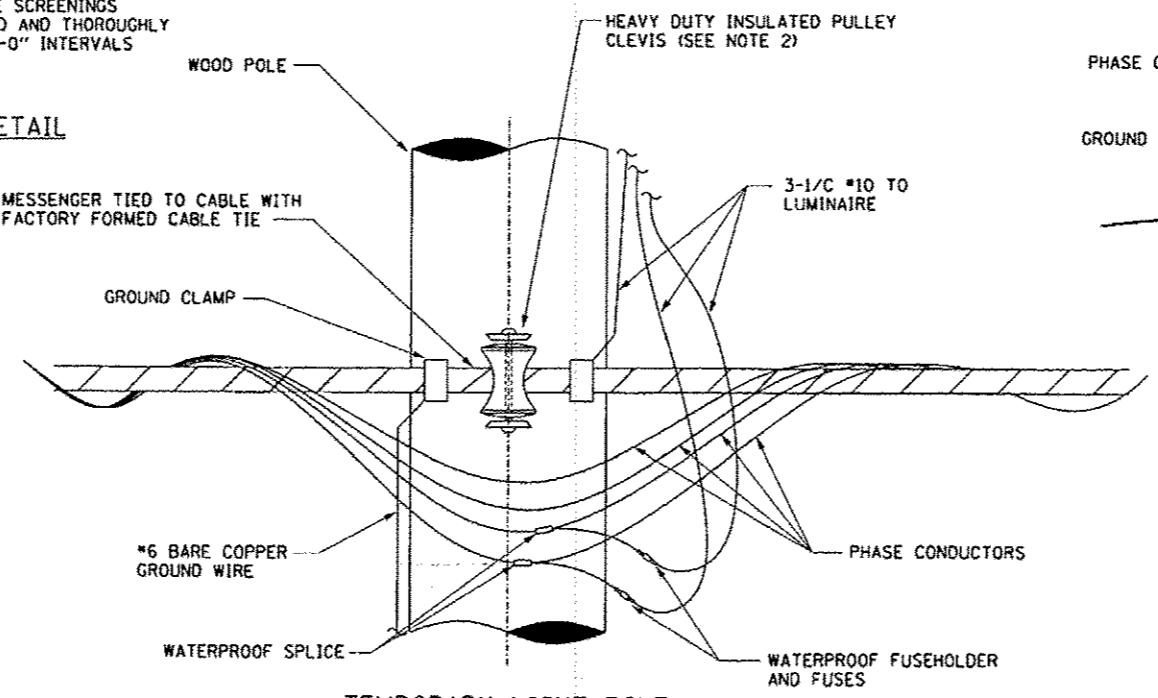

TEMPORARY LIGHT POLE CABLE ATTACHMENT DETAIL
NOT TO SCALE

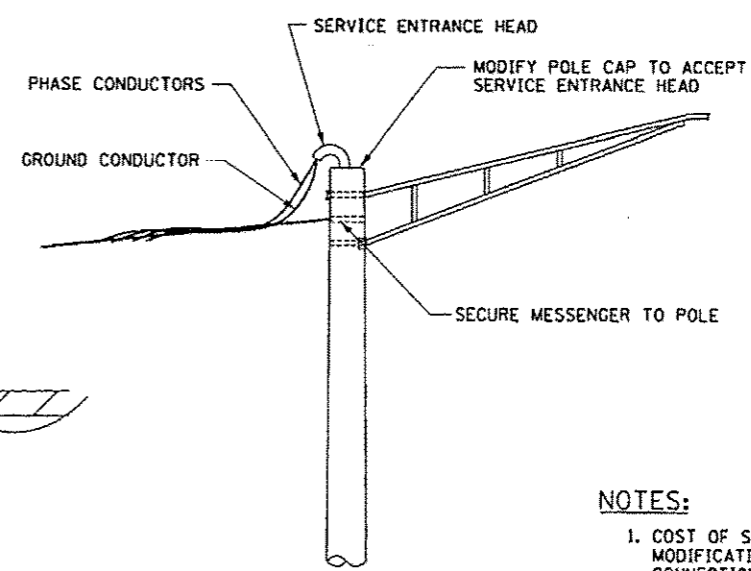

TEMPORARY POWER FEED TO EXISTING ALUMINUM POLE
NOT TO SCALE

- NOTES:
- SEE DRAWING E15 FOR AERIAL CABLE ATTACHED TO BEAM LOCATION.
 - COST OF SPLICES AND MOUNTING HARDWARE SHALL BE INCLUDED IN THE UNIT PRICE FOR AERIAL CABLE.

NOTES:

- COST OF SERVICE ENTRANCE HEAD, MODIFICATION OF POLE CAP AND CONNECTION ARE INCIDENTAL.
- WITH THE APPROVAL OF THE ENGINEER, A SECONDARY CABLE SPREADER SECURED TO THE POLE MAY BE USED IN CONJUNCTION WITH THE QUADRUPEX IN LIEU OF THE HEAVY DUTY INSULATED PULLEY CLEVIS.