


DEVELOPED ELEVATION OF STONE RETAINING WALL
PROPOSED BOARDWALK STRUCTURE No. 2 - W. ABUTMENT
 (Railings Omitted For Clarity)

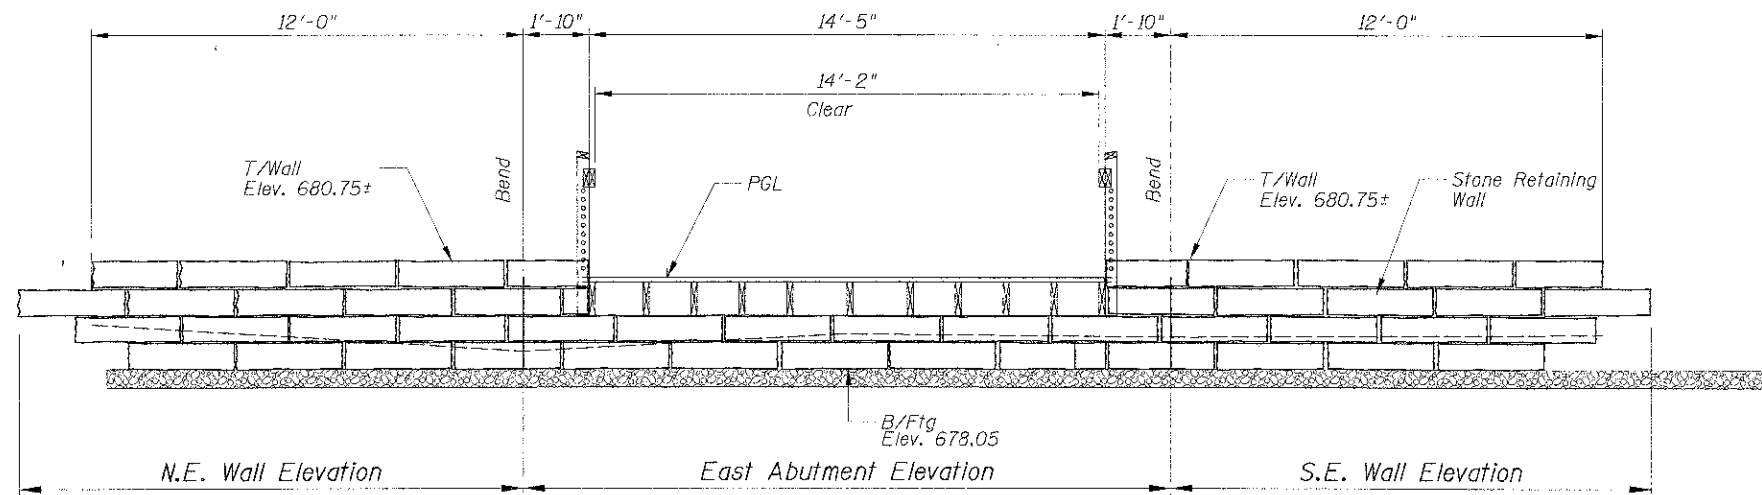

DEVELOPED ELEVATION OF STONE RETAINING WALL
PROPOSED BOARDWALK STRUCTURE No. 2 - E. ABUTMENT
 (Railings Omitted For Clarity)

NOTES:

1. Final Placement of Stones to be Approved by Landscape Architect in Field.
2. Stones Shall Have No Exposed Saw Cuts.
3. Stone retaining Walls Shall Have Minimum 6:1 Batter on Exposed Face.