

GENERAL NOTES

ALTERNATE MATERIAL FOR THE WALLS MAY BE CONCRETE MASONRY UNITS, PRECAST REINFORCED CONCRETE SECTIONS OR CAST-IN-PLACE CONCRETE. THE CAST IRON STEPS AS DETAILED HEREON ARE TYPICAL. STEPS OF OTHER DESIGN AND MATERIAL THAT CONFORM TO THE MINIMUM REQUIREMENTS OF THE STEPS SHOWN MAY BE USED WHEN APPROVED BY THE ENGINEER.

CAST IRON STEPS SHALL BE GRAY IRON CONFORMING TO THE REQUIREMENTS OF ARTICLE 1006.14 OF THE STANDARD SPECIFICATIONS.

STEPS SHALL BE EMBEDDED INTO THE WALL A MINIMUM OF THREE (3) INCHES. STEPS SHALL NOT BE EXTENDED ON THE OUTSIDE.

STEPS SHALL BE OMITTED FOR WORK IN COOK COUNTY WHEN THE DEPTH OF THE MANHOLE IS TEN (10') OR LESS.


IN ADDITION TO THE REQUIREMENTS OF ARTICLE 612.13 OF THE STANDARD SPECIFICATIONS, THE CONTRACT UNIT PRICE FOR MANHOLES, TYPE A, 7'-DIAMETER SHALL INCLUDE THE SAND CUSHION WHEN REQUIRED, FURNISHING AND INSTALLING STEPS WHEN REQUIRED, FURNISHING AND COMPACTING THE SPECIFIED BACKFILL MATERIAL, AND FURNISHING AND INSTALLING FLAT SLAB TOP.

PRECAST FLAT SLAB TOP SHALL CONFORM TO ARTICLES 505.01 THRU 505.05 OF THE STANDARD SPECIFICATIONS EXCEPT THAT THE CONCRETE STRENGTH SHALL BE 4,000 PSI AFTER 28 DAYS. REINFORCEMENT BARS AND WELDED WIRE FABRIC SHALL CONFORM TO THE REQUIREMENTS OF ARTICLE 1006.10. ONLY GRADE 60 REINFORCEMENT BARS WILL BE PERMITTED.


BOTTOM SLAB SHALL BE REINFORCED BY EITHER REINFORCEMENT BARS OR WELDED WIRE FABRIC. THE MINIMUM REINFORCEMENT SHALL BE 0.46 SQUARE INCH PER LINEAR FOOT IN BOTH DIRECTIONS.

JOINT CONFIGURATION AND DIMENSIONS OF FLAT SLAB TOP SHALL MATCH AND FIT THE RISER JOINT DETAIL.


LIFTING DEVICES SHALL BE APPROVED BY THE ENGINEER.

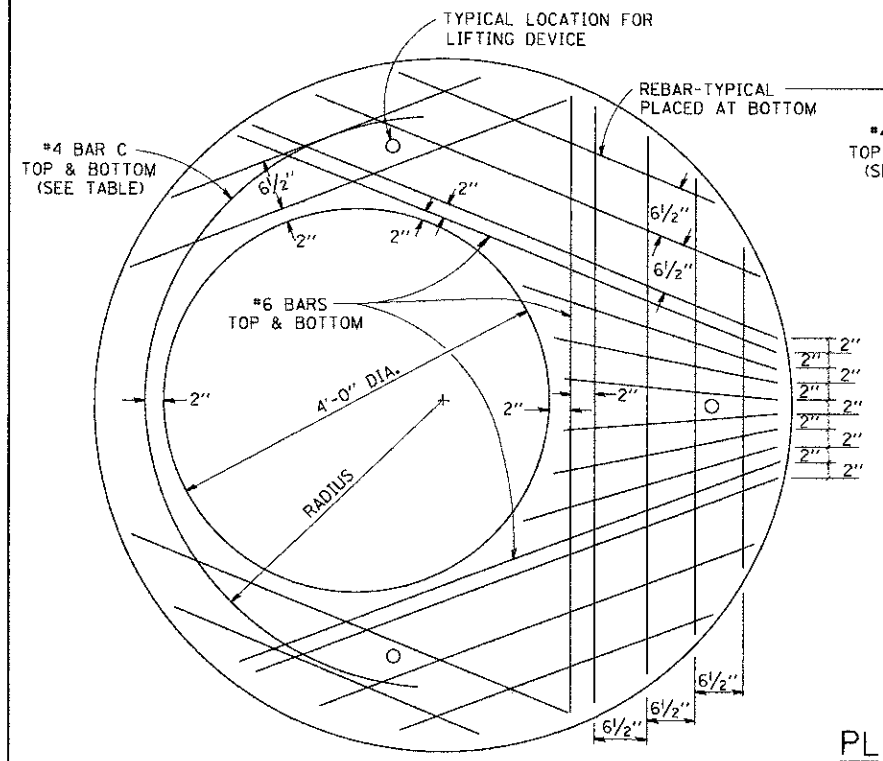



PLAN
SHOWING REBAR REINFORCEMENT

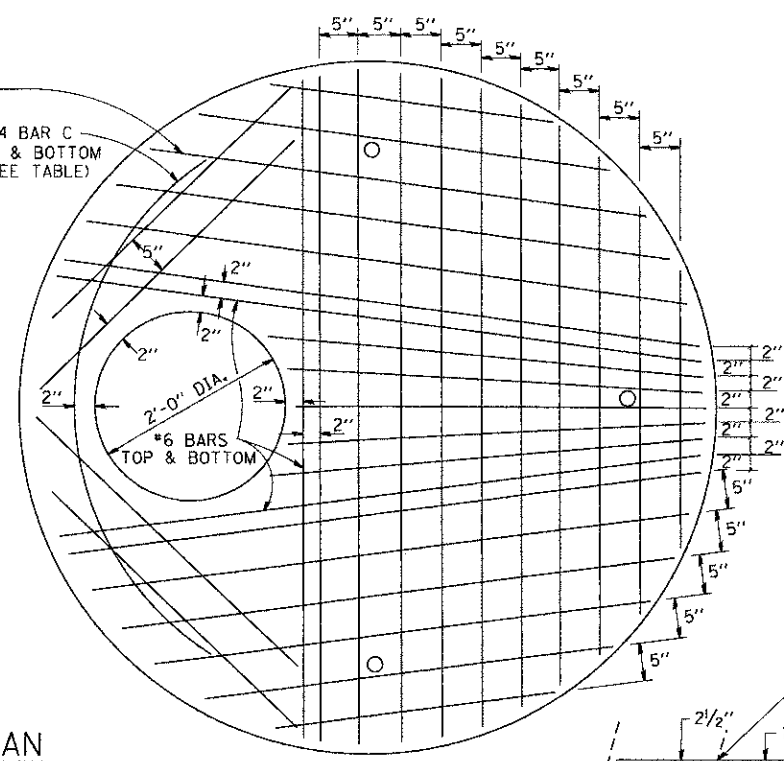

SEC. A-A
CAST IRON STEPS

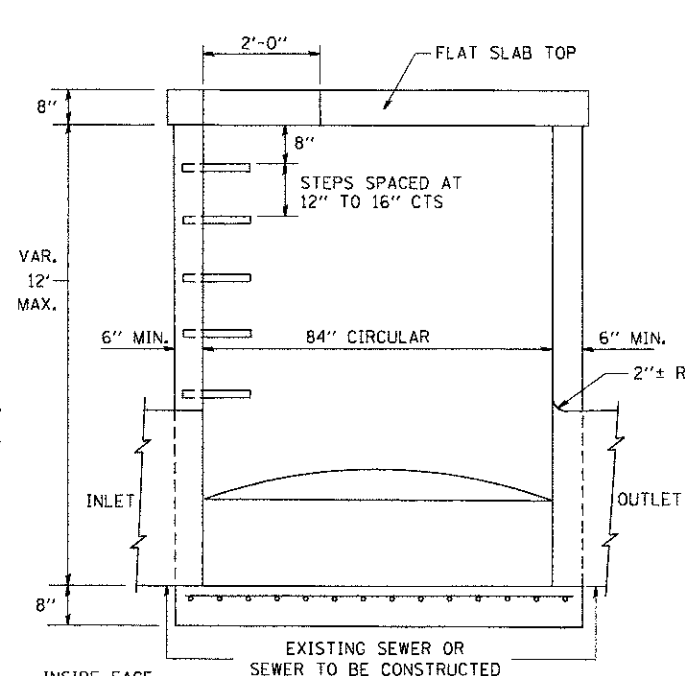


ELEVATION

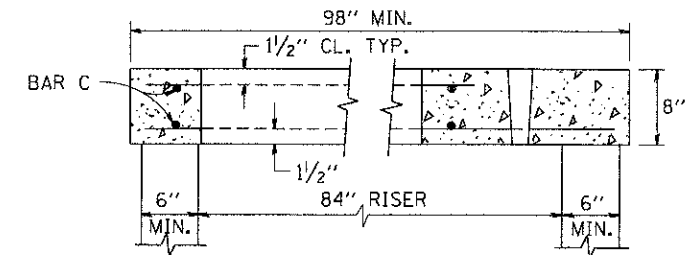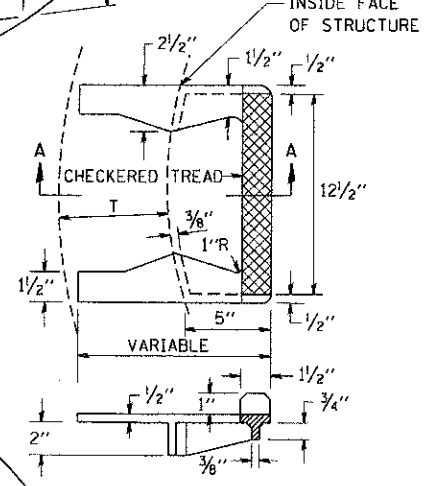


SECTION B-B

| ALTERNATE MATERIALS FOR RISERS | (MIN.) |
|--------------------------------------|--------|
| CONCRETE MASONRY UNITS | 5" |
| PRECAST REINFORCED CONCRETE SECTIONS | 4" |
| CAST-IN-PLACE CONCRETE | 6" |

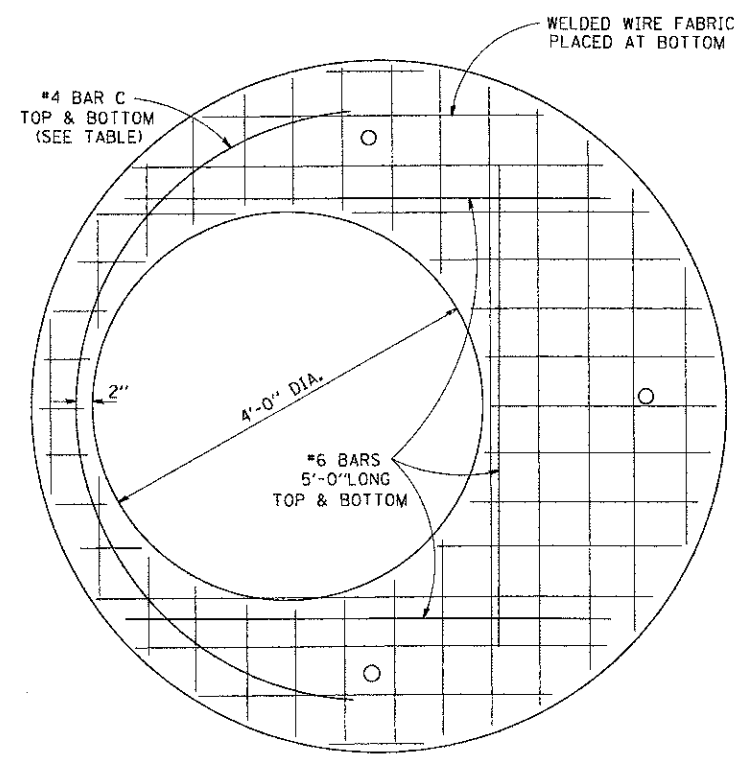


PLAN
SHOWING WELDED WIRE FABRIC REINFORCEMENT

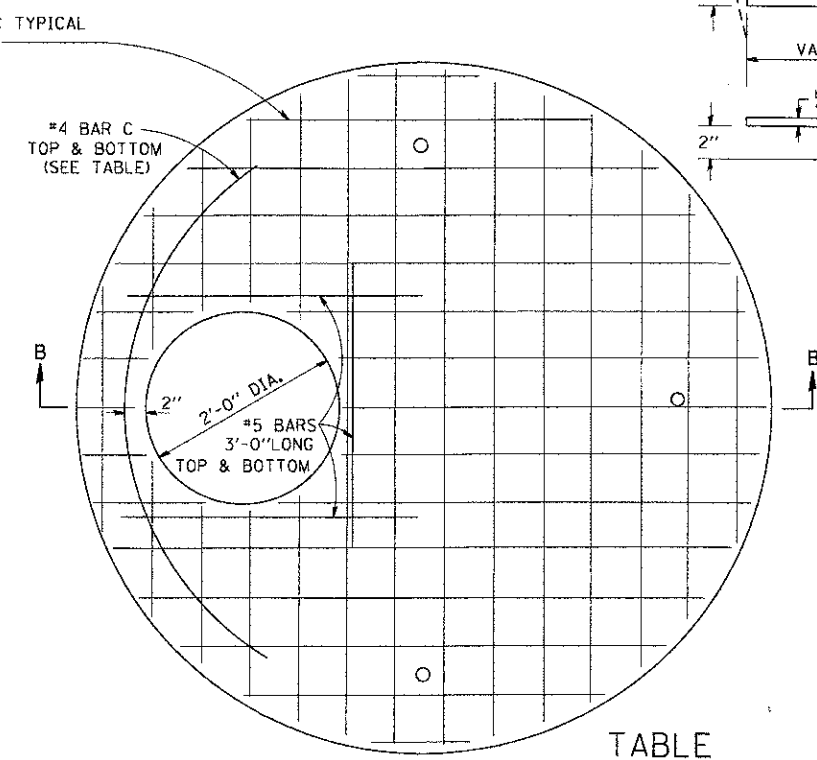


TABLE

| DIAMETER OF OPENING | REINFORCEMENT "A _S " WWF OR BAR SIZE | OR SIZE | BAR C | | |
|---------------------|---|---------|-------|--------|--------|
| | | | SIZE | LENGTH | RADIUS |
| 2'-0" | 1.06 SQ.IN./LIN.FT. | #6 | #4 | 6'-0" | 38" |
| 4'-0" | 0.82 SQ.IN./LIN.FT. | #6 | #4 | 9'-0" | 38" |

NOTE: THIS STRUCTURE SHOULD BE USED WITH PIPES SIZE 54" DIA. OR SMALLER.

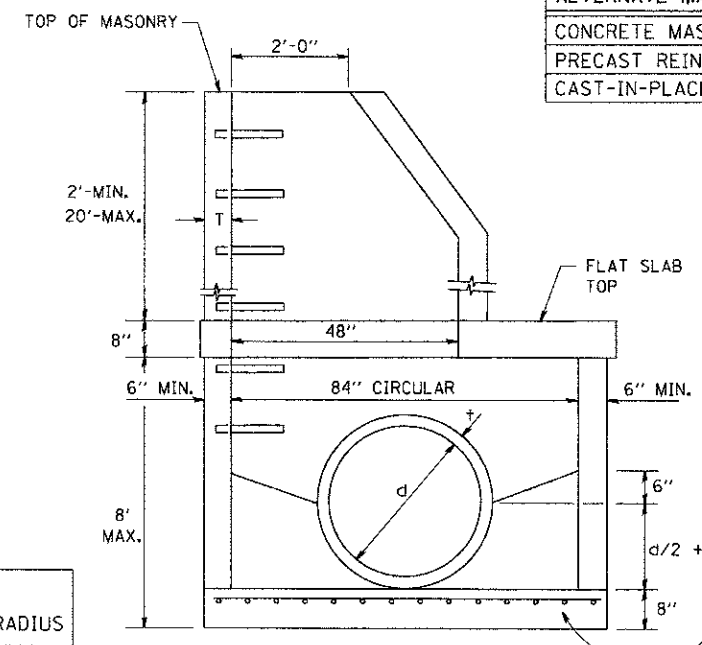

ELEVATION

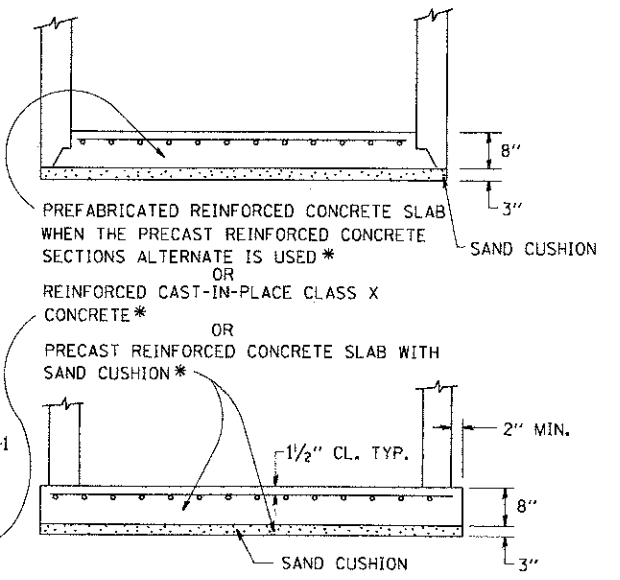

FILE NAME = W:\distato\22-34\bd37.dgn

USER NAME = gaglienob
DESIGNED -
DRAWN -
CHECKED -
DATE - 10-18-02

REVISOR -
REVISIONS -
REVISOR -
REVISIONS -

STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION

MANHOLE TYPE A
7 FOOT DIAMETER

SCALE: NONE SHEET NO. 1 OF 1 SHEETS STA. TO STA.

| | | | | |
|---|------------------------|-------------|--------------------|--------------|
| F.A.P. RTE. 326 | SECTION 11-00001-00-Ch | COUNTY KANE | TOTAL SHEETS 55 | SHEET NO. 40 |
| BD600-11 (BD-37) | | | CONTRACT NO. 63829 | |
| FED. ROAD DIST. NO. 1 ILLINOIS FED. AID PROJECT | | | | |